




# OIL ANALYSIS REPORT



Machine Id  
**BRCM03BE (S/N 6ZJ00395)**  
 Component  
**Biogas Engine**  
 Fluid  
**CHEVRON HDAX 9500 GAS ENGINE OIL 40 (150 GAL)**

Sample Rating Trend

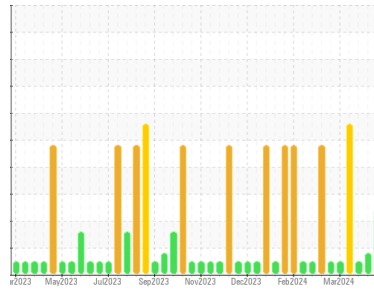

## DIAGNOSIS

- Recommendation**  
No corrective action is recommended at this time. Resample at the next service interval to monitor.
- Wear**  
The tin level is abnormal.
- Contamination**  
Elemental level of silicon (Si) above normal.

**Fluid Condition**  
 The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0760832</b>	WC0760872	WC0760867
Sample Date	Client Info		<b>19 Apr 2024</b>	12 Apr 2024	05 Apr 2024
Machine Age	hrs	Client Info	<b>92855</b>	92699	92545
Oil Age	hrs	Client Info	<b>332</b>	245	22
Oil Changed	Client Info		<b>Not Chngd</b>	Not Chngd	Not Chngd
Sample Status			<b>ABNORMAL</b>	ABNORMAL	NORMAL

## CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>4.0	<b>&lt;1.0</b>	<1.0	<1.0
Water	WC Method		<b>NEG</b>	NEG	NEG
Glycol	WC Method		<b>NEG</b>	NEG	NEG

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >14	<b>2</b>	2	0
Chromium	ppm	ASTM D5185m >3	<b>&lt;1</b>	0	0
Nickel	ppm	ASTM D5185m	<b>0</b>	<1	0
Titanium	ppm	ASTM D5185m	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >5	<b>2</b>	3	1
Lead	ppm	ASTM D5185m >8	<b>1</b>	1	0
Copper	ppm	ASTM D5185m >5	<b>0</b>	2	0
Tin	ppm	ASTM D5185m >3	<b>▲ 4</b>	<b>▲ 3</b>	<1
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>7</b>	7	7
Barium	ppm	ASTM D5185m	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	<b>8</b>	8	7
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	1	<1
Magnesium	ppm	ASTM D5185m	<b>36</b>	37	33
Calcium	ppm	ASTM D5185m	<b>1808</b>	1865	1712
Phosphorus	ppm	ASTM D5185m	<b>311</b>	332	284
Zinc	ppm	ASTM D5185m	<b>379</b>	390	351
Sulfur	ppm	ASTM D5185m	<b>2294</b>	2304	1243

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >180	<b>▲ 193</b>	110	36
Sodium	ppm	ASTM D5185m >20	<b>4</b>	2	1
Potassium	ppm	ASTM D5185m >20	<b>4</b>	2	0

## INFRA-RED

	method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844	<b>0</b>	0	0
Nitration	Abs/cm	*ASTM D7624	<b>6.1</b>	5.8	5.1
Sulfation	Abs/.1mm	*ASTM D7415	<b>18.7</b>	16.7	16.0


## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414	<b>11.2</b>	9.5	8.8
Acid Number (AN)	mg KOH/g	ASTM D8045 1.0	<b>1.31</b>	0.68	0.74
Base Number (BN)	mg KOH/g	ASTM D2896 5.4	<b>4.22</b>	4.63	5.23




# OIL ANALYSIS REPORT


## ▲ Non-ferrous Metals

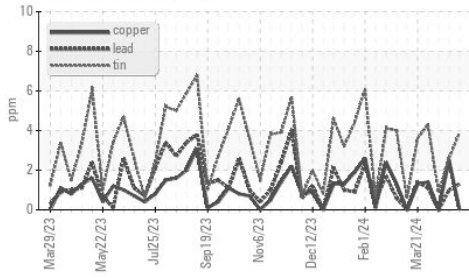


## ● FT-IR (Direct Trend)

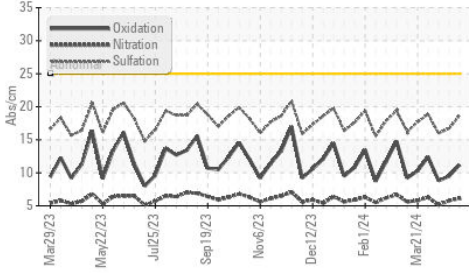


## Acid Number

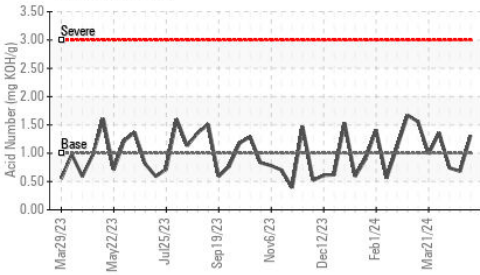

## Acid Number

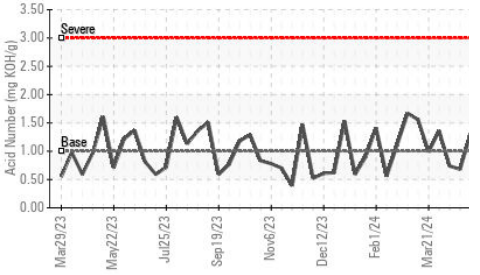









## Base Number

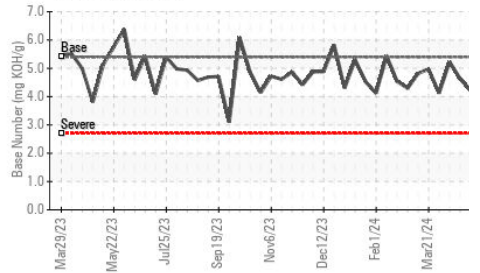

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	NEG	NEG	NEG
Free Water	scalar	*Visual	NEG	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	13.4	12.9	12.8

## GRAPHS

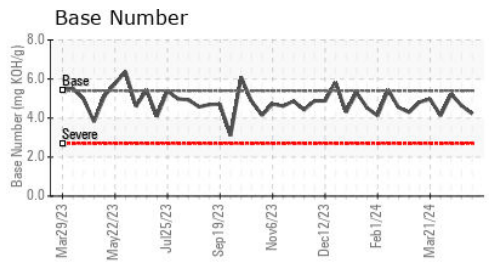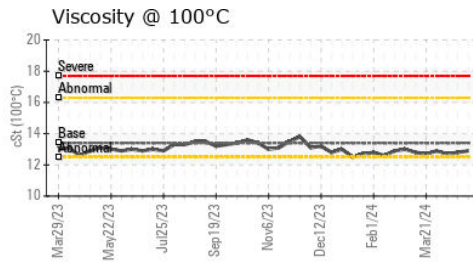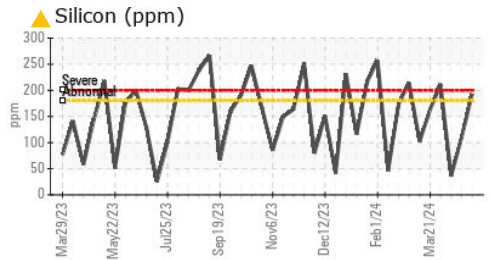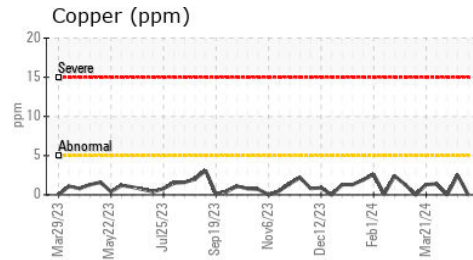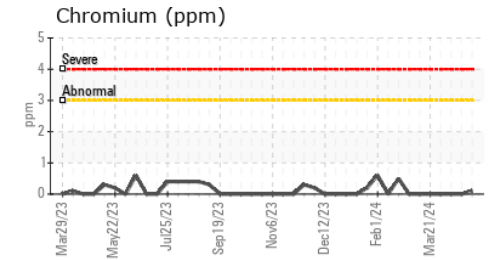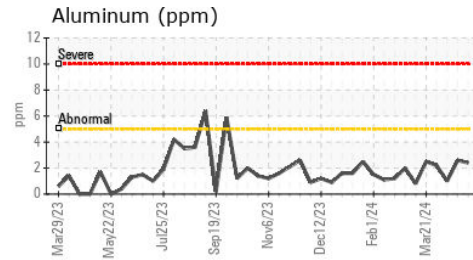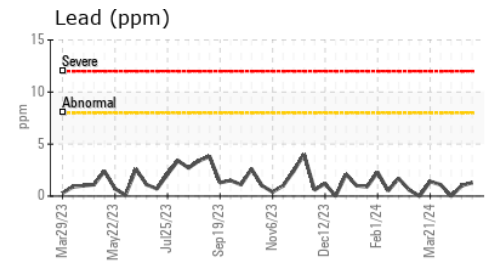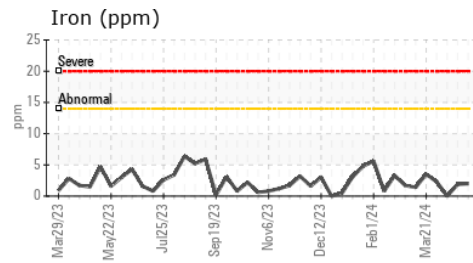

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513

Sample No. : WC0760832

Lab Number : 06157836

Unique Number : 10993259

Test Package : MOB 2

Received : 23 Apr 2024

Tested : 24 Apr 2024

Diagnosed : 25 Apr 2024 - Don Baldrige

EDL NA Recips-Brown County

BROWN COUNTY POWER STATION, 9427 BEYERS RD

GEORGETOWN, OH

US 45121

Contact: MITCHELL BUTLER

Mitchell.Butler@edlenergy.com

T:

F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)