




# OIL ANALYSIS REPORT



Machine Id  
**BRCM01BE (S/N GZJ00658)**  
 Component  
**Biogas Engine**  
 Fluid  
**CHEVRON HDAX 9500 GAS ENGINE OIL 40 (--- GAL)**

Sample Rating Trend

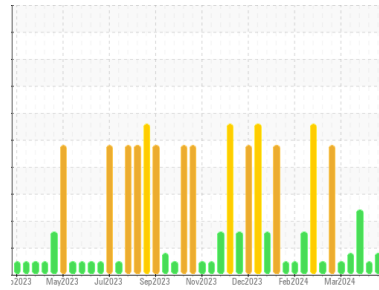

**WEAR**



## DIAGNOSIS

### ▲ Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

### ▲ Wear

The tin level is abnormal. All other component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0760833</b>	WC0760869	WC0760865
Sample Date	Client Info		<b>19 Apr 2024</b>	12 Apr 2024	05 Apr 2024
Machine Age	hrs	Client Info	<b>76145</b>	75990	75840
Oil Age	hrs	Client Info	<b>190</b>	35	400
Oil Changed	Client Info		<b>Not Chngd</b>	Not Chngd	Not Chngd
Sample Status			<b>MARGINAL</b>	NORMAL	ABNORMAL

## CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>4.0	<b>&lt;1.0</b>	<1.0	<1.0
Water	WC Method		<b>NEG</b>	NEG	NEG
Glycol	WC Method		<b>NEG</b>	NEG	NEG

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >14	<b>0</b>	<1	0
Chromium	ppm	ASTM D5185m >3	<b>&lt;1</b>	0	0
Nickel	ppm	ASTM D5185m	<b>0</b>	<1	0
Titanium	ppm	ASTM D5185m	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >5	<b>2</b>	2	2
Lead	ppm	ASTM D5185m >8	<b>0</b>	0	<1
Copper	ppm	ASTM D5185m >5	<b>0</b>	2	<1
Tin	ppm	ASTM D5185m >3	<b>▲ 3</b>	1	▲ 4
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>8</b>	9	6
Barium	ppm	ASTM D5185m	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	<b>5</b>	5	9
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	1	<1
Magnesium	ppm	ASTM D5185m	<b>27</b>	28	36
Calcium	ppm	ASTM D5185m	<b>1758</b>	1683	1848
Phosphorus	ppm	ASTM D5185m	<b>295</b>	292	315
Zinc	ppm	ASTM D5185m	<b>349</b>	349	383
Sulfur	ppm	ASTM D5185m	<b>2356</b>	2196	1825

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >180	<b>120</b>	33	▲ 198
Sodium	ppm	ASTM D5185m >20	<b>&lt;1</b>	2	2
Potassium	ppm	ASTM D5185m >20	<b>1</b>	2	0

## INFRA-RED

	method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844	<b>0</b>	0	0
Nitration	Abs/cm	*ASTM D7624	<b>5.8</b>	5.3	6.2
Sulfation	Abs/.1mm	*ASTM D7415	<b>17.8</b>	15.5	19.3


## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414	<b>10.0</b>	8.4	12.7
Acid Number (AN)	mg KOH/g	ASTM D8045 1.0	<b>0.96</b>	0.44	1.70
Base Number (BN)	mg KOH/g	ASTM D2896 5.4	<b>4.61</b>	5.18	3.77




# OIL ANALYSIS REPORT


## Non-ferrous Metals

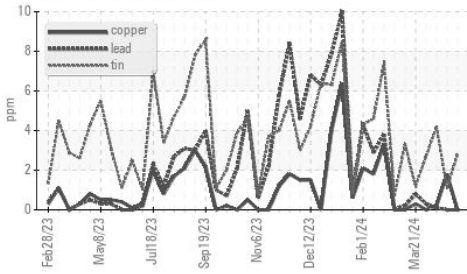


## FT-IR (Direct Trend)

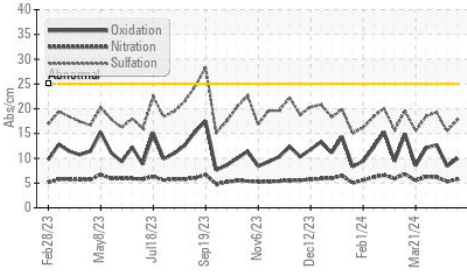


## Acid Number

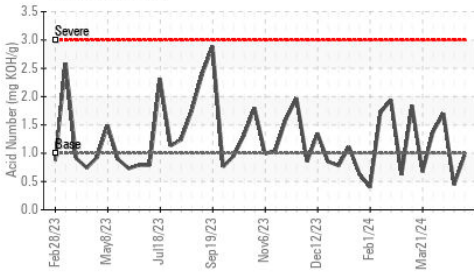

## Base Number

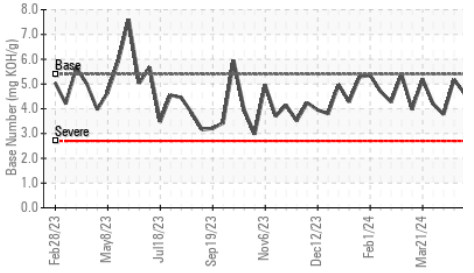

## Viscosity @ 100°C

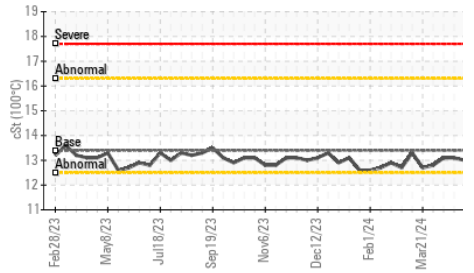


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	NEG	NEG	NEG
Free Water	scalar	*Visual	NEG	NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	13.4	13.0	13.1

## GRAPHS


### Iron (ppm)

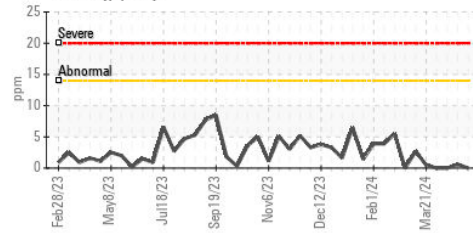


### Lead (ppm)

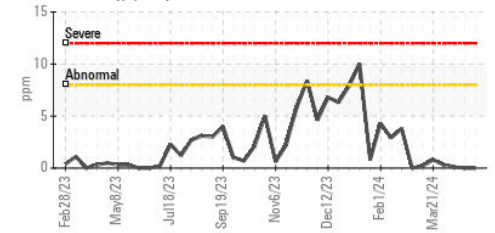


### Aluminum (ppm)

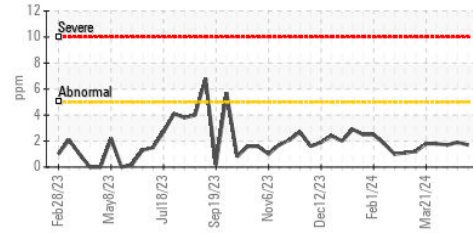


### Chromium (ppm)

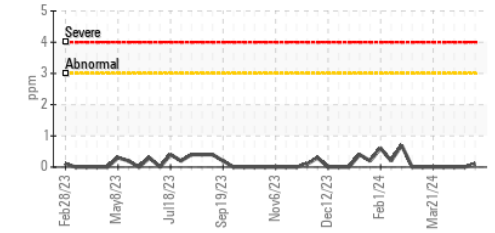


### Copper (ppm)

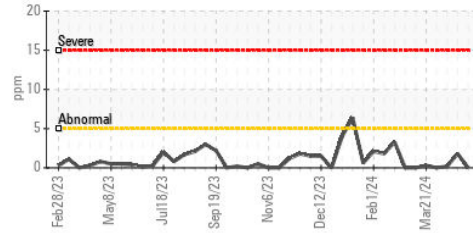


### Silicon (ppm)

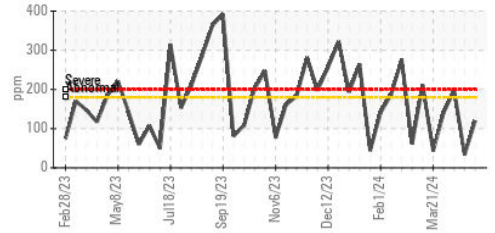

### Viscosity @ 100°C

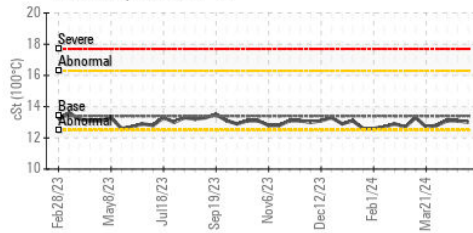

### Base Number

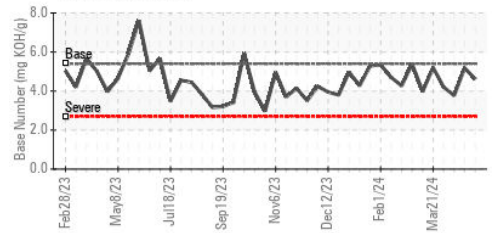

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513

Sample No. : WC0760833

Lab Number : 06157837

Unique Number : 10993260

Test Package : MOB 2

Received : 23 Apr 2024

Tested : 24 Apr 2024

Diagnosed : 25 Apr 2024 - Don Baldrige

EDL NA Recips-Brown County

BROWN COUNTY POWER STATION, 9427 BEYERS RD

GEORGETOWN, OH

US 45121

Contact: MITCHELL BUTLER

Mitchell.Butler@edlenergy.com

T:

F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)