




OIL ANALYSIS REPORT

Sample Rating Trend

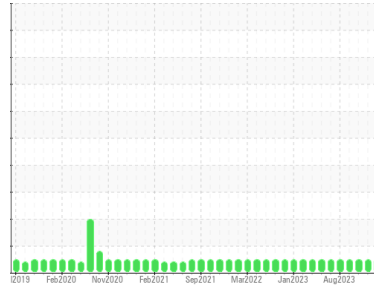

NORMAL



Area
Canton
 Machine Id
[Canton] Oil - Port Genset
 Component
Port Genset
 Fluid
MARATHON 15W40 (35 GAL)

DIAGNOSIS

Recommendation
 Resample at the next service interval to monitor. (Customer Sample Comment: Top Up Amount: 4 GAL)

Wear
 All component wear rates are normal.

Contamination
 There is no indication of any contamination in the oil.

Fluid Condition
 The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			WC0805423	WC0805430	WC0805398
Sample Date	Client Info			28 Mar 2024	27 Feb 2024	01 Feb 2024
Machine Age	hrs	Client Info		17830	0	17168
Oil Age	hrs	Client Info		3672	0	3009
Oil Changed	Client Info			Oil Added	N/A	Oil Added
Sample Status				NORMAL	NORMAL	NORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Fuel	WC Method		>4.0	<1.0	<1.0	<1.0
Glycol	WC Method			NEG	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	8	11	17
Chromium	ppm	ASTM D5185m	>4	<1	0	<1
Nickel	ppm	ASTM D5185m	>2	0	0	0
Titanium	ppm	ASTM D5185m		0	0	<1
Silver	ppm	ASTM D5185m	>5	0	0	0
Aluminum	ppm	ASTM D5185m	>12	4	1	2
Lead	ppm	ASTM D5185m	>17	0	0	<1
Copper	ppm	ASTM D5185m	>70	0	0	<1
Tin	ppm	ASTM D5185m	>15	<1	0	<1
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		141	137	151
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		117	112	125
Manganese	ppm	ASTM D5185m		<1	0	<1
Magnesium	ppm	ASTM D5185m		696	751	778
Calcium	ppm	ASTM D5185m		1488	1516	1576
Phosphorus	ppm	ASTM D5185m		759	697	803
Zinc	ppm	ASTM D5185m		921	883	985
Sulfur	ppm	ASTM D5185m		3117	3209	2935

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	5	4	6
Sodium	ppm	ASTM D5185m		8	7	11
Potassium	ppm	ASTM D5185m	>20	2	0	<1
Water	%	ASTM D6304	>0.1	NEG	NEG	NEG


INFRA-RED		method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844		0.2	0.2	0.2
Nitration	Abs/cm	*ASTM D7624	>20	11.0	11.0	11.9
Sulfation	Abs/.1mm	*ASTM D7415	>30	22.0	21.6	23.0

FLUID DEGRADATION		method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414	>25	21.6	21.5	24.0
Base Number (BN)	mg KOH/g	ASTM D2896		8.45	8.72	8.12




OIL ANALYSIS REPORT


FT-IR (Direct Trend)

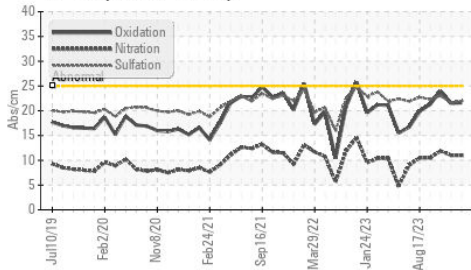


Water (KF)

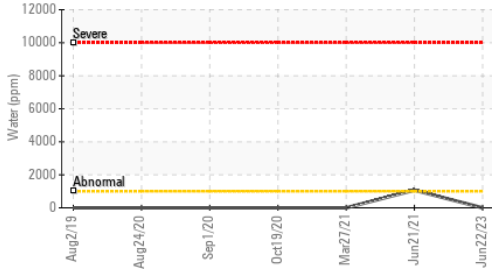

Base Number

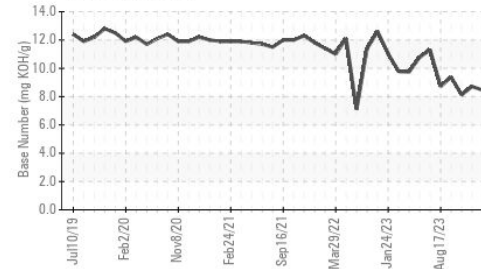

Water (KF)

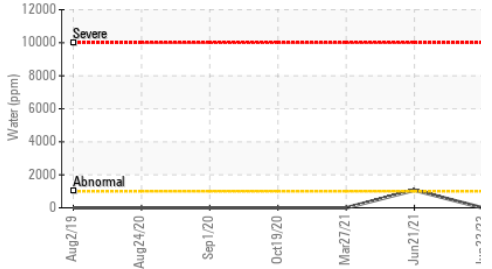


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	12.6	12.7	13.0

GRAPHS


Ferrous Alloys

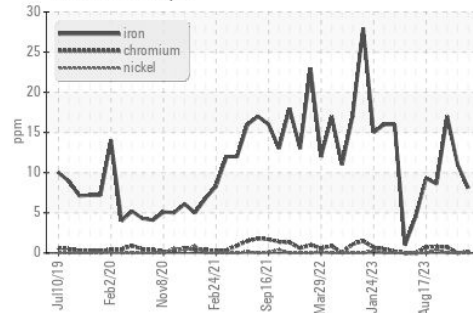


Non-ferrous Metals

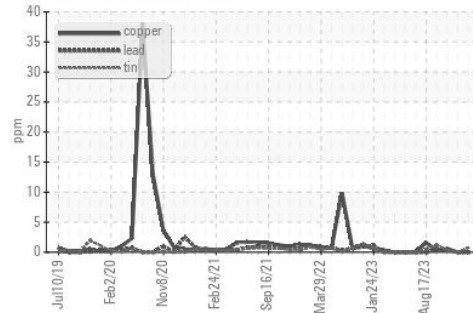

Viscosity @ 100°C

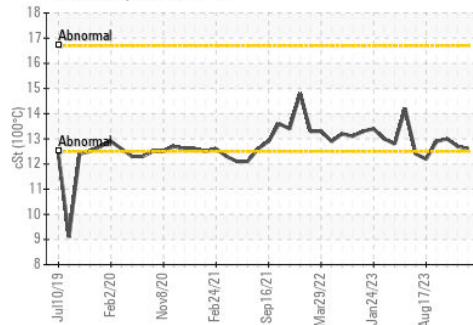

Base Number

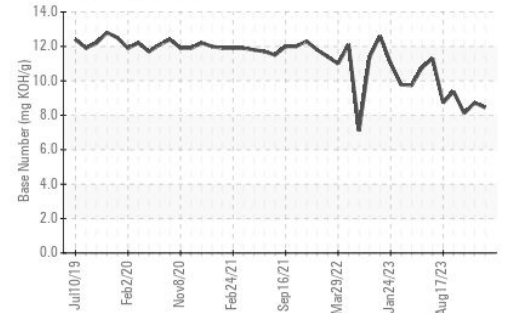

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513

Sample No. : WC0805423

Lab Number : 06157857

Unique Number : 10993280

Test Package : IND 2 (Additional Tests: KF)

Received : 23 Apr 2024

Tested : 25 Apr 2024

Diagnosed : 25 Apr 2024 - Sean Felton

MARATHON PETROLEUM CO.

101 12TH ST

CATLETTSBURG, KY

US 41169

Contact: M/V CANTON

mvcanton@marathonpetroleum.com

T:

F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)