




OIL ANALYSIS REPORT

Sample Rating Trend

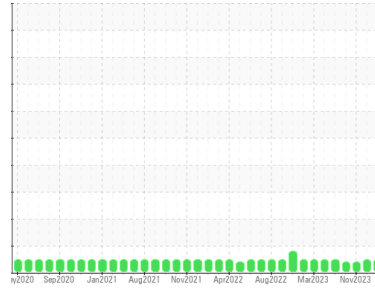

NORMAL



Area

Kenova

Machine Id

[Kenova] Oil - Starboard Genset

Component

Starboard Genset

Fluid

DIESEL ENGINE OIL SAE 15W40 (8 GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor. (Customer Sample Comment: Adam fields)

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			WC0859751	WC0805217	WC0805224
Sample Date	Client Info			10 Apr 2024	16 Jan 2024	20 Nov 2023
Machine Age	hrs	Client Info		1526	490	22266
Oil Age	hrs	Client Info		1526	490	3960
Oil Changed	Client Info			N/A	Not Changd	Not Changd
Sample Status				NORMAL	NORMAL	MARGINAL

CONTAMINATION		method	limit/base	current	history1	history2
Fuel	WC Method	>4.0		<1.0	<1.0	<1.0
Glycol	WC Method			NEG	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	38	18	18
Chromium	ppm	ASTM D5185m	>4	<1	<1	1
Nickel	ppm	ASTM D5185m	>2	0	<1	0
Titanium	ppm	ASTM D5185m		0	<1	0
Silver	ppm	ASTM D5185m	>5	0	<1	0
Aluminum	ppm	ASTM D5185m	>12	2	2	3
Lead	ppm	ASTM D5185m	>17	8	8	0
Copper	ppm	ASTM D5185m	>70	7	6	<1
Tin	ppm	ASTM D5185m	>15	2	2	<1
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	<1	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	250	93	131	118
Barium	ppm	ASTM D5185m	10	0	<1	0
Molybdenum	ppm	ASTM D5185m	100	74	63	92
Manganese	ppm	ASTM D5185m		4	5	<1
Magnesium	ppm	ASTM D5185m	450	468	410	616
Calcium	ppm	ASTM D5185m	3000	1837	1772	1492
Phosphorus	ppm	ASTM D5185m	1150	961	1017	650
Zinc	ppm	ASTM D5185m	1350	1218	1254	813
Sulfur	ppm	ASTM D5185m	4250	3337	3134	2433

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	11	10	4
Sodium	ppm	ASTM D5185m	>158	7	8	5
Potassium	ppm	ASTM D5185m	>20	<1	3	1
Water	%	ASTM D6304	>0.1	NEG	NEG	NEG


INFRA-RED		method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844		0.1	0.1	0.2
Nitration	Abs/cm	*ASTM D7624	>20	8.1	5.9	16.9
Sulfation	Abs/.1mm	*ASTM D7415	>30	20.3	19.0	31.5

FLUID DEGRADATION		method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414	>25	18.0	15.1	43.8
Base Number (BN)	mg KOH/g	ASTM D2896	8.5	8.86	9.33	5.74




OIL ANALYSIS REPORT


FT-IR (Direct Trend)

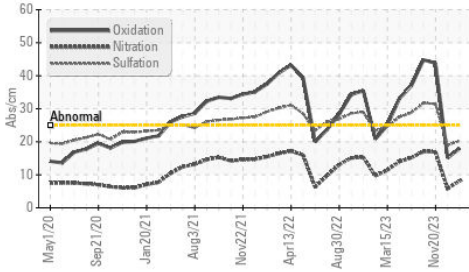


Water (KF)

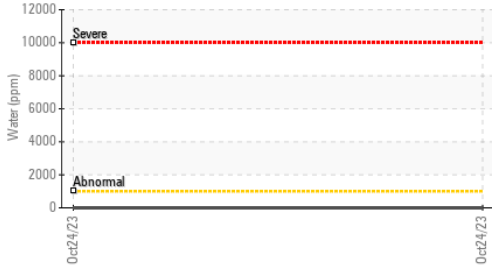

Viscosity @ 100°C

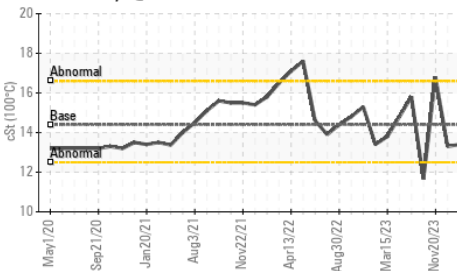

Water (KF)

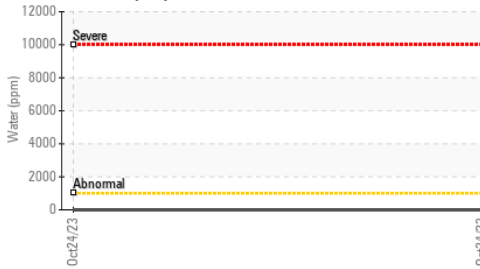


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	14.4	13.4	▲ 16.8

GRAPHS


Ferrous Alloys

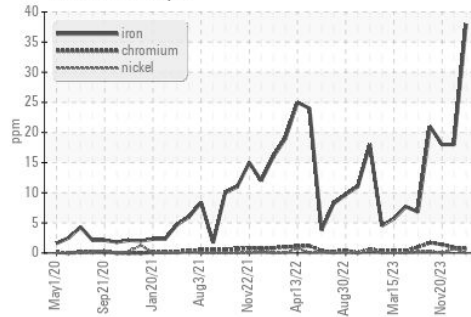


Non-ferrous Metals

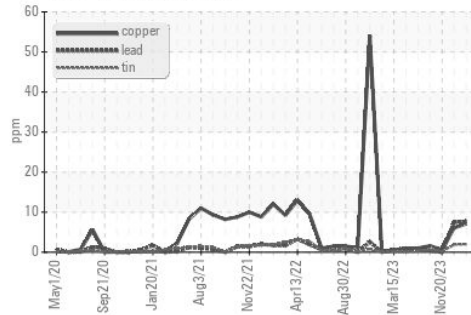

Viscosity @ 100°C

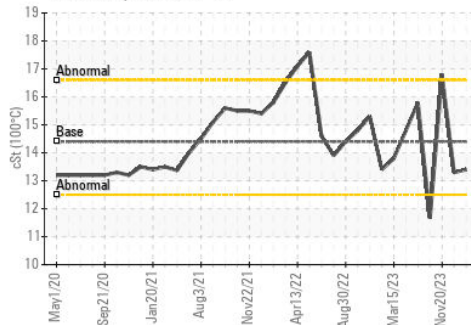

Base Number

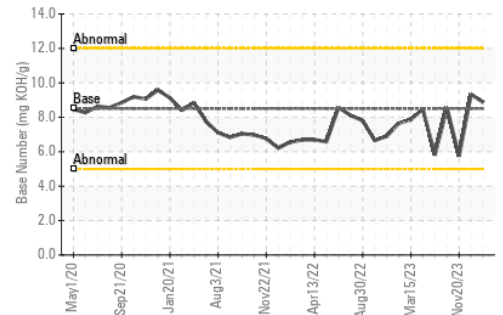

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513

Sample No. : WC0859751

Lab Number : 06157868

Unique Number : 10993291

Test Package : IND 2 (Additional Tests: KF)

Received : 23 Apr 2024

Tested : 25 Apr 2024

Diagnosed : 25 Apr 2024 - Sean Felton

MARATHON PETROLEUM CO.

101 12TH ST

CATLETTSBURG, KY

US 41169

Contact: CORY GUMBERT

cagumbert@marathonpetroleum.com

T: (606)585-3950

F: x:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)