



OIL ANALYSIS REPORT

Sample Rating Trend



ISO



Machine Id

E13 - DURATRAN E13 DURATRAN

Component

Bulk Tank New (Unused) Oil

Fluid

PETRO CANADA DURATRAN (--- GAL)

DIAGNOSIS

Recommendation

This is a baseline read-out on the submitted sample.

Contamination

There is a high amount of particulates present in the oil.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			KFS0005268	---	---
Sample Date	Client Info			22 Apr 2024	---	---
Machine Age	hrs	Client Info		0	---	---
Oil Age	hrs	Client Info		0	---	---
Oil Changed	Client Info			N/A	---	---
Sample Status				ABNORMAL	---	---

CONTAMINATION		method	limit/base	current	history1	history2
Water	WC Method			NEG	---	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>5	0	---	---
Chromium	ppm	ASTM D5185m	>5	0	---	---
Nickel	ppm	ASTM D5185m	>5	0	---	---
Titanium	ppm	ASTM D5185m		0	---	---
Silver	ppm	ASTM D5185m	>5	0	---	---
Aluminum	ppm	ASTM D5185m	>5	0	---	---
Lead	ppm	ASTM D5185m	>5	0	---	---
Copper	ppm	ASTM D5185m	>5	0	---	---
Tin	ppm	ASTM D5185m	>5	0	---	---
Vanadium	ppm	ASTM D5185m		0	---	---
Cadmium	ppm	ASTM D5185m		0	---	---






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	110	94	---	---
Barium	ppm	ASTM D5185m	0.0	0	---	---
Molybdenum	ppm	ASTM D5185m	0.0	4	---	---
Manganese	ppm	ASTM D5185m	1	0	---	---
Magnesium	ppm	ASTM D5185m	13	86	---	---
Calcium	ppm	ASTM D5185m	3610	3233	---	---
Phosphorus	ppm	ASTM D5185m	1192	1131	---	---
Zinc	ppm	ASTM D5185m	1455	1382	---	---
Sulfur	ppm	ASTM D5185m	2641	3452	---	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	9	---	---
Sodium	ppm	ASTM D5185m		<1	---	---
Potassium	ppm	ASTM D5185m	>20	0	---	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>5000	▲ 30878	---	---
Particles >6µm		ASTM D7647	>1300	▲ 6088	---	---
Particles >14µm		ASTM D7647	>160	▲ 329	---	---
Particles >21µm		ASTM D7647	>40	▲ 95	---	---
Particles >38µm		ASTM D7647	>10	5	---	---
Particles >71µm		ASTM D7647	>3	0	---	---
Oil Cleanliness		ISO 4406 (c)	>19/17/14	▲ 22/20/16	---	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.6	1.15	---	---

OIL ANALYSIS REPORT

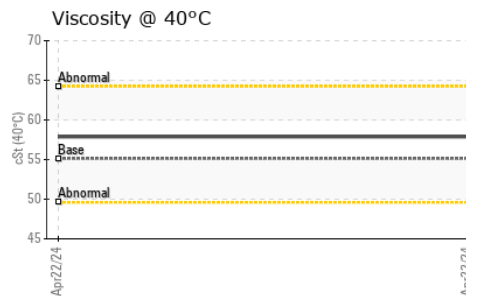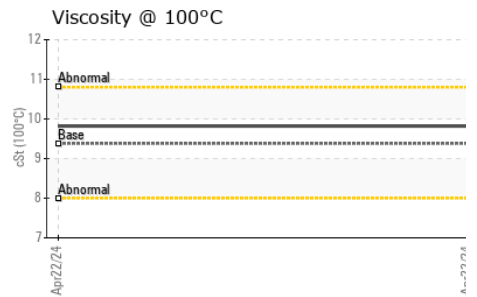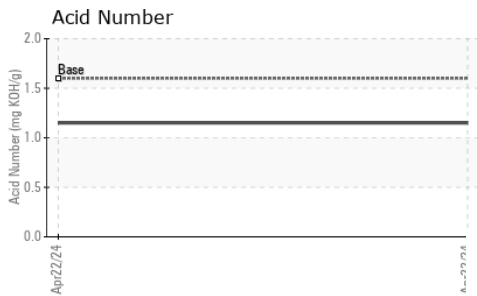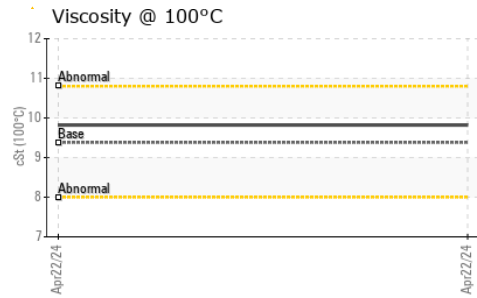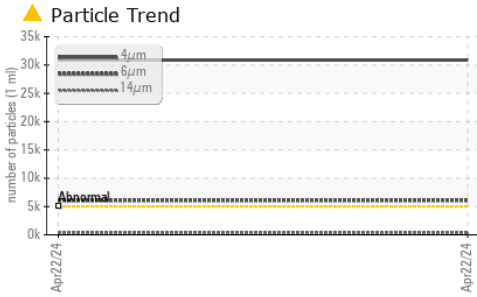



VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	NEG	---	---
Free Water	scalar	*Visual	NEG	---	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	55.14	57.88	---
Visc @ 100°C	cSt	ASTM D445	9.38	9.82	---
Viscosity Index (VI)	Scale	ASTM D2270	153	155	---

SAMPLE IMAGES

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color				no image	no image
Bottom				no image	no image

GRAPHS

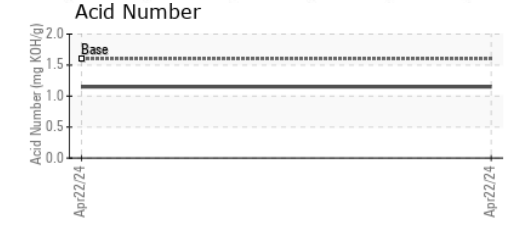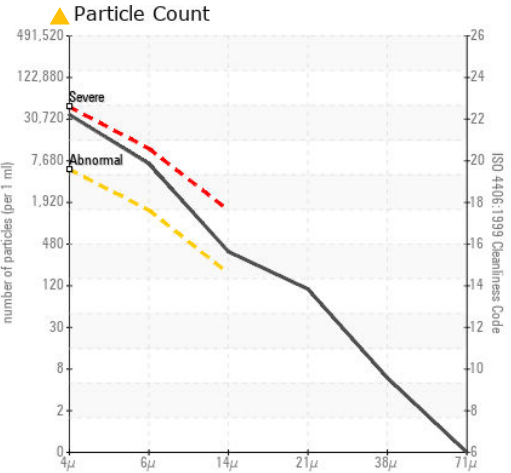

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KFS0005268 **Received** : 23 Apr 2024
Lab Number : 06158200 **Tested** : 25 Apr 2024
Unique Number : 10993623 **Diagnosed** : 25 Apr 2024 - Jonathan Hester
Test Package : IND 2 (Additional Tests: FT-IR, ICP-NewOil, KV100, PrtCount, VI)

CONSTELLIUM
 4805 SECOND STREET
 MUSCLE SHOALS, AL
 US 35661
 Contact: Randy Nichols
 randall.nichols@constellium.com
 T: (256)386-6956
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)