




# FUEL REPORT

Sample Rating Trend

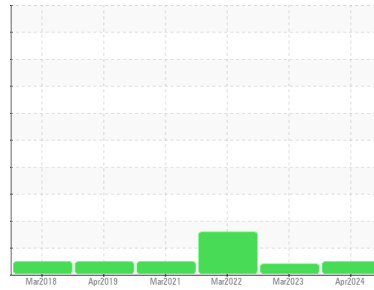

**NORMAL**



Machine Id  
**GATEWAY MED**

Component  
**Diesel Fuel**

Fluid  
**No.2 DIESEL FUEL (ULTRALOW SULPHUR) (2700 GAL)**

## DIAGNOSIS

### Recommendation

All laboratory tests indicate that this sample meets specifications for No.2 low-sulfur diesel fuel.

### Corrosion

All metal levels are normal indicating no corrosion in the system.

### Contaminants

There is no bacteria or fungus (yeast and/or mold) indicated in the sample. The water content is negligible. There is no indication of any contamination in the fuel.

### Fuel Condition

Sulfur value derived by ASTM D5453 method for ULSD validation.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>WCDF4605</b>	WCDF4341	WCDF04403
Sample Date	Client Info			<b>18 Apr 2024</b>	16 Mar 2023	07 Mar 2022
Machine Age	mls	Client Info		<b>0</b>	0	0
Sample Status				<b>NORMAL</b>	ABNORMAL	ABNORMAL

PHYSICAL PROPERTIES		method	limit/base	current	history1	history2
Specific Gravity		*ASTM D1298	0.839	---	0.840	0.840
Fuel Color	text	*Visual Screen	Yllow	<b>Red</b>	Red	Red
ASTM Color	scalar	*ASTM D1500		<b>L5.5</b>	L5.5	L5.0
Visc @ 40°C	cSt	ASTM D445	3.0	<b>2.57</b>	2.57	2.59
Pensky-Martens Flash Point	°C	*PMCC Calculated	52	<b>62.4</b>	61	62
Cloud Point	°C	ASTM D5771		<b>-11</b>	-12	-12

SULFUR CONTENT		method	limit/base	current	history1	history2
Sulfur	ppm	ASTM D5185m	10	<b>0</b>	0	6
Sulfur (UVF)	ppm	ASTM D5453		<b>13</b>	13	10





DISTILLATION		method	limit/base	current	history1	history2
Initial Boiling Point	°C	ASTM D86	165	<b>174</b>	169	28
5% Distillation Point	°C	ASTM D86		<b>196</b>	195	192
10% Distill Point	°C	ASTM D86	201	<b>206</b>	205	203
15% Distillation Point	°C	ASTM D86		<b>213</b>	213	211
20% Distill Point	°C	ASTM D86	216	<b>221</b>	219	219
30% Distill Point	°C	ASTM D86	230	<b>236</b>	233	233
40% Distill Point	°C	ASTM D86	243	<b>249</b>	247	247
50% Distill Point	°C	ASTM D86	255	<b>262</b>	260	260
60% Distill Point	°C	ASTM D86	267	<b>276</b>	274	274
70% Distill Point	°C	ASTM D86	280	<b>290</b>	289	289
80% Distill Point	°C	ASTM D86	295	<b>305</b>	305	305
85% Distillation Point	°C	ASTM D86		<b>316</b>	315	314
90% Distill Point	°C	ASTM D86	310	<b>326</b>	326	326
95% Distillation Point	°C	ASTM D86		<b>345</b>	343	343
Final Boiling Point	°C	ASTM D86	341	<b>359</b>	352	352
Distillation Residue	%	ASTM D86	3.0	---	1.4	1.4
Distillation Loss	%	ASTM D86	3.0	---	0.6	0.7

IGNITION QUALITY		method	limit/base	current	history1	history2
API Gravity		ASTM D7777	37.7	<b>36</b>	37.0	37.0
Cetane Index		ASTM D4737	<40.0	<b>49</b>	48.7	48.6

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	<1.0	<b>0</b>	1	0
Sodium	ppm	ASTM D5185m	<0.1	<b>0</b>	<1	0
Potassium	ppm	ASTM D5185m	<0.1	<b>0</b>	0	1
Water	%	ASTM D6304	<0.05	<b>0.008</b>	0.009	0.012
ppm Water	ppm	ASTM D6304	<500	<b>81</b>	99.8	129.3
% Gasoline	%	*In-House	<0.50	<b>0.0</b>	0.0	0.0
% Biodiesel	%	*In-House	<20.0	<b>0.0</b>	0.0	0.0






# FUEL REPORT

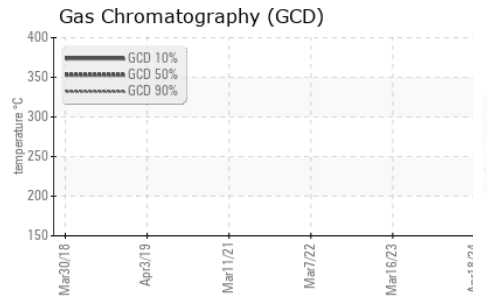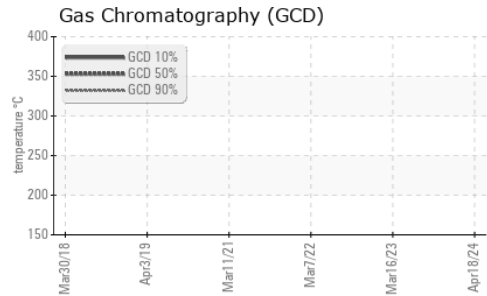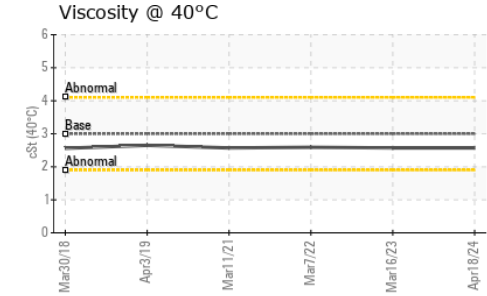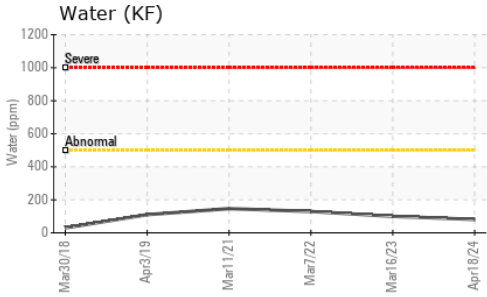

HEAVY METALS		method	limit/base	current	history1	history2
Aluminum	ppm	ASTM D5185m	<0.1	0	<1	<1
Nickel	ppm	ASTM D5185m	<0.1	0	0	0
Lead	ppm	ASTM D5185m	<0.1	0	0	0
Vanadium	ppm	ASTM D5185m	<0.1	0	<1	0
Iron	ppm	ASTM D5185m	<0.1	0	0	0
Calcium	ppm	ASTM D5185m	<0.1	0	0	0
Magnesium	ppm	ASTM D5185m	<0.1	0	3	0
Phosphorus	ppm	ASTM D5185m	<0.1	3	7	3
Zinc	ppm	ASTM D5185m	<0.1	0	0	0

SAMPLE IMAGES		method	limit/base	current	history1	history2
Color						no image
Bottom						no image

## GRAPHS

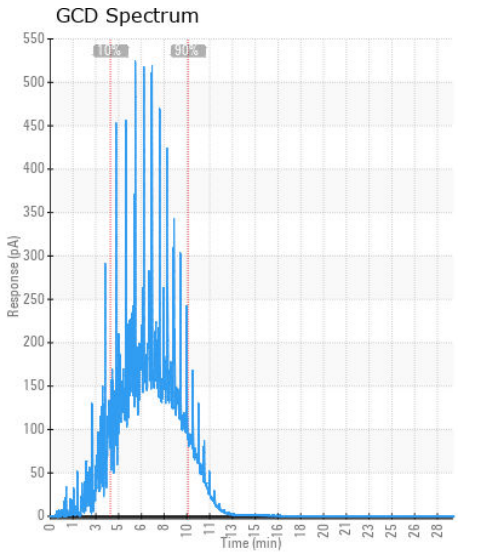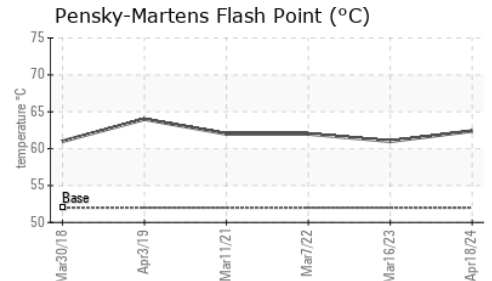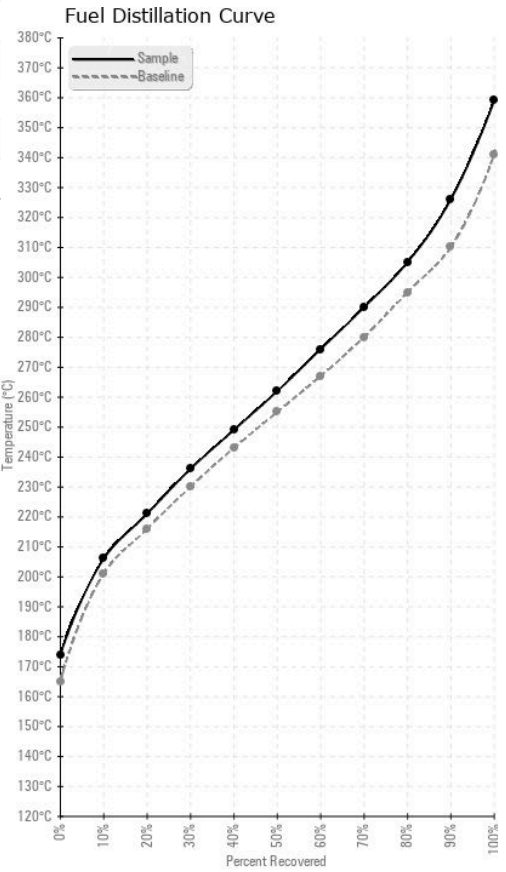

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WCDF4605 **Received** : 23 Apr 2024  
**Lab Number** : 06158219 **Tested** : 06 May 2024  
**Unique Number** : 10993642 **Diagnosed** : 06 May 2024 - Doug Bogart  
**Test Package** : DF-2 ( Additional Tests: CldPt, Fuel, PrtCount, Screen )

**TANK WIZARDS**  
 1511 MASTERS RD NW  
 PALM BAY, FL  
 US 32907  
 Contact: WENDALL STRODERD  
 wendall@tankwizards.com  
 T: (321)427-5149  
 F: (321)574-4131

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)