


# **OIL ANALYSIS REPORT**

Sample Rating Trend

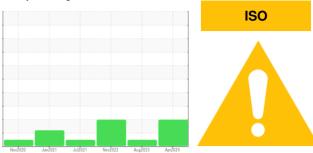

Machine Id

## **KAESER 7372186**

Component Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

### **DIAGNOSIS**

#### Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

### Contamination

There is a high amount of particulates present in the oil.

#### **Fluid Condition**


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		10002020	Janzozi Julzozi	NOVEUZE AUGEUZS	Apr2024	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA016452	KCPA003526	KCP46760D
Sample Date		Client Info		19 Apr 2024	29 Aug 2023	03 Nov 2022
Machine Age	hrs	Client Info		30989	25496	19708
Oil Age	hrs	Client Info		5500	0	9778
Oil Changed		Client Info		Not Changd	N/A	Changed
Sample Status				ABNORMAL	NORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	2	0	0
Chromium	ppm	ASTM D5185m	>10	<1	0	0
Nickel	ppm	ASTM D5185m	>3	<1	0	0
Titanium	ppm	ASTM D5185m	>3	<1	<1	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	2	0	0
Lead	ppm	ASTM D5185m	>10	<1	0	0
Copper	ppm	ASTM D5185m	>50	10	17	8
Tin	ppm	ASTM D5185m	>10	<1	0	0
Antimony	ppm	ASTM D5185m				
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		<1	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m	90	1	0	0
Molybdenum	ppm	ASTM D5185m		<1	0	0
Manganese	ppm	ASTM D5185m		<1	0	0
Magnesium	ppm	ASTM D5185m	90	3	0	0
Calcium	ppm	ASTM D5185m	2	3	0	0
Phosphorus	ppm	ASTM D5185m		2	2	4
Zinc	ppm	ASTM D5185m		<1	0	0
Sulfur	ppm	ASTM D5185m		16803	17447	14558
CONTAMINANTS	)	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	<1	0
Sodium	ppm	ASTM D5185m		<1	<1	0
Potassium	ppm	ASTM D5185m	>20	<1	0	0
Water	%	ASTM D6304	>0.05	0.007	0.004	0.008
ppm Water	ppm	ASTM D6304	>500	73	46.7	81.0
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4μm		ASTM D7647		65484	471	5484
Particles >6µm		ASTM D7647	>1300	<u>^</u> 24154	129	<u>^</u> 2144
Particles >14µm		ASTM D7647	>80	<u> </u>	8	<u>\$\text{252}\$</u>
Particles >21µm		ASTM D7647	>20	<b>△</b> 639	1	<b>△</b> 55
Particles >38µm		ASTM D7647	>4	<b>9</b>	0	<u>^</u> 6
Particles >71µm		ASTM D7647	>3	0	0	1
Oil Cleanliness		ISO 4406 (c)	>/17/13	<b>23/22/19</b>	16/14/10	<u>^</u> 20/18/15
FLUID DEGRADA	TION	method	limit/base	current	history1	history2

0.53



## **OIL ANALYSIS REPORT**

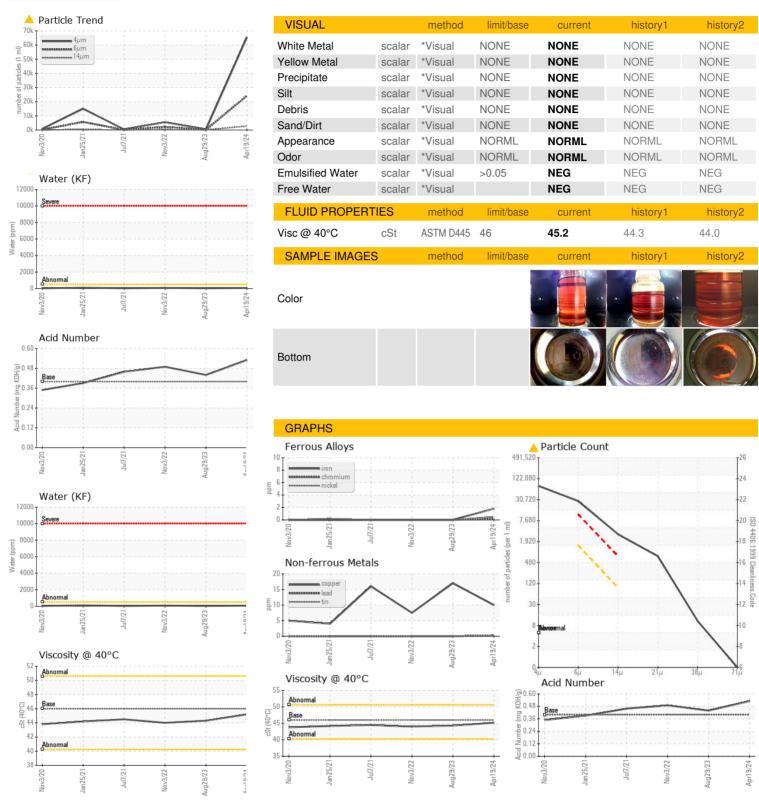





Certificate 12367

Laboratory Sample No.

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 : 06158462

Lab Number Unique Number: 10993885

: KCPA016452

Received : 23 Apr 2024 **Tested** : 25 Apr 2024

Diagnosed : 25 Apr 2024 - Angela Borella

Test Package : IND 2 ( Additional Tests: KF, PrtCount )

To discuss this sample report, contact Customer Service at 1-800-237-1369. \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

**FLORIDA TILE** 

US 40342

T:

1247 ALTON RD

LAWRENCEBURG, KY

Contact: Service Manager