


# **OIL ANALYSIS REPORT**

Sample Rating Trend

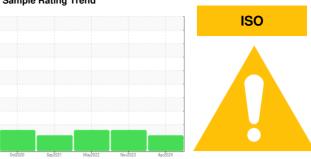

Machine Id

# KAESER SK15 6875479 (S/N 1381)

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

### **DIAGNOSIS**

#### Recommendation

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

## Contamination

There is a high amount of particulates present in the oil.

#### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		0ct2020	Sep 2021	May2022 Nov2023	Apr2024	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA015364	KCPA009066	KCP44700
Sample Date		Client Info		11 Apr 2024	10 Nov 2023	19 May 2022
Machine Age	hrs	Client Info		27947	25556	16795
Oil Age	hrs	Client Info		6000	0	4322
Oil Changed		Client Info		Changed	N/A	Changed
Sample Status				ABNORMAL	ABNORMAL	ATTENTION
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	0	<1
Chromium	ppm	ASTM D5185m	>10	<1	0	0
Nickel	ppm	ASTM D5185m	>3	<1	0	0
Titanium	ppm	ASTM D5185m	>3	<1	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	2	<1	<1
Lead	ppm	ASTM D5185m	>10	<1	0	0
Copper	ppm	ASTM D5185m	>50	9	9	7
Tin	ppm	ASTM D5185m	>10	<1	<1	0
Antimony	ppm	ASTM D5185m				
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		<1	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	<1
Barium	ppm	ASTM D5185m	90	0	1	17
Molybdenum	ppm	ASTM D5185m	0	<1	0	0
Manganese	ppm	ASTM D5185m		<1	0	0
Magnesium	ppm	ASTM D5185m	100	2	16	28
Calcium	ppm	ASTM D5185m	0	3	2	0
Phosphorus	ppm	ASTM D5185m	0	3	1	<1
Zinc	ppm	ASTM D5185m	0	0	0	7
Sulfur	ppm	ASTM D5185m	23500	20104	19129	18172
CONTAMINANTS	)	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	2	1	2
Sodium	ppm	ASTM D5185m		0	3	12
Potassium	ppm	ASTM D5185m	>20	<1	0	0
Water	%	ASTM D6304	>0.05	0.006	0.006	0.019
ppm Water	ppm	ASTM D6304	>500	67	67.5	192.4
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		8071	4726	6376
Particles >6µm		ASTM D7647	>1300	<u>^</u> 2754	<u></u> 1697	1684
Particles >14µm		ASTM D7647	>80	<u> </u>	<u> </u>	<b>151</b>
		ACTM D7647	>20	28	<u>4</u> 1	<b>2</b> 6
Particles >21µm		ASTM D7647	720	_0		
•		ASTM D7647 ASTM D7647	>4	0	3	2
Particles >21μm						
Particles >21μm Particles >38μm		ASTM D7647	>4	0	3	2



## OIL ANALYSIS REPORT







Certificate 12367

Laboratory Sample No. Lab Number

: KCPA015364

: 06158464 Unique Number: 10993887 Received : 23 Apr 2024 **Tested** Diagnosed

: 25 Apr 2024

: 25 Apr 2024 - Angela Borella

Test Package : IND 2 ( Additional Tests: KF, PrtCount ) To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Contact/Location: J. BRADLEY - APCCHE

770 SPIRIT OF ST LOUIS BLVD

CHESTERFIELD, MO

Contact: J. BRADLEY

jbradley@apcisg.com

US 63005

T:

F: