


OIL ANALYSIS REPORT

Sample Rating Trend



Machine Id

KAESER ESD 250 7882652 (S/N 2050)

Component Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Ap	2022	Jul2023 Apr202	14	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
		Client Info	mma sass	KCPA013639	KCPA001752	KC89865
Sample Number Sample Date		Client Info		12 Apr 2024	09 Jul 2023	28 Apr 2022
Machine Age	hrs	Client Info		12 Apr 2024 10856	7172	3664
Oil Age	hrs	Client Info		3684	0	3664
ū	1115	Client Info			N/A	Changed
Oil Changed Sample Status		Ciletit IIIIO		Changed NORMAL	ABNORMAL	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	nnm	ASTM D5185m	>50	<1	0	<1
Chromium	ppm	ASTM D5185m	>10	<1	0	0
Nickel	ppm	ASTM D5185m	>3	<1	<1	0
Titanium	ppm	ASTM D5185m		<1	0	0
Silver	ppm	ASTM D5185m	>2	0	<1	<1
Aluminum	ppm	ASTM D5185m		2	0	<1
Lead		ASTM D5185m	>10	<1	1	0
	ppm			6	6	1
Copper	ppm	ASTM D5185m ASTM D5185m	>50 >10	<1	0	0
Vanadium	ppm	ASTM D5185m	>10	0	0	0
	ppm			-		
Cadmium	ppm	ASTM D5185m		<1	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	<1
Barium	ppm	ASTM D5185m	90	0	<1	38
Molybdenum	ppm	ASTM D5185m		<1	0	0
Manganese	ppm	ASTM D5185m		<1	0	<1
Magnesium	ppm	ASTM D5185m	90	<1	1	53
Calcium	ppm	ASTM D5185m	2	3	0	2
Phosphorus	ppm	ASTM D5185m		3	3	4
Zinc	ppm	ASTM D5185m		0	0	0
Sulfur	ppm	ASTM D5185m		17392	19053	16549
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	1	<1
Sodium	ppm	ASTM D5185m		0	0	9
Potassium	ppm	ASTM D5185m	>20	<1	2	5
Water	%	ASTM D6304	>0.05	0.005	0.003	0.011
ppm Water	ppm	ASTM D6304	>500	59	37.8	114.7
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		2602	5520	1468
Particles >6μm		ASTM D7647	>1300	1067	<u>△</u> 2582	485
Particles >14μm		ASTM D7647	>80	20	55	15
Particles >21µm		ASTM D7647	>20	7	6	2
Particles >38μm		ASTM D7647	>4	0	0	0
Particles >71µm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>/17/13	19/17/11	<u>20/19/13</u>	16/11
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.51	0.44	0.44



OIL ANALYSIS REPORT

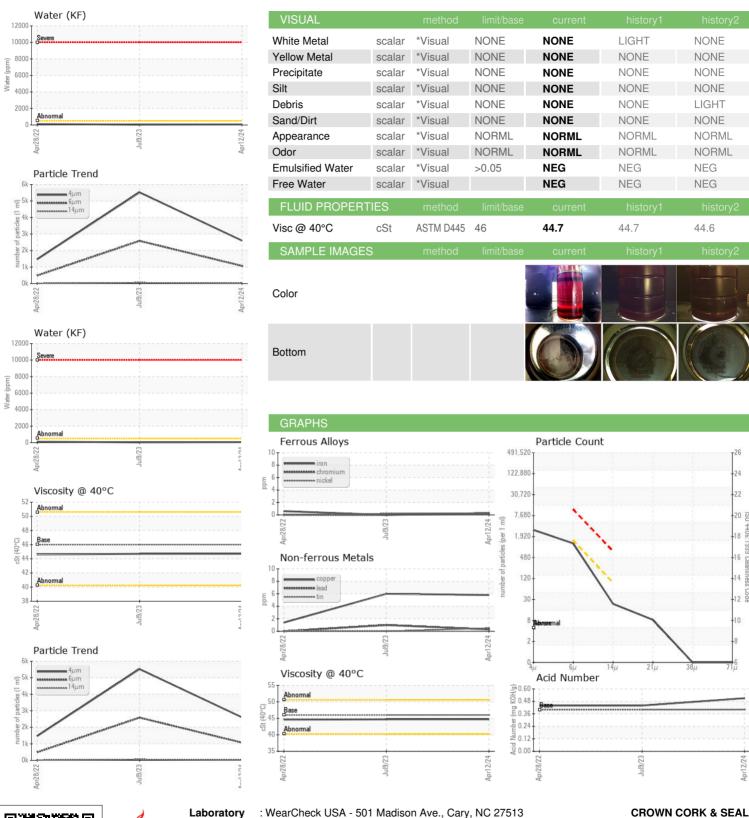





Certificate 12367

Laboratory Sample No.

Lab Number

: KCPA013639 : 06158471 Unique Number : 10993894

Received : 23 Apr 2024 **Tested** Diagnosed

: 25 Apr 2024 : 25 Apr 2024 - Angela Borella 5005 N SPRINGBORO PIKE DAYTON, OH

RENE.SANTIAGO@CROWNCORK.COM

Contact: RENE SANTIAGO

Test Package : IND 2 (Additional Tests: KF, PrtCount) To discuss this sample report, contact Customer Service at 1-800-237-1369.

 st - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

US 45439

T:

F: