




# OIL ANALYSIS REPORT

## Sample Rating Trend

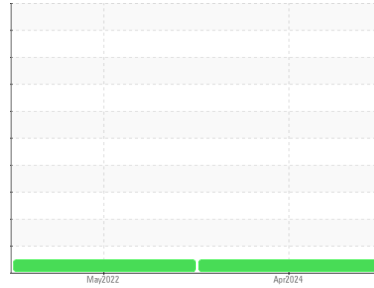

**NORMAL**



Machine Id  
**KAESER ESD 250 7910182 (S/N 2052)**  
 Component  
**Compressor**  
 Fluid  
**KAESER SIGMA (OEM) S-460 (--- GAL)**

### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

### SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>KCPA016628</b>	KC89864	---
Sample Date	Client Info		<b>12 Apr 2024</b>	06 May 2022	---
Machine Age	hrs	Client Info	<b>10432</b>	2695	---
Oil Age	hrs	Client Info	<b>0</b>	2695	---
Oil Changed	Client Info		<b>Changed</b>	Changed	---
Sample Status			<b>NORMAL</b>	NORMAL	---

### WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>&lt;1</b>	<1	---
Chromium	ppm	ASTM D5185m >10	<b>&lt;1</b>	0	---
Nickel	ppm	ASTM D5185m >3	<b>&lt;1</b>	0	---
Titanium	ppm	ASTM D5185m >3	<b>&lt;1</b>	0	---
Silver	ppm	ASTM D5185m >2	<b>0</b>	0	---
Aluminum	ppm	ASTM D5185m >10	<b>2</b>	<1	---
Lead	ppm	ASTM D5185m >10	<b>&lt;1</b>	<1	---
Copper	ppm	ASTM D5185m >50	<b>6</b>	2	---
Tin	ppm	ASTM D5185m >10	<b>&lt;1</b>	0	---
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	---
Cadmium	ppm	ASTM D5185m	<b>&lt;1</b>	0	---

### ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	0	---
Barium	ppm	ASTM D5185m 90	<b>0</b>	0	---
Molybdenum	ppm	ASTM D5185m	<b>&lt;1</b>	0	---
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	0	---
Magnesium	ppm	ASTM D5185m 90	<b>&lt;1</b>	33	---
Calcium	ppm	ASTM D5185m 2	<b>4</b>	0	---
Phosphorus	ppm	ASTM D5185m	<b>2</b>	<1	---
Zinc	ppm	ASTM D5185m	<b>0</b>	0	---
Sulfur	ppm	ASTM D5185m	<b>18770</b>	15309	---

### CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>&lt;1</b>	1	---
Sodium	ppm	ASTM D5185m	<b>0</b>	3	---
Potassium	ppm	ASTM D5185m >20	<b>&lt;1</b>	2	---
Water	%	ASTM D6304 >0.05	<b>0.005</b>	0.010	---
ppm Water	ppm	ASTM D6304 >500	<b>54</b>	108.7	---






### FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		<b>2065</b>	548	---
Particles >6µm	ASTM D7647	>1300	<b>820</b>	138	---
Particles >14µm	ASTM D7647	>80	<b>37</b>	15	---
Particles >21µm	ASTM D7647	>20	<b>9</b>	5	---
Particles >38µm	ASTM D7647	>4	<b>0</b>	0	---
Particles >71µm	ASTM D7647	>3	<b>0</b>	0	---
Oil Cleanliness	ISO 4406 (c)	>--/17/13	<b>18/17/12</b>	16/14/11	---

### FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	<b>0.50</b>	0.42	---


# OIL ANALYSIS REPORT

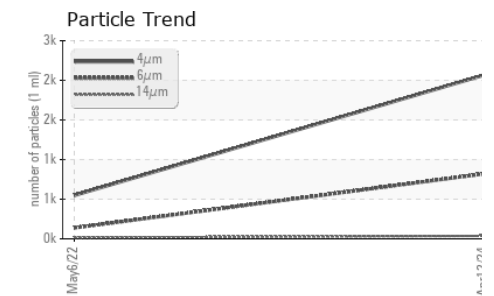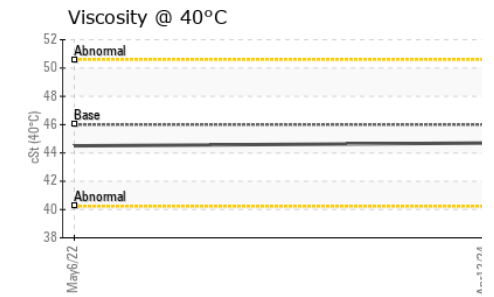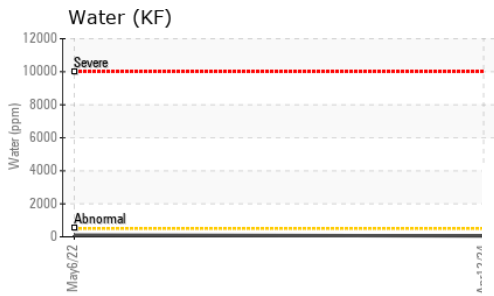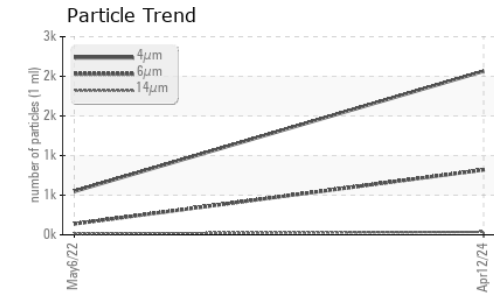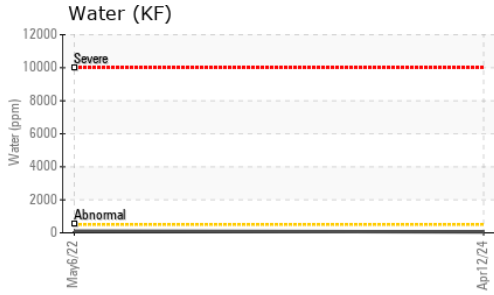





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	44.7	44.5	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

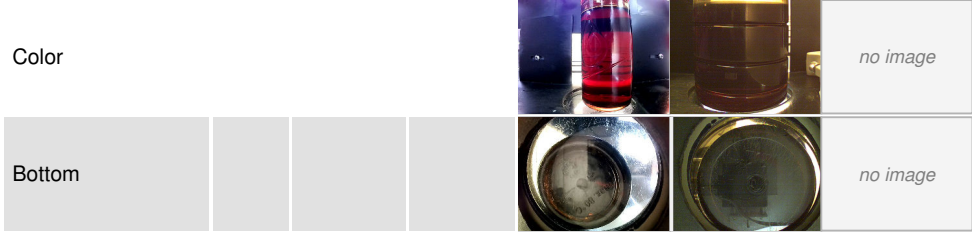

## GRAPHS

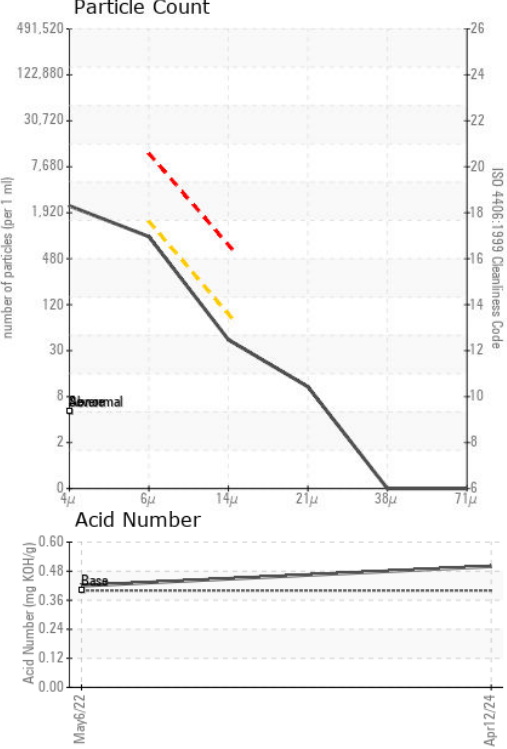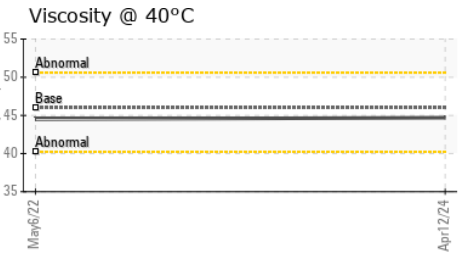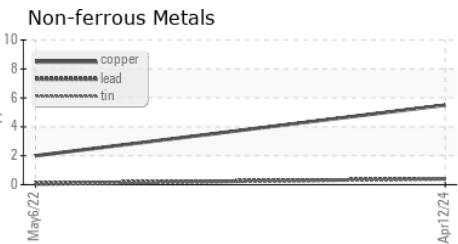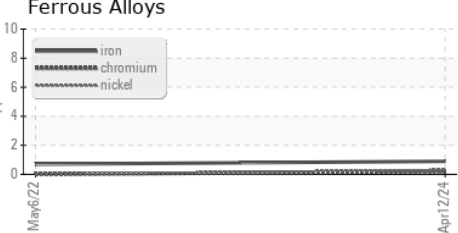

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCPA016628 **Received** : 23 Apr 2024  
**Lab Number** : 06158473 **Tested** : 25 Apr 2024  
**Unique Number** : 10993896 **Diagnosed** : 25 Apr 2024 - Angela Borella  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**CROWN CORK & SEAL**  
 5005 N SPRINGBORO PIKE  
 DAYTON, OH  
 US 45439

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Contact: RENE SANTIAGO  
 RENE.SANTIAGO@CROWNCORK.COM  
 T:  
 F: