




# OIL ANALYSIS REPORT

Sample Rating Trend

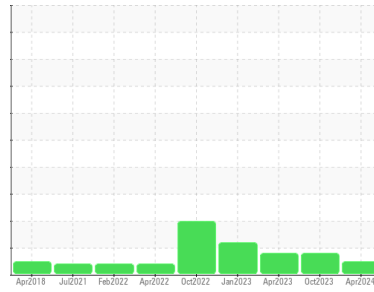

**NORMAL**



Machine Id  
**MAIN HYDRAULIC TANK**  
 Component  
**Hydraulic System**  
 Fluid  
**AW HYDRAULIC OIL ISO 32 (200 GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>WC0879238</b>	WC0830759	WC0750424
Sample Date	Client Info			<b>19 Apr 2024</b>	16 Oct 2023	20 Apr 2023
Machine Age	yrs	Client Info		<b>0</b>	0	0
Oil Age	yrs	Client Info		<b>0</b>	0	0
Oil Changed	Client Info			<b>N/A</b>	N/A	N/A
Sample Status				<b>NORMAL</b>	ATTENTION	ABNORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>20	<b>0</b>	3	<1
Chromium	ppm	ASTM D5185m	>20	<b>0</b>	<1	0
Nickel	ppm	ASTM D5185m	>20	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m		<b>0</b>	0	0
Silver	ppm	ASTM D5185m		<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>20	<b>0</b>	<1	<1
Lead	ppm	ASTM D5185m	>20	<b>0</b>	0	0
Copper	ppm	ASTM D5185m	>20	<b>6</b>	7	6
Tin	ppm	ASTM D5185m	>20	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	5	<b>4</b>	9	5
Barium	ppm	ASTM D5185m	5	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	5	<b>5</b>	6	5
Manganese	ppm	ASTM D5185m		<b>0</b>	0	<1
Magnesium	ppm	ASTM D5185m	25	<b>16</b>	18	12
Calcium	ppm	ASTM D5185m	200	<b>154</b>	146	130
Phosphorus	ppm	ASTM D5185m	300	<b>295</b>	286	326
Zinc	ppm	ASTM D5185m	370	<b>367</b>	356	379
Sulfur	ppm	ASTM D5185m	2500	<b>1363</b>	1794	1059





CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	<b>10</b>	11	6
Sodium	ppm	ASTM D5185m		<b>2</b>	0	2
Potassium	ppm	ASTM D5185m	>20	<b>1</b>	4	2
Water	%	ASTM D6304	>0.05	<b>NEG</b>	NEG	NEG

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>5000	<b>2676</b>	● 9090	▲ 10135
Particles >6µm		ASTM D7647	>1300	<b>104</b>	754	1268
Particles >14µm		ASTM D7647	>160	<b>11</b>	25	50
Particles >21µm		ASTM D7647	>40	<b>4</b>	10	16
Particles >38µm		ASTM D7647	>10	<b>0</b>	1	1
Particles >71µm		ASTM D7647	>3	<b>0</b>	0	0
Oil Cleanliness		ISO 4406 (c)	>19/17/14	<b>19/14/11</b>	● 20/17/12	▲ 21/17/13

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.57	<b>0.34</b>	0.33	0.30




# OIL ANALYSIS REPORT

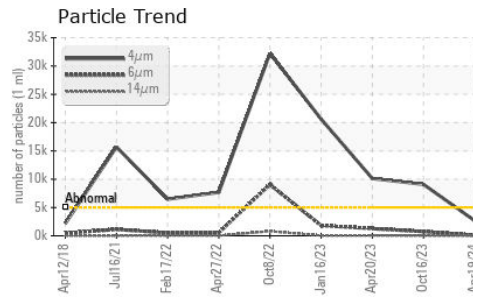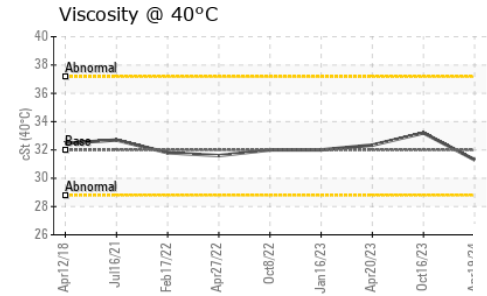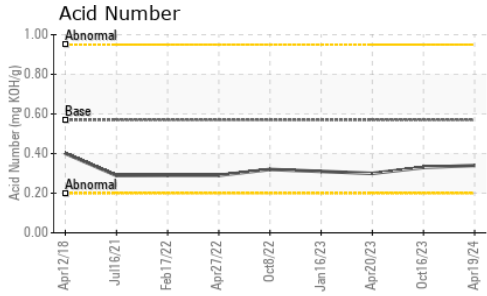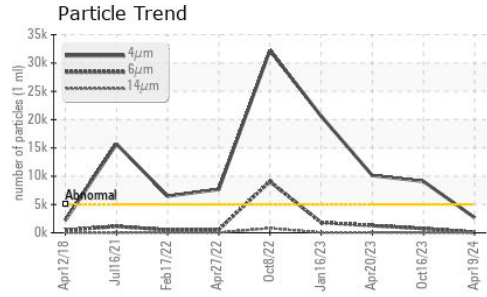






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	32	31.3	33.2

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

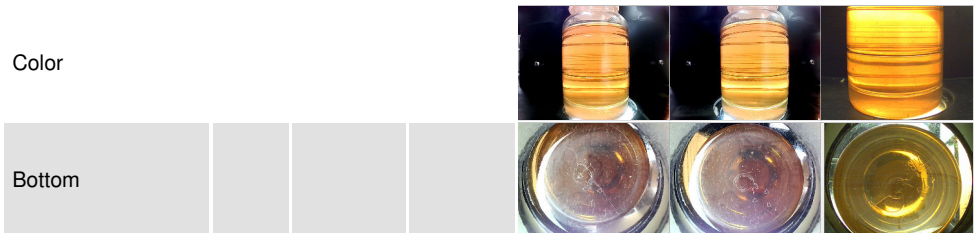

## GRAPHS

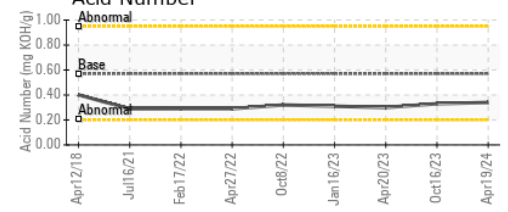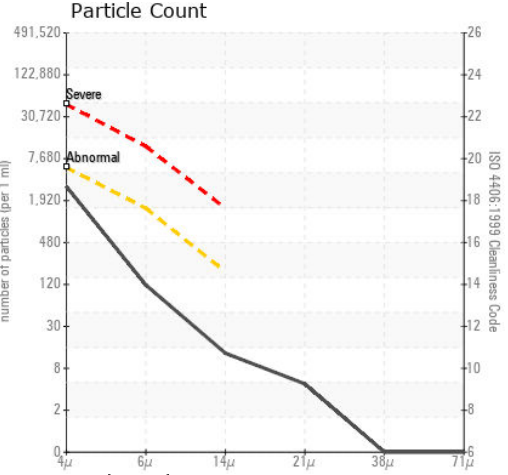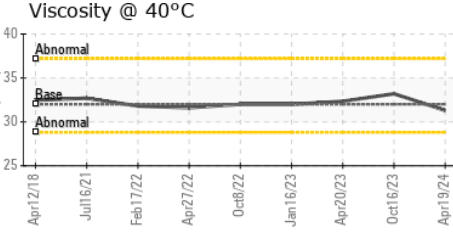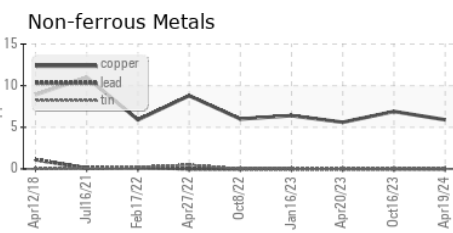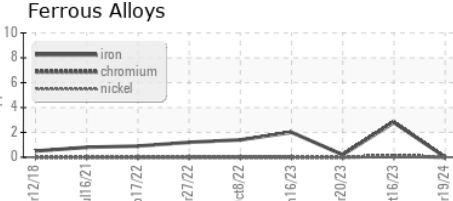

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0879238  
**Lab Number** : 06159034  
**Unique Number** : 10994457  
**Test Package** : PLANT

**ALL METALS PROCESSING & LOGISTICS**  
 100 ALL METALS DR  
 CARTERSVILLE, GA  
 US 30120

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)