




OIL ANALYSIS REPORT

Sample Rating Trend

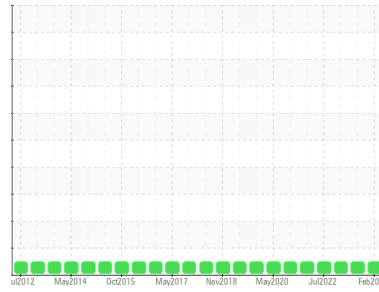

NORMAL



Machine Id

IZ/15WM

Component

Gearbox

Fluid

MOBIL MOBILGEAR SHC XMP 320 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the component. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0807520	WC0807378	WC0695194
Sample Date	Client Info		06 Feb 2024	29 Jun 2023	27 Feb 2023
Machine Age	mths	Client Info	0	0	203741
Oil Age	mths	Client Info	115	109	0
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			NORMAL	NORMAL	NORMAL

WEAR METALS

	method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m	>200	28	7	8
Chromium	ppm	ASTM D5185m	>15	0	<1	0
Nickel	ppm	ASTM D5185m	>15	0	1	0
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m		0	0	0
Aluminum	ppm	ASTM D5185m	>25	0	0	0
Lead	ppm	ASTM D5185m	>100	0	<1	0
Copper	ppm	ASTM D5185m	>200	0	<1	1
Tin	ppm	ASTM D5185m	>25	0	<1	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0

ADDITIVES

	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	0	0	0	0
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m	0	0	0	0
Manganese	ppm	ASTM D5185m		0	<1	<1
Magnesium	ppm	ASTM D5185m		0	1	<1
Calcium	ppm	ASTM D5185m	0	0	3	3
Phosphorus	ppm	ASTM D5185m	485	439	411	421
Zinc	ppm	ASTM D5185m	0	27	40	10
Sulfur	ppm	ASTM D5185m		5298	3782	4530

CONTAMINANTS

	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m	>50	2	8	12
Sodium	ppm	ASTM D5185m	>15	0	0	0
Potassium	ppm	ASTM D5185m	>20	0	2	<1
Water	%	ASTM D6304	>0.2	NEG	NEG	NEG

FLUID CLEANLINESS






	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>20000	2248	407	609
Particles >6µm	ASTM D7647	>5000	523	109	124
Particles >14µm	ASTM D7647	>640	39	7	8
Particles >21µm	ASTM D7647	>160	13	1	3
Particles >38µm	ASTM D7647	>40	1	0	1
Particles >71µm	ASTM D7647	>10	0	0	1
Oil Cleanliness	ISO 4406 (c)	>21/19/16	18/16/12	16/14/10	16/14/10

FLUID DEGRADATION

	method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045	0.85	1.36	0.95	0.88




OIL ANALYSIS REPORT

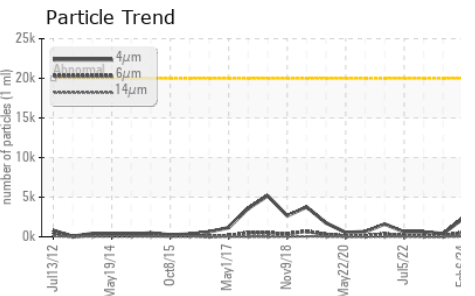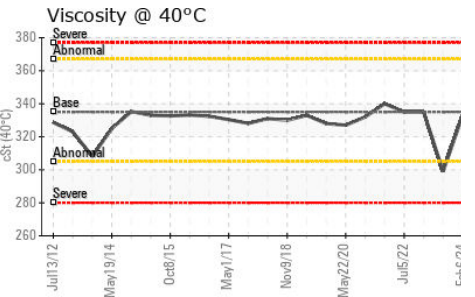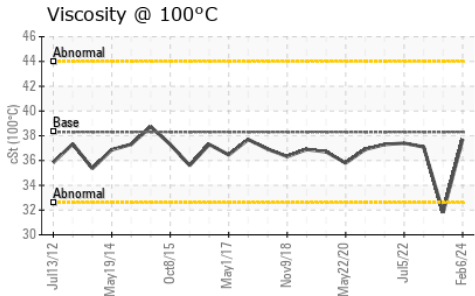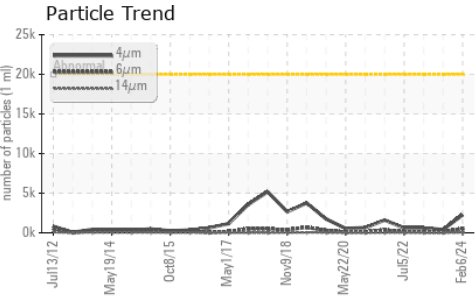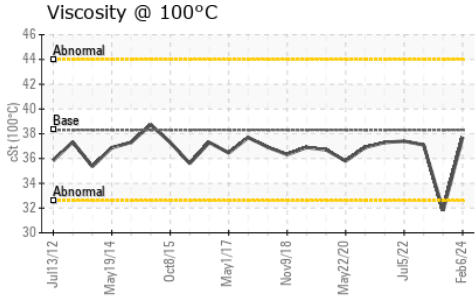






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	335	333	299	335
Visc @ 100°C	cSt	ASTM D445	38.3	37.7	31.8	37.1
Viscosity Index (VI)	Scale	ASTM D2270	164	162	146	158

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

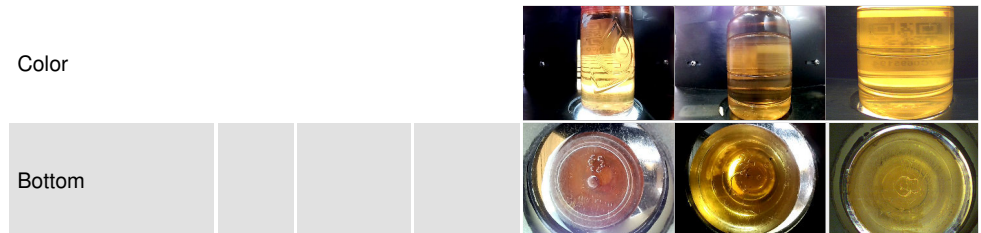

GRAPHS

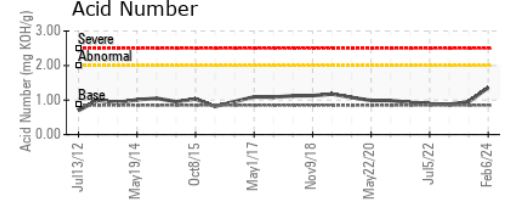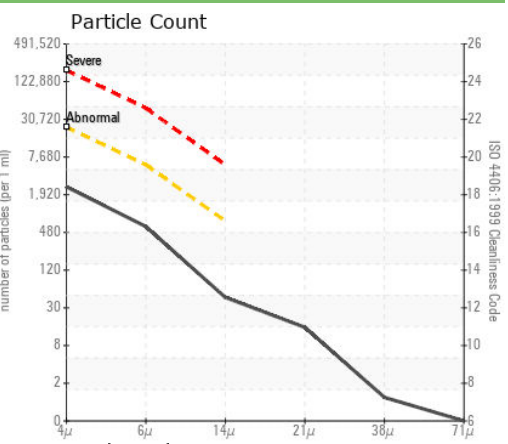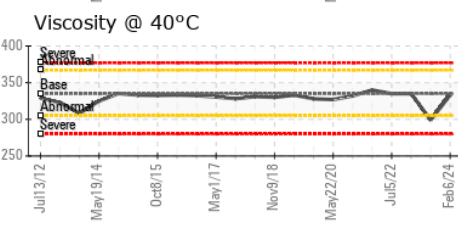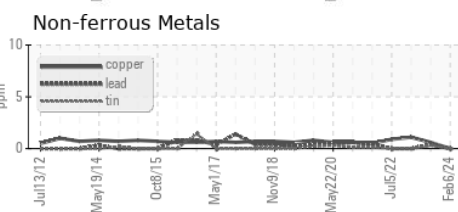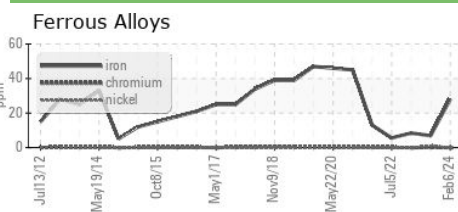

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0807520 **Received** : 24 Apr 2024
Lab Number : 06159087 **Tested** : 26 Apr 2024
Unique Number : 10994510 **Diagnosed** : 26 Apr 2024 - Jonathan Hester
Test Package : PLANT (Additional Tests: KV100, VI)

JPHYTEC

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

JP
Contact: Service

T:
F: