



# OIL ANALYSIS REPORT

Sample Rating Trend



ISO



Machine Id  
**NTC/4PH1/GB**  
 Component  
**Gearbox**  
 Fluid  
**SYNLUB EP SB 320 (--- GAL)**

## DIAGNOSIS

### ▲ Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### ▲ Contamination

There is a high amount of silt (particulates < 14 microns in size) present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>WC0807540</b>	---	---
Sample Date	Client Info			<b>18 Apr 2024</b>	---	---
Machine Age	mths	Client Info		<b>0</b>	---	---
Oil Age	mths	Client Info		<b>6</b>	---	---
Oil Changed	Client Info			<b>N/A</b>	---	---
Sample Status				<b>ABNORMAL</b>	---	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>200	<b>23</b>	---	---
Chromium	ppm	ASTM D5185m	>15	<b>0</b>	---	---
Nickel	ppm	ASTM D5185m	>15	<b>0</b>	---	---
Titanium	ppm	ASTM D5185m		<b>0</b>	---	---
Silver	ppm	ASTM D5185m		<b>0</b>	---	---
Aluminum	ppm	ASTM D5185m	>25	<b>0</b>	---	---
Lead	ppm	ASTM D5185m	>100	<b>0</b>	---	---
Copper	ppm	ASTM D5185m	>200	<b>0</b>	---	---
Tin	ppm	ASTM D5185m	>25	<b>0</b>	---	---
Vanadium	ppm	ASTM D5185m		<b>0</b>	---	---
Cadmium	ppm	ASTM D5185m		<b>0</b>	---	---





ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	---	---
Barium	ppm	ASTM D5185m		<b>0</b>	---	---
Molybdenum	ppm	ASTM D5185m		<b>0</b>	---	---
Manganese	ppm	ASTM D5185m		<b>0</b>	---	---
Magnesium	ppm	ASTM D5185m		<b>0</b>	---	---
Calcium	ppm	ASTM D5185m		<b>0</b>	---	---
Phosphorus	ppm	ASTM D5185m		<b>262</b>	---	---
Zinc	ppm	ASTM D5185m		<b>0</b>	---	---
Sulfur	ppm	ASTM D5185m		<b>6486</b>	---	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>50	<b>5</b>	---	---
Sodium	ppm	ASTM D5185m		<b>0</b>	---	---
Potassium	ppm	ASTM D5185m	>20	<b>&lt;1</b>	---	---
Water	%	ASTM D6304	>0.2	<b>NEG</b>	---	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		<b>129928</b>	---	---
Particles >6µm		ASTM D7647	>5000	<b>▲ 37173</b>	---	---
Particles >14µm		ASTM D7647	>640	<b>272</b>	---	---
Particles >21µm		ASTM D7647	>160	<b>43</b>	---	---
Particles >38µm		ASTM D7647	>40	<b>1</b>	---	---
Particles >71µm		ASTM D7647	>10	<b>0</b>	---	---
Oil Cleanliness		ISO 4406 (c)	>--/19/16	<b>▲ 24/22/15</b>	---	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		<b>0.43</b>	---	---

# OIL ANALYSIS REPORT

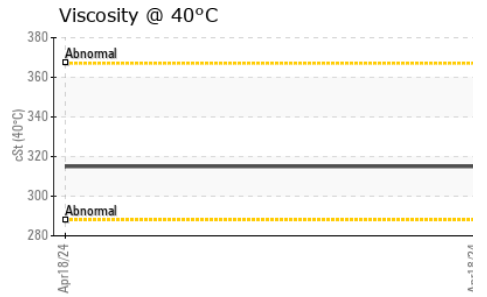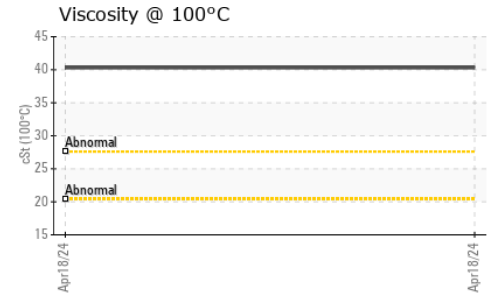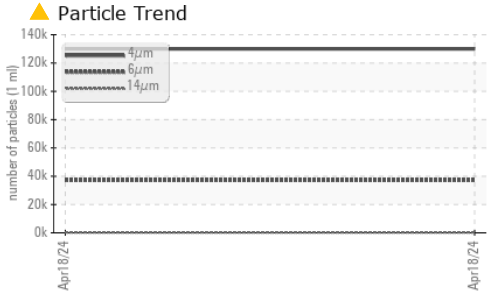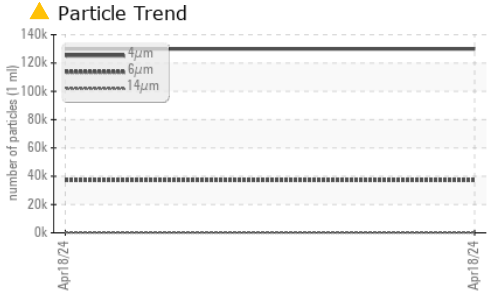




VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	NONE	---	---
Yellow Metal	scalar	*Visual	NONE	NONE	---	---
Precipitate	scalar	*Visual	NONE	NONE	---	---
Silt	scalar	*Visual	NONE	NONE	---	---
Debris	scalar	*Visual	NONE	LIGHT	---	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---	---
Appearance	scalar	*Visual	NORML	NORML	---	---
Odor	scalar	*Visual	NORML	NORML	---	---
Emulsified Water	scalar	*Visual	>0.2	NEG	---	---
Free Water	scalar	*Visual		NEG	---	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	315	---	---
Visc @ 100°C	cSt	ASTM D445	40.3	---	---
Viscosity Index (VI)	Scale	ASTM D2270	181	---	---

### SAMPLE IMAGES

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color				no image	no image
Bottom				no image	no image

### GRAPHS

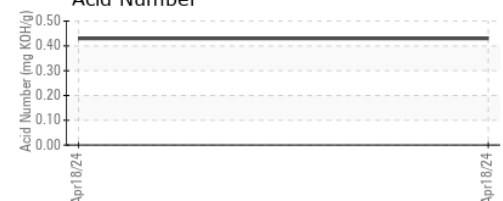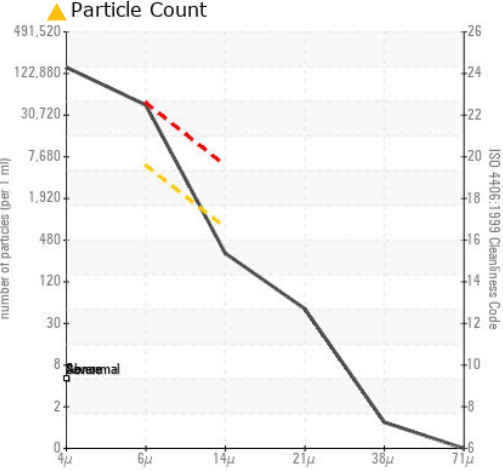

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0807540      **Received** : 24 Apr 2024  
**Lab Number** : 06159091      **Tested** : 26 Apr 2024  
**Unique Number** : 10994514      **Diagnosed** : 26 Apr 2024 - Jonathan Hester  
**Test Package** : PLANT ( Additional Tests: KV100, VI )

**J/POWER-BD**  
 JP  
 Contact: KENTO OKUHARA  
 Mitsuo\_Miyahara@jpower.co.jp

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)