




OIL ANALYSIS REPORT

Sample Rating Trend

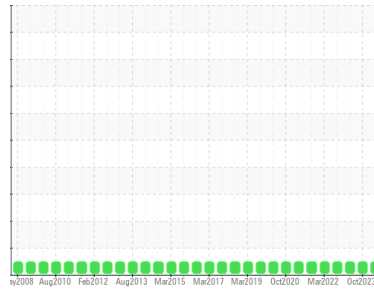

NORMAL



Machine Id
7WM/TH/JPBD

Component

Gearbox

Fluid

ROYAL PURPLE SYNFILM GT 320 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	WC0807527	WC0695187	WC0695026
Sample Date	Client Info	05 Mar 2024	16 Oct 2023	28 Mar 2023
Machine Age	hrs Client Info	0	0	30505
Oil Age	hrs Client Info	37602	34245	0
Oil Changed	Client Info	N/A	N/A	N/A
Sample Status		NORMAL	NORMAL	NORMAL

WEAR METALS

method	limit/base	current	history1	history2
Iron	ppm ASTM D5185m >200	7	3	9
Chromium	ppm ASTM D5185m >15	0	0	0
Nickel	ppm ASTM D5185m >15	0	1	0
Titanium	ppm ASTM D5185m	0	0	0
Silver	ppm ASTM D5185m	0	0	0
Aluminum	ppm ASTM D5185m >25	0	0	0
Lead	ppm ASTM D5185m >100	0	<1	0
Copper	ppm ASTM D5185m >200	0	<1	1
Tin	ppm ASTM D5185m >25	0	<1	0
Vanadium	ppm ASTM D5185m	0	0	0
Cadmium	ppm ASTM D5185m	0	0	0

ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm ASTM D5185m	0	0	0
Barium	ppm ASTM D5185m	0	0	0
Molybdenum	ppm ASTM D5185m	0	0	0
Manganese	ppm ASTM D5185m	0	<1	<1
Magnesium	ppm ASTM D5185m 90	23	21	35
Calcium	ppm ASTM D5185m	0	1	0
Phosphorus	ppm ASTM D5185m	0	<1	0
Zinc	ppm ASTM D5185m	6	0	5
Sulfur	ppm ASTM D5185m	21859	18103	23355

CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185m >50	0	<1	0
Sodium	ppm ASTM D5185m	2	<1	2
Potassium	ppm ASTM D5185m >20	0	1	<1
Water	% ASTM D6304 >0.2	NEG	NEG	NEG

FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647 >20000	12029	2258	1134
Particles >6µm	ASTM D7647 >5000	795	570	262
Particles >14µm	ASTM D7647 >640	42	32	22
Particles >21µm	ASTM D7647 >160	11	6	7
Particles >38µm	ASTM D7647 >40	0	1	1
Particles >71µm	ASTM D7647 >10	0	1	0
Oil Cleanliness	ISO 4406 (c) >21/19/16	21/17/13	18/16/12	17/15/12


FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g ASTM D8045 0.25	0.44	0.36	0.38




OIL ANALYSIS REPORT


Particle Trend

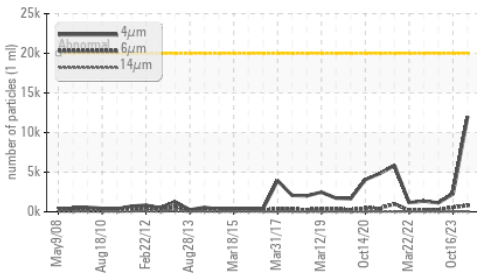


Acid Number

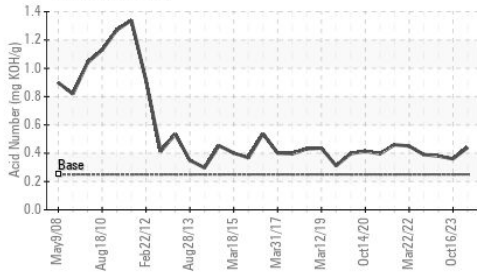

Viscosity @ 100°C

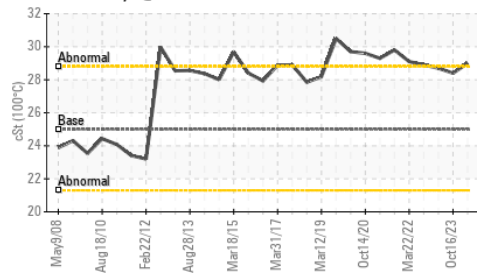


Particle Trend

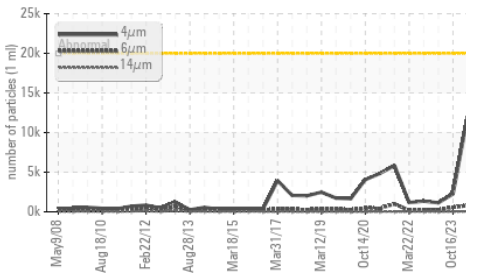






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	320	324	327
Visc @ 100°C	cSt	ASTM D445	25	29.0	28.4
Viscosity Index (VI)	Scale	ASTM D2270	100	121	117

SAMPLE IMAGES

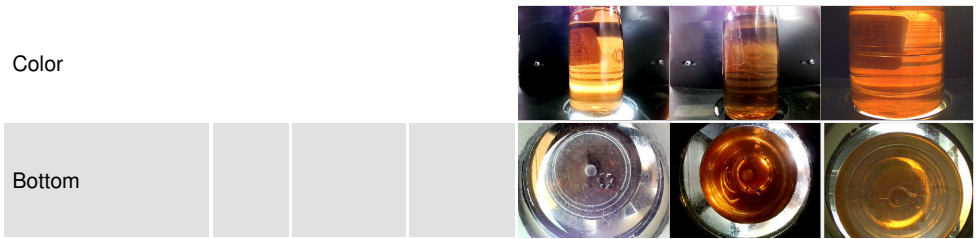

GRAPHS

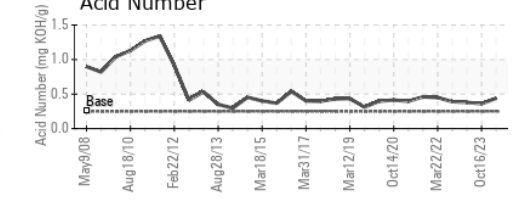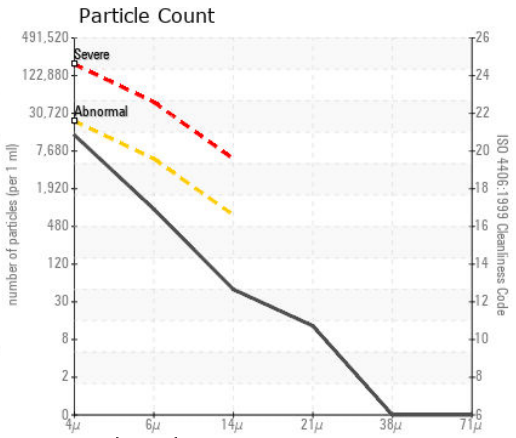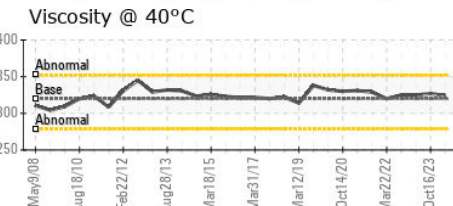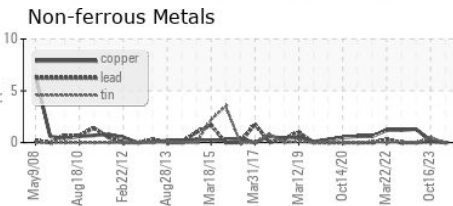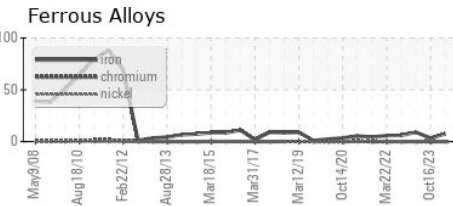

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0807527 **Received** : 24 Apr 2024
Lab Number : 06159094 **Tested** : 26 Apr 2024
Unique Number : 10994517 **Diagnosed** : 26 Apr 2024 - Jonathan Hester
Test Package : PLANT (Additional Tests: KV100, VI)

JPHYTEC

JP
 Contact: Service

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: