




# OIL ANALYSIS REPORT

## Sample Rating Trend

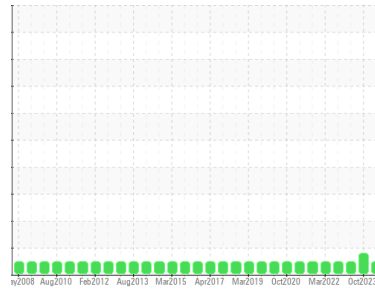

**NORMAL**



Machine Id  
**6WM/TH/JPBD**

Component  
**Gearbox**

Fluid  
**MOBIL MOBILGEAR SHC XMP 320 (--- GAL)**

### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

### SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0807526</b>	WC0695188	WC0695025
Sample Date	Client Info		<b>19 Mar 2024</b>	05 Oct 2023	28 Mar 2023
Machine Age	hrs	Client Info	<b>0</b>	0	37334
Oil Age	hrs	Client Info	<b>44800</b>	40845	0
Oil Changed		Client Info	<b>N/A</b>	N/A	N/A
Sample Status			<b>NORMAL</b>	ATTENTION	NORMAL

### WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >200	<b>12</b>	17	28
Chromium	ppm	ASTM D5185m >15	<b>0</b>	0	<1
Nickel	ppm	ASTM D5185m >15	<b>0</b>	<1	0
Titanium	ppm	ASTM D5185m	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >25	<b>0</b>	<1	0
Lead	ppm	ASTM D5185m >100	<b>0</b>	<1	0
Copper	ppm	ASTM D5185m >200	<b>12</b>	4	7
Tin	ppm	ASTM D5185m >25	<b>0</b>	<1	0
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

### ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	<b>0</b>	0	0
Barium	ppm	ASTM D5185m	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m 0	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>0</b>	0	<1
Magnesium	ppm	ASTM D5185m	<b>0</b>	1	<1
Calcium	ppm	ASTM D5185m 0	<b>0</b>	1	0
Phosphorus	ppm	ASTM D5185m 485	<b>326</b>	370	414
Zinc	ppm	ASTM D5185m 0	<b>36</b>	17	60
Sulfur	ppm	ASTM D5185m	<b>5305</b>	4458	5744

### CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >50	<b>6</b>	7	7
Sodium	ppm	ASTM D5185m >15	<b>0</b>	0	0
Potassium	ppm	ASTM D5185m >20	<b>0</b>	2	<1
Water	%	ASTM D6304 >0.2	<b>NEG</b>	NEG	NEG

### FLUID CLEANLINESS






	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		<b>18072</b>	26516	2108
Particles >6µm	ASTM D7647 >5000		<b>815</b>	6342	214
Particles >14µm	ASTM D7647 >640		<b>10</b>	13	8
Particles >21µm	ASTM D7647 >160		<b>3</b>	3	2
Particles >38µm	ASTM D7647 >40		<b>0</b>	0	0
Particles >71µm	ASTM D7647 >10		<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c) >--/19/16		<b>21/17/10</b>	22/20/11	18/15/10

### FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.85	<b>1.11</b>	1.08	1.03




# OIL ANALYSIS REPORT

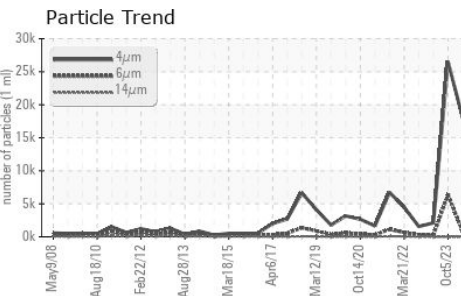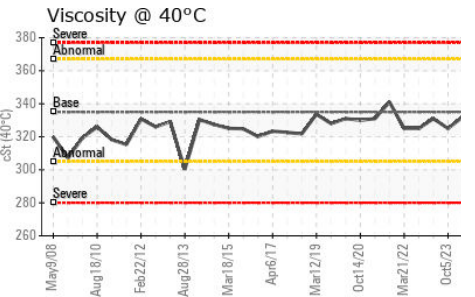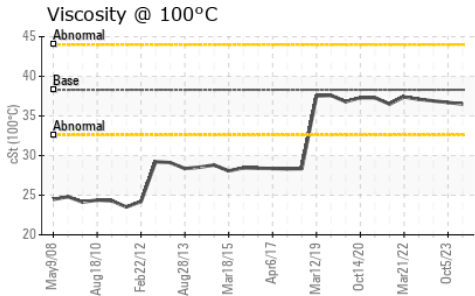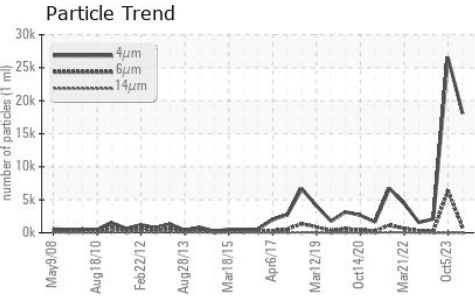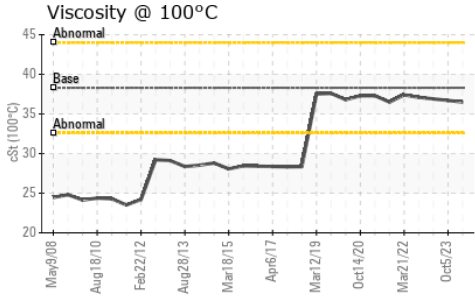






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	335	332	325
Visc @ 100°C	cSt	ASTM D445	38.3	36.5	36.7
Viscosity Index (VI)	Scale	ASTM D2270	164	157	160

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

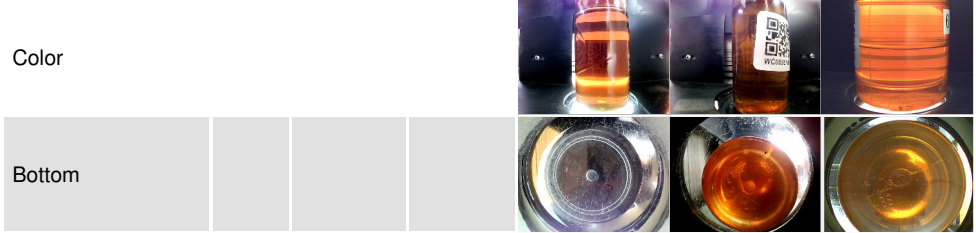

## GRAPHS

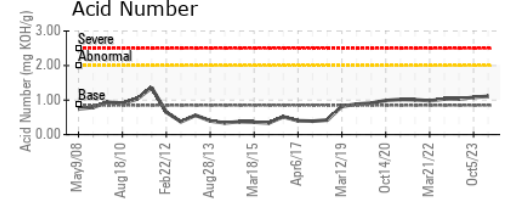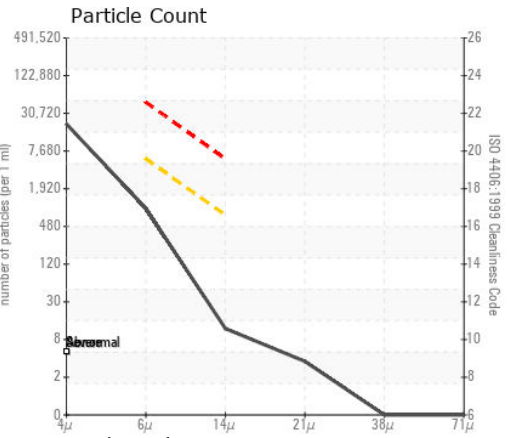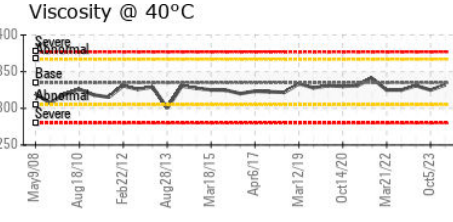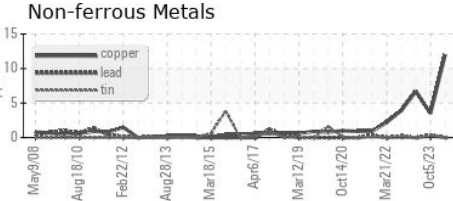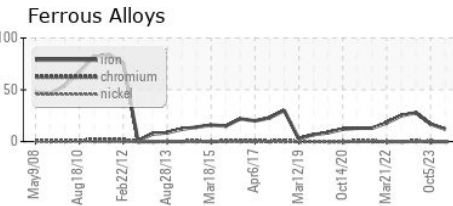

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0807526 **Received** : 24 Apr 2024  
**Lab Number** : 06159096 **Tested** : 26 Apr 2024  
**Unique Number** : 10994519 **Diagnosed** : 26 Apr 2024 - Jonathan Hester  
**Test Package** : PLANT ( Additional Tests: KV100, VI )

JPHYTEC

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

JP  
 Contact: Service

T:  
F: