




# OIL ANALYSIS REPORT

Sample Rating Trend

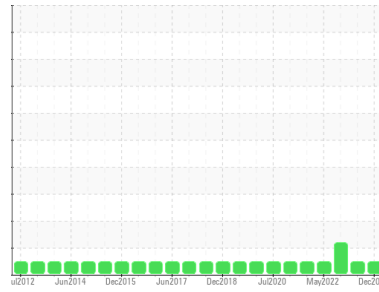

**NORMAL**



Machine Id  
**IZ/7WM**  
 Component  
**Gearbox**

Fluid  
**MOBIL MOBILGEAR SHC XMP 320 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the component. The amount and size of particulates present in the system are acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>WC0807462</b>	WC0807370	WC0695217
Sample Date	Client Info	<b>05 Dec 2023</b>	01 Jun 2023	30 Jan 2023
Machine Age	hrs	<b>0</b>	0	0
Oil Age	hrs	<b>0</b>	25296	21140
Oil Changed	Client Info	<b>N/A</b>	N/A	N/A
Sample Status		<b>NORMAL</b>	NORMAL	ATTENTION

## WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >200	<b>26</b>	19	21
Chromium	ppm	ASTM D5185m >15	<b>0</b>	0	<1
Nickel	ppm	ASTM D5185m >15	<b>0</b>	1	0
Titanium	ppm	ASTM D5185m	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >25	<b>0</b>	0	0
Lead	ppm	ASTM D5185m >100	<b>0</b>	<1	<1
Copper	ppm	ASTM D5185m >200	<b>&lt;1</b>	1	5
Tin	ppm	ASTM D5185m >25	<b>0</b>	<1	0
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m 0	<b>0</b>	0	0
Barium	ppm	ASTM D5185m	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m 0	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>0</b>	<1	<1
Magnesium	ppm	ASTM D5185m	<b>0</b>	2	<1
Calcium	ppm	ASTM D5185m 0	<b>0</b>	1	3
Phosphorus	ppm	ASTM D5185m 485	<b>433</b>	443	393
Zinc	ppm	ASTM D5185m 0	<b>25</b>	7	32
Sulfur	ppm	ASTM D5185m	<b>5562</b>	4552	4481

## CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >50	<b>2</b>	4	5
Sodium	ppm	ASTM D5185m >15	<b>0</b>	<1	2
Potassium	ppm	ASTM D5185m >20	<b>0</b>	2	<1
Water	%	ASTM D6304 >0.2	<b>NEG</b>	NEG	NEG

## FLUID CLEANLINESS






method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647 >20000	<b>7169</b>	3190	23606
Particles >6µm	ASTM D7647 >5000	<b>1988</b>	1254	7197
Particles >14µm	ASTM D7647 >640	<b>170</b>	186	364
Particles >21µm	ASTM D7647 >160	<b>52</b>	62	57
Particles >38µm	ASTM D7647 >40	<b>4</b>	2	3
Particles >71µm	ASTM D7647 >10	<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c) >21/19/16	<b>20/18/15</b>	19/17/15	22/20/16

## FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045 0.85	<b>1.23</b>	1.10	1.05



# OIL ANALYSIS REPORT

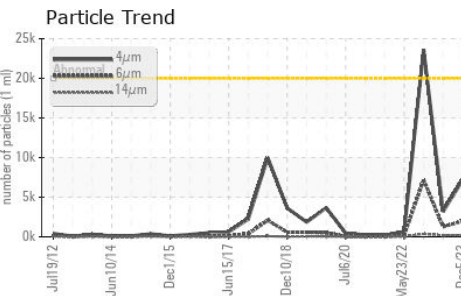
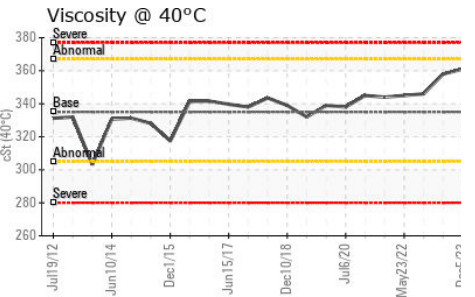
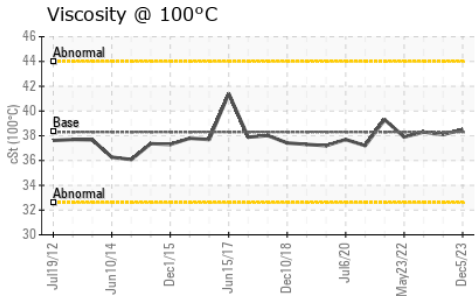
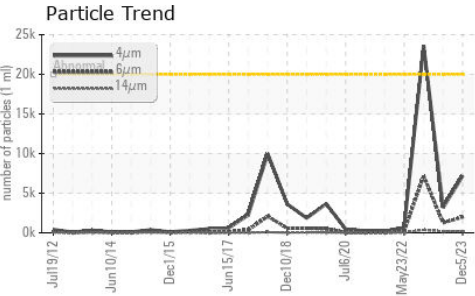
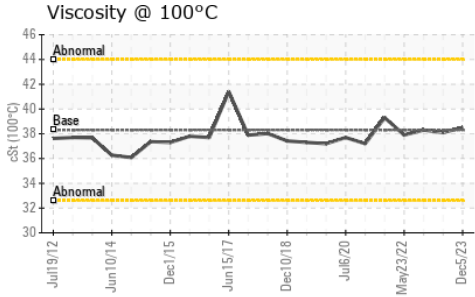


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	335	361	358
Visc @ 100°C	cSt	ASTM D445	38.3	38.5	38.1
Viscosity Index (VI)	Scale	ASTM D2270	164	155	160

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

## GRAPHS

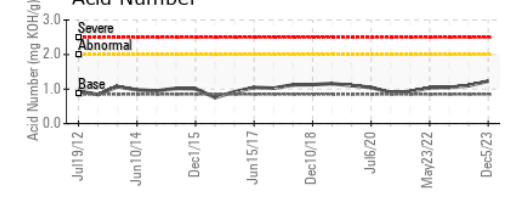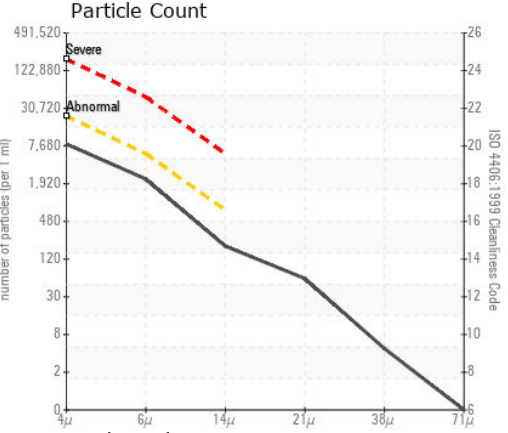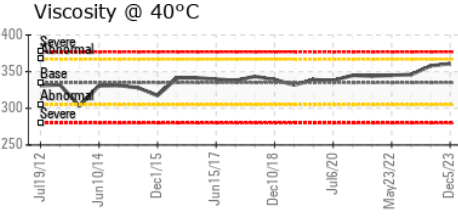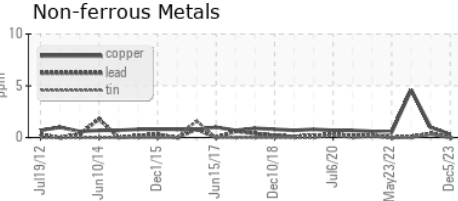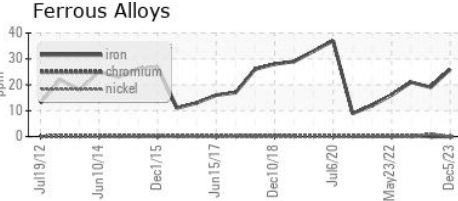

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0807462 **Received** : 24 Apr 2024  
**Lab Number** : 06159103 **Tested** : 26 Apr 2024  
**Unique Number** : 10994526 **Diagnosed** : 26 Apr 2024 - Jonathan Hester  
**Test Package** : PLANT ( Additional Tests: KV100, VI )

JPHYTEC

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

JP  
Contact: Service

T:  
F: