




# OIL ANALYSIS REPORT

Sample Rating Trend

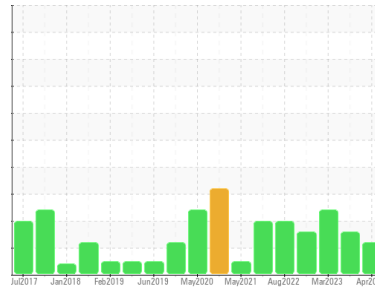

ISO



Machine Id  
**FAB-CV 4-PUMP 2**  
 Component  
**Pump**  
 Fluid  
**USPI VAC 100 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is a high amount of silt (particulates < 14 microns in size) present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>USPM36800</b>	USPM31692	USPM5805605
Sample Date	Client Info	<b>23 Apr 2024</b>	28 Dec 2023	28 Mar 2023
Machine Age	hrs	Client Info	0	0
Oil Age	hrs	Client Info	0	0
Oil Changed	Client Info	<b>N/A</b>	N/A	N/A
Sample Status		<b>ABNORMAL</b>	ATTENTION	ABNORMAL

## WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >90	<b>2</b>	2	▲ 50
Chromium	ppm	ASTM D5185m >5	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m >5	<b>0</b>	0	<1
Titanium	ppm	ASTM D5185m >3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m >3	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >7	<b>0</b>	0	2
Lead	ppm	ASTM D5185m >12	<b>0</b>	0	0
Copper	ppm	ASTM D5185m >30	<b>0</b>	0	<1
Tin	ppm	ASTM D5185m >9	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m 0	<b>0</b>	0	0
Barium	ppm	ASTM D5185m 0	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m 0	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>0</b>	<1	<1
Magnesium	ppm	ASTM D5185m 0	<b>&lt;1</b>	0	<1
Calcium	ppm	ASTM D5185m 0	<b>&lt;1</b>	0	<1
Phosphorus	ppm	ASTM D5185m 1800	<b>814</b>	674	742
Zinc	ppm	ASTM D5185m 0	<b>0</b>	0	2
Sulfur	ppm	ASTM D5185m 0	<b>0</b>	0	0

## CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >60	<b>6</b>	5	12
Sodium	ppm	ASTM D5185m	<b>0</b>	3	2
Potassium	ppm	ASTM D5185m >20	<b>0</b>	2	1
Water	%	ASTM D6304 >.1	<b>0.037</b>	0.022	0.038
ppm Water	ppm	ASTM D6304 >1000	<b>378</b>	229	381.1

## FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647 >5000	▲ <b>10213</b>	4813	▲ 56202
Particles >6µm	ASTM D7647 >1300	● <b>1330</b>	● 2002	▲ 8718
Particles >14µm	ASTM D7647 >160	<b>63</b>	● 244	▲ 246
Particles >21µm	ASTM D7647 >40	<b>20</b>	● 65	33
Particles >38µm	ASTM D7647 >10	<b>3</b>	2	1
Particles >71µm	ASTM D7647 >3	<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c) >19/17/14	▲ <b>21/18/13</b>	● 19/18/15	▲ 23/20/15


## FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045 0.05	<b>0.12</b>	0.055	0.35




# OIL ANALYSIS REPORT


## Particle Trend

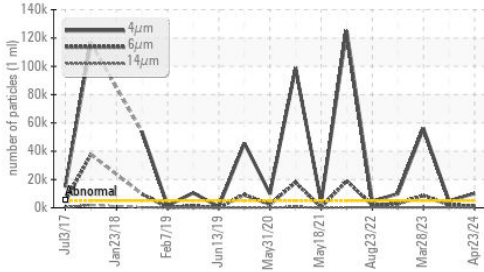


## Water (KF)

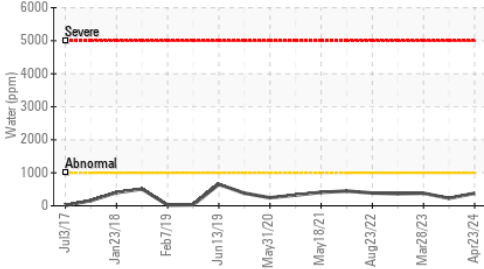


## Acid Number

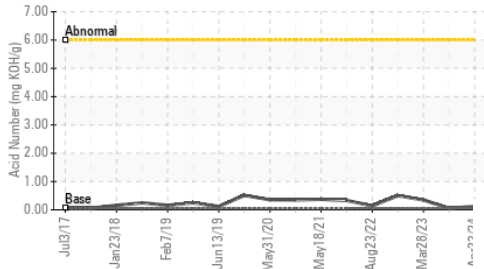

## Water (KF)

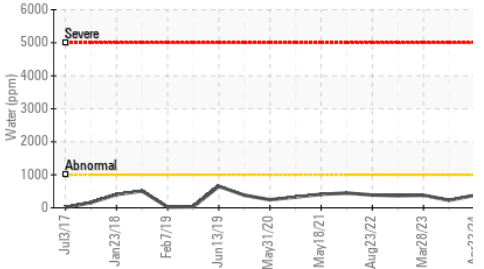


## Viscosity @ 40°C

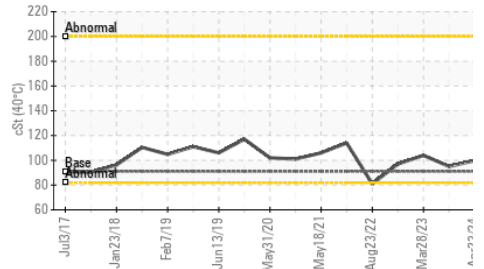

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 91	99.8	95.0	104

## SAMPLE IMAGES

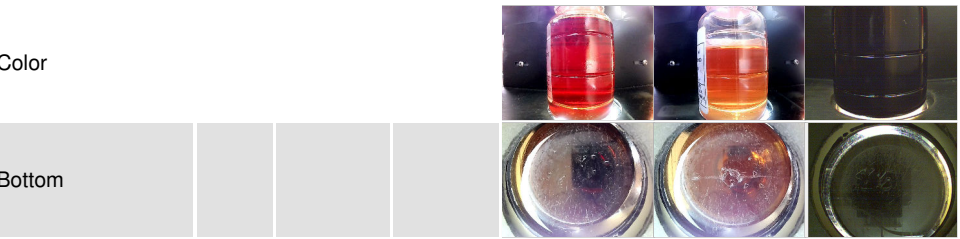


## GRAPHS


### Ferrous Alloys

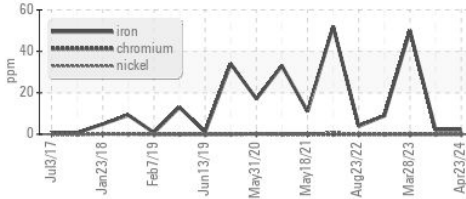


### Non-ferrous Metals

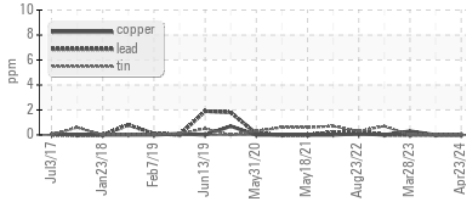


### Viscosity @ 40°C

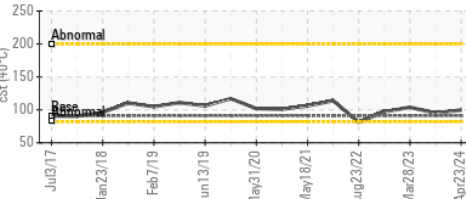

### Particle Count

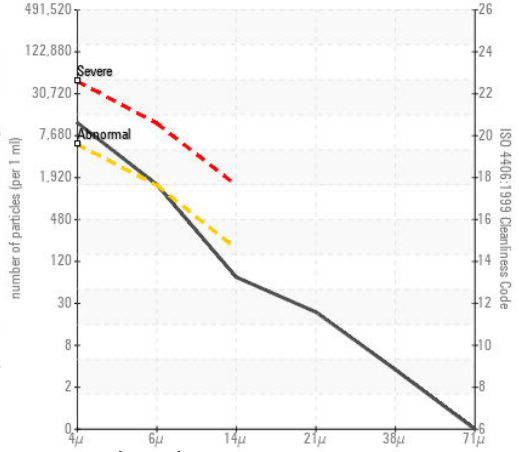

### Acid Number

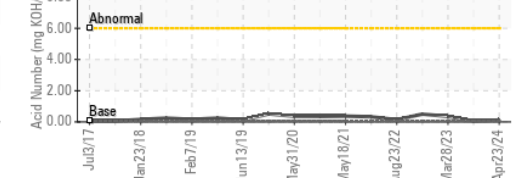

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : USPM36800  
**Lab Number** : 06159143  
**Unique Number** : 10994566  
**Test Package** : IND 2  
**Received** : 24 Apr 2024  
**Tested** : 25 Apr 2024  
**Diagnosed** : 26 Apr 2024 - Jonathan Hester

**JBS - TOLLESON**  
 TOLLESON, AZ  
 US 85353  
 Contact:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)