


OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL



RECYCLED NH3 (S/N SCC19180005)

Refrigeration Compressor

Fluid
USPI ALT-68 SC (--- GAL)

DIAGNOSIS

Recommendation

This is a baseline read-out on the submitted sample.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


		ry2021 Mar20	22 Jul2022 Sep2022	Mar2023 Aug2023 Oct2023 F	eb2024	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		USP0006474	USP0006779	USP0005832
Sample Date		Client Info		19 Apr 2024	09 Apr 2024	07 Mar 2024
Machine Age	days	Client Info		0	0	0
Oil Age	days	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				NORMAL	NORMAL	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>8	0	0	0
Chromium	ppm	ASTM D5185m	>2	<1	0	<1
Nickel	ppm	ASTM D5185m		<1	<1	0
Titanium	ppm	ASTM D5185m		<1	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>3	0	<1	0
Lead	ppm	ASTM D5185m	>2	<1	0	0
Copper	ppm	ASTM D5185m	>8	<1	2	0
Tin	ppm	ASTM D5185m	>4	<1	<1	0
Vanadium	ppm	ASTM D5185m		<1	0	0
Cadmium	ppm	ASTM D5185m		<1	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		<1	0	0
Manganese	ppm	ASTM D5185m		0	1	0
Magnesium	ppm	ASTM D5185m		<1	<1	0
Calcium	ppm	ASTM D5185m		0	<1	0
Phosphorus	ppm	ASTM D5185m		0	0	0
Zinc	ppm	ASTM D5185m		0	0	0
Sulfur	ppm	ASTM D5185m	50	0	10	0
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	3	2	3
Sodium	ppm	ASTM D5185m		1	2	0
Potassium	ppm	ASTM D5185m	>20	<1	2	<1
Water	%	ASTM D6304	>0.01	0.006	0.002	0.005
ppm Water	ppm	ASTM D6304	>100	65	25	53
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		5900	4610	7911
Particles >6µm		ASTM D7647	>2500	690	602	1180
Particles >14µm		ASTM D7647	>320	7	9	14
Particles >21µm		ASTM D7647	>80	1	2	2
Particles >38µm		ASTM D7647	>20	0	0	0
Particles >71μm		ASTM D7647	>4	0	0	0
Oil Cleanliness		ISO 4406 (c)	>/18/15	20/17/10	19/16/10	20/17/11
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974	0.005	0.014	0.014	0.013





OIL ANALYSIS REPORT




Par ^{25k} T	ticle T						P oposition
≘ 20k -	пававава Б <i>ј.1</i>	m m zm					A
15k -	A	Λ	٨				
10k Jumper of particles	M		1	۸۸	A	N	W
Ok Then	22	2	S S	<u> </u>	<u>~^</u> ^	23	24
May23/	Mar6/22	Jul27/	Sep19/	Mar9/	Aug2/23	0ct10/	Feb23/7







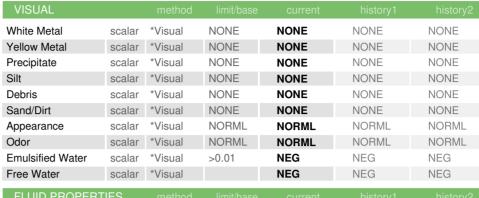

I LOID I HOI LITI	ILO	memou			HISTOLAL	HISTOLYZ
Visc @ 40°C	cSt	ASTM D445	65.6	63.6	62.4	61.3


SAM	IPLE	IMA	GES.

Bottom

Color





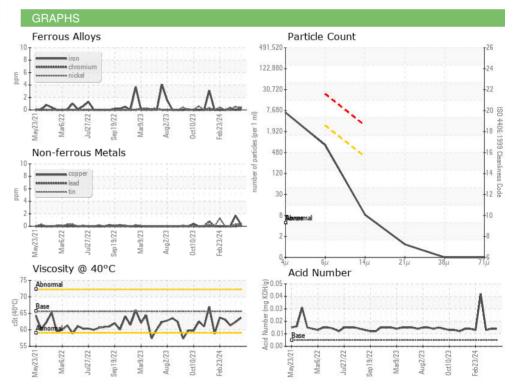





Certificate 12367

Laboratory Sample No.

Test Package : IND 2

: USP0006474 Lab Number : 06159201 Unique Number : 10994624

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 24 Apr 2024

Tested : 25 Apr 2024

Diagnosed : 26 Apr 2024 - Jonathan Hester **TYSON FP-PINE BLUFF-USP**

PINE BLUFF, AR US 71602

Contact: RICHARD RICKELS

To discuss this sample report, contact Customer Service at 1-800-237-1369.

 st - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:

F: