

Machine Id
C-3 CANNING
 Component
Refrigeration Compressor
 Fluid
TULCO LUBSOIL SYN REFRIGERATION 68 (--- QTS)

DIAGNOSIS

- Recommendation**
 No corrective action is recommended at this time. Resample at the next service interval to monitor.
- Wear**
 All component wear rates are normal.
- Contamination**
 There is a moderate amount of silt (particulates < 6 microns in size) present in the oil.
- Fluid Condition**
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		TO10003300	TO10002636	TO10001892
Sample Date	Client Info		17 Apr 2024	26 Dec 2023	02 Aug 2023
Machine Age	days	Client Info	0	0	0
Oil Age	days	Client Info	0	0	0
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			ATTENTION	ABNORMAL	ABNORMAL

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >8	0	0	18
Chromium	ppm	ASTM D5185m >2	<1	0	0
Nickel	ppm	ASTM D5185m	<1	<1	<1
Titanium	ppm	ASTM D5185m	<1	0	0
Silver	ppm	ASTM D5185m >2	0	0	0
Aluminum	ppm	ASTM D5185m >3	2	0	1
Lead	ppm	ASTM D5185m >2	<1	0	0
Copper	ppm	ASTM D5185m >8	<1	0	<1
Tin	ppm	ASTM D5185m >4	<1	<1	<1
Vanadium	ppm	ASTM D5185m	<1	0	0
Cadmium	ppm	ASTM D5185m	<1	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0
Barium	ppm	ASTM D5185m	0	0	0
Molybdenum	ppm	ASTM D5185m	<1	0	0
Manganese	ppm	ASTM D5185m	0	0	<1
Magnesium	ppm	ASTM D5185m	<1	<1	<1
Calcium	ppm	ASTM D5185m	3	0	8
Phosphorus	ppm	ASTM D5185m 10	0	1	6
Zinc	ppm	ASTM D5185m	0	0	0
Sulfur	ppm	ASTM D5185m 725	516	356	572

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	0	0	<1
Sodium	ppm	ASTM D5185m	<1	<1	<1
Potassium	ppm	ASTM D5185m >20	<1	1	1
Water	%	ASTM D6304 >0.01	0.003	0.002	0.011
ppm Water	ppm	ASTM D6304 >100	28	24	117.0






FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	10302	52811	172418
Particles >6µm	ASTM D7647	>2500	2245	12819	46614
Particles >14µm	ASTM D7647	>320	74	298	126
Particles >21µm	ASTM D7647	>80	13	45	3
Particles >38µm	ASTM D7647	>20	0	0	0
Particles >71µm	ASTM D7647	>4	0	0	0
Oil Cleanliness	ISO 4406 (c)	>20/18/15	21/18/13	23/21/15	25/23/14

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974 0.06	0.014	0.014	0.06

OIL ANALYSIS REPORT

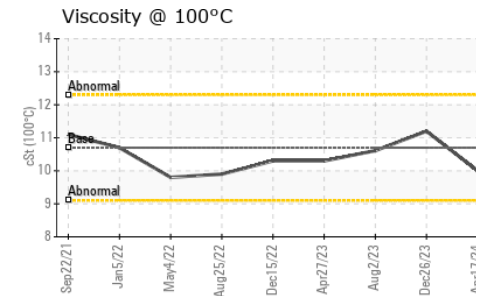
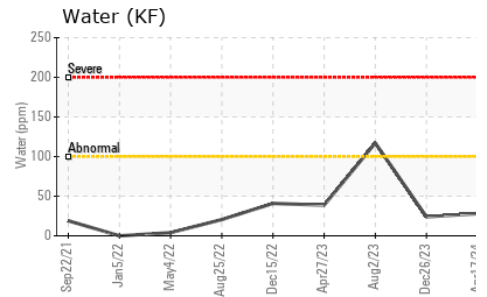
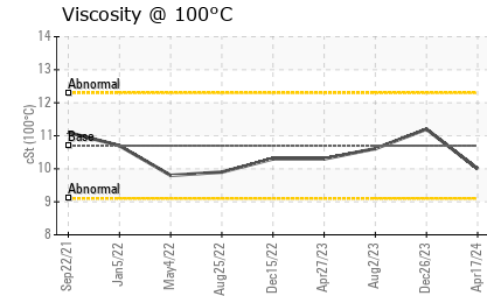
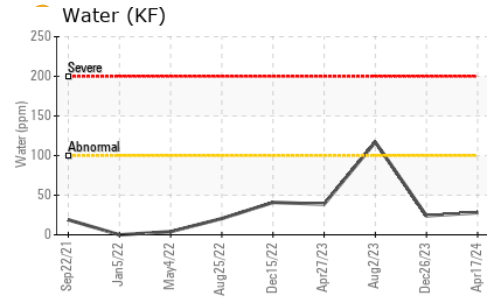
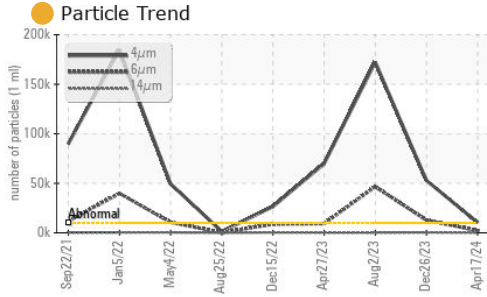


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.01	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	67.5	65.1	75.4
Visc @ 100°C	cSt	ASTM D445	10.7	10.0	11.2
Viscosity Index (VI)	Scale	ASTM D2270	147	138	139

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

GRAPHS

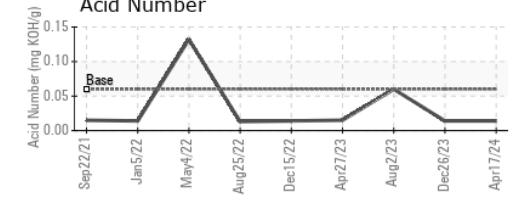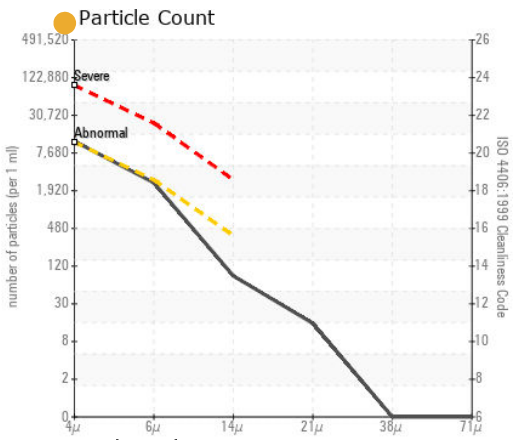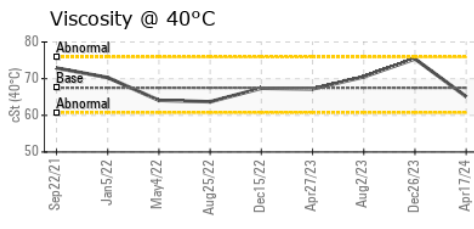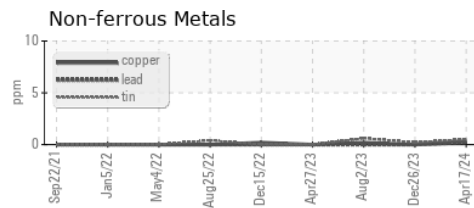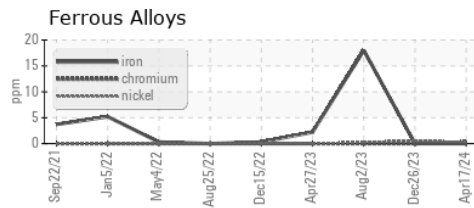

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : TO10003300 **Received** : 24 Apr 2024
Lab Number : 06159206 **Tested** : 25 Apr 2024
Unique Number : 10994629 **Diagnosed** : 26 Apr 2024 - Jonathan Hester
Test Package : IND 2 (Additional Tests: KV100, PrtCount, VI)

PEPSI BOTTLING GROUP
 510 W SKELLY DR
 TULSA, OK
 US 74107
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)