


# OIL ANALYSIS REPORT

Sample Rating Trend



**NORMAL**

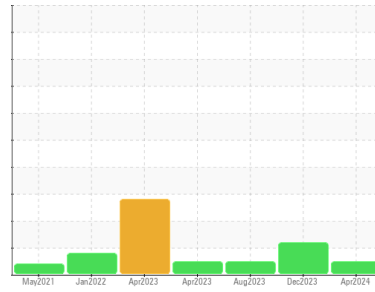

Machine Id  
**C-8 BOTTLING**  
Component  
**Refrigeration Compressor**  
Fluid  
**TULCO LUBSOIL SYN REFRIGERATION 68 (18 GAL)**

**DIAGNOSIS**

**Recommendation**

Resample at the next service interval to monitor.

**Wear**

All component wear rates are normal.

**Contamination**

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

**Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>TO10003302</b>	TO10002634	TO10001888
Sample Date	Client Info			<b>17 Apr 2024</b>	26 Dec 2023	08 Aug 2023
Machine Age	hrs	Client Info		<b>0</b>	0	0
Oil Age	hrs	Client Info		<b>0</b>	0	0
Oil Changed	Client Info			<b>N/A</b>	N/A	N/A
Sample Status				<b>NORMAL</b>	ABNORMAL	NORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>8	<b>0</b>	0	0
Chromium	ppm	ASTM D5185m	>2	<b>&lt;1</b>	0	0
Nickel	ppm	ASTM D5185m		<b>&lt;1</b>	<1	<1
Titanium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Silver	ppm	ASTM D5185m	>2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>3	<b>2</b>	0	1
Lead	ppm	ASTM D5185m	>2	<b>&lt;1</b>	0	<1
Copper	ppm	ASTM D5185m	>8	<b>&lt;1</b>	0	0
Tin	ppm	ASTM D5185m	>4	<b>&lt;1</b>	<1	<1
Vanadium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	0	0
Barium	ppm	ASTM D5185m		<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Manganese	ppm	ASTM D5185m		<b>0</b>	0	<1
Magnesium	ppm	ASTM D5185m		<b>0</b>	1	<1
Calcium	ppm	ASTM D5185m		<b>3</b>	0	0
Phosphorus	ppm	ASTM D5185m	10	<b>0</b>	1	3
Zinc	ppm	ASTM D5185m		<b>0</b>	0	0
Sulfur	ppm	ASTM D5185m	725	<b>350</b>	435	541

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	<b>0</b>	0	<1
Sodium	ppm	ASTM D5185m		<b>&lt;1</b>	1	<1
Potassium	ppm	ASTM D5185m	>20	<b>&lt;1</b>	<1	1
Water	%	ASTM D6304	>0.01	<b>0.004</b>	0.002	0.010
ppm Water	ppm	ASTM D6304	>100	<b>44</b>	21	105.5

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	<b>7663</b>	▲ 29699	5144
Particles >6µm		ASTM D7647	>2500	<b>2033</b>	▲ 8428	815
Particles >14µm		ASTM D7647	>320	<b>72</b>	316	12
Particles >21µm		ASTM D7647	>80	<b>9</b>	44	1
Particles >38µm		ASTM D7647	>20	<b>1</b>	1	0
Particles >71µm		ASTM D7647	>4	<b>0</b>	0	0
Oil Cleanliness		ISO 4406 (c)	>20/18/15	<b>20/18/13</b>	▲ 22/20/15	20/17/11

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974	0.06	<b>0.014</b>	0.014	0.014

# OIL ANALYSIS REPORT

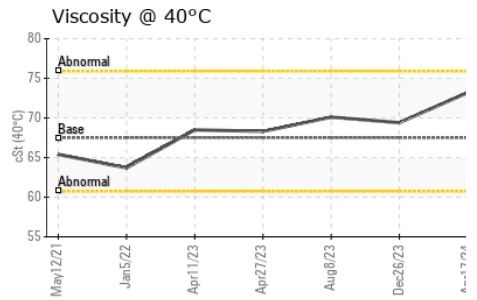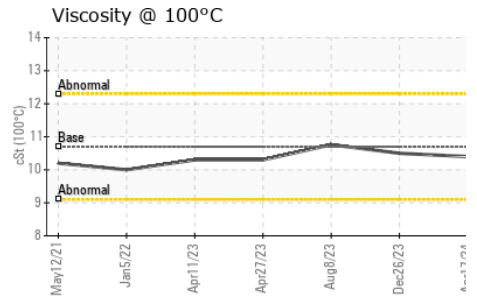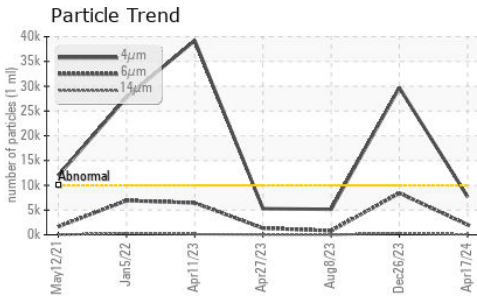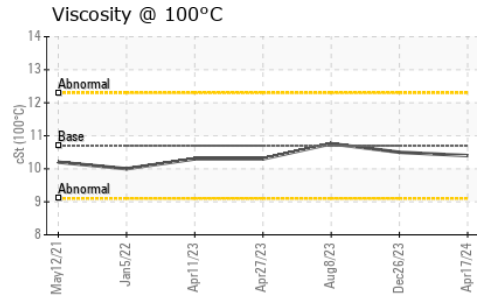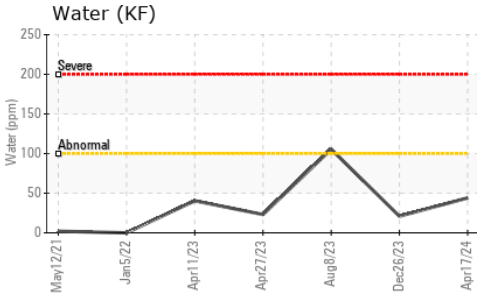


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.01	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	67.5	73.2	69.4
Visc @ 100°C	cSt	ASTM D445	10.7	10.4	10.76
Viscosity Index (VI)	Scale	ASTM D2270	147	127	138





SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color

Bottom

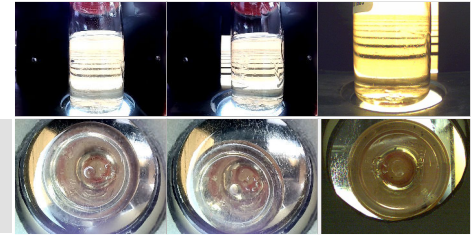

## GRAPHS

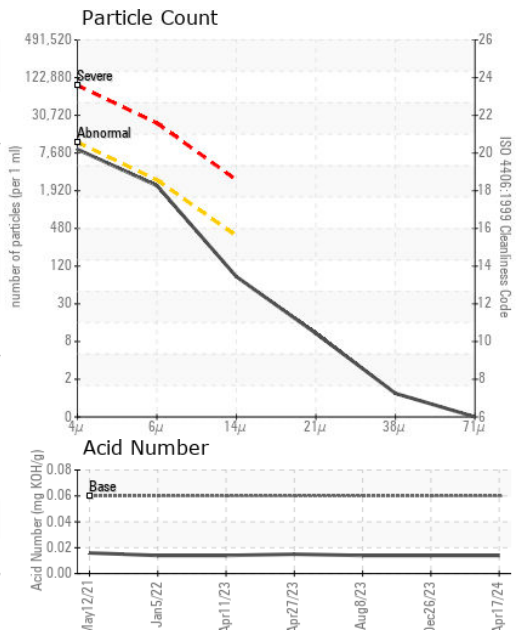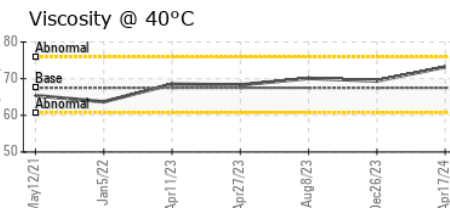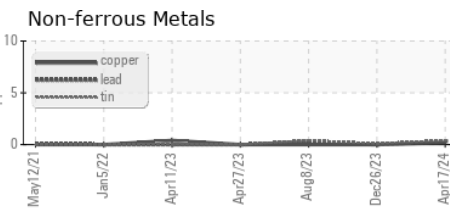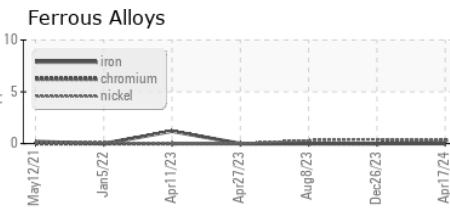

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : TO10003302 **Received** : 24 Apr 2024  
**Lab Number** : 06159211 **Tested** : 25 Apr 2024  
**Unique Number** : 10994634 **Diagnosed** : 26 Apr 2024 - Jonathan Hester  
**Test Package** : IND 2 ( Additional Tests: KV100, PrtCount, VI )

**PEPSI BOTTLING GROUP**  
 510 W SKELLY DR  
 TULSA, OK  
 US 74107  
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: