

OIL ANALYSIS REPORT

Sample Rating Trend



Machine Id

COMP 1 (S/N 83725)

Refrigeration Compressor

{not provided} (7 GAL)

DIAGNOSIS

A Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

🔺 Wear

The iron level is abnormal. All other component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.


Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		WC0898014	WCI2287576	
Sample Date		Client Info		18 Apr 2024	30 Sep 2016	
Machine Age	mths	Client Info		0	0	
Oil Age	mths	Client Info		0	12	
Oil Changed		Client Info		N/A	Not Changd	
Sample Status				ABNORMAL	NORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>8	1 3	2	
Chromium	ppm	ASTM D5185m	>2	<1	0	
Nickel	ppm	ASTM D5185m		<1	0	
Titanium	ppm	ASTM D5185m		<1	0	
Silver	ppm	ASTM D5185m	>2	0	<1	
Aluminum	ppm	ASTM D5185m	>3	2	<1	
Lead	ppm	ASTM D5185m	>2	<1	0	
Copper	ppm	ASTM D5185m	>8	<1	<1	
Tin	ppm	ASTM D5185m	>4	<1	0	
Antimony	ppm	ASTM D5185m			0	
Vanadium	ppm	ASTM D5185m		<1	0	
Cadmium	ppm	ASTM D5185m		<1	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	
Barium	ppm	ASTM D5185m		0	0	
Molybdenum	ppm	ASTM D5185m		<1	0	
Manganese	ppm	ASTM D5185m		<1	0	
Magnesium	ppm	ASTM D5185m		0	0	
Calcium	ppm	ASTM D5185m		3	0	
Phosphorus	ppm	ASTM D5185m		0	0	
Zinc	ppm	ASTM D5185m		0	0	
Sulfur	ppm	ASTM D5185m		0	34	
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	<1	<1	
Sodium	ppm	ASTM D5185m		<1	0	
Potassium	ppm	ASTM D5185m	>20	<1	0	
Water	%	ASTM D6304	>0.01	0.002	0.001	
ppm Water	ppm	ASTM D6304	>100	24	10	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974		0.014	0.008	




OIL ANALYSIS REPORT





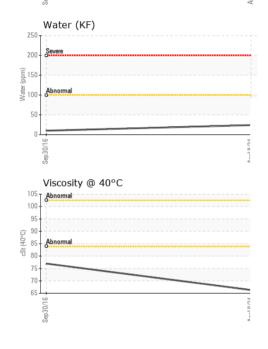

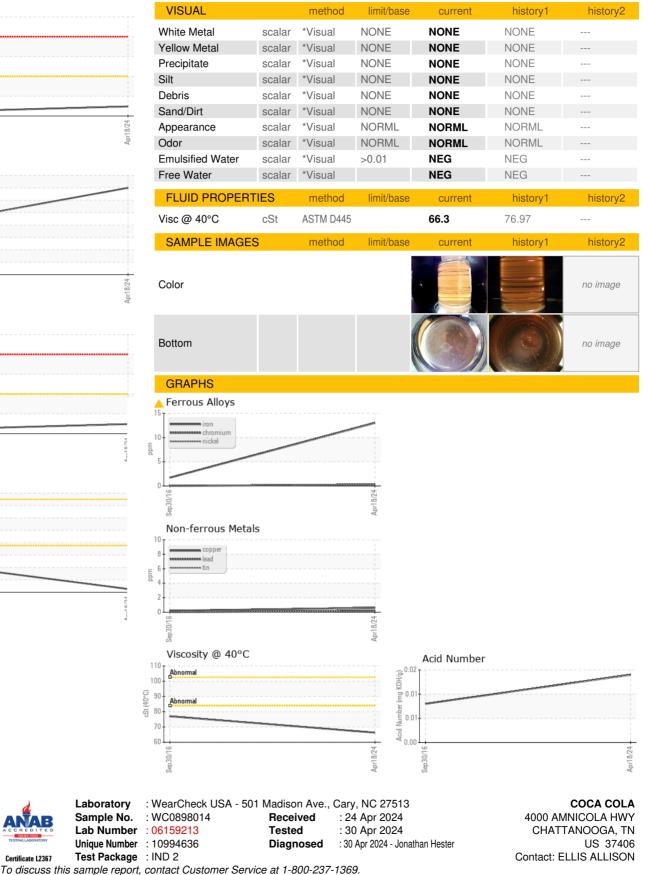

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

(40°C)

Laboratory

Sample No.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Certificate 12367

Contact/Location: ELLIS ALLISON - COCCHA

Page 2 of 2