




OIL ANALYSIS REPORT



Machine Id
CATERPILLAR GM02
 Component
Biogas Engine
 Fluid
MAHLER Q8 Mahler G8 SAE 40 (--- GAL)

Sample Rating Trend

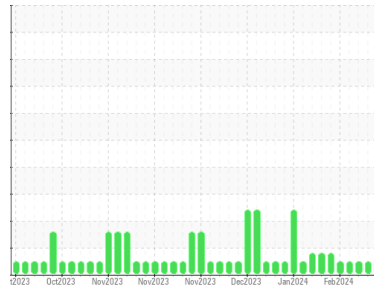

NORMAL



DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			WC0870555	WC0870560	WC0870562
Sample Date	Client Info			23 Apr 2024	15 Apr 2024	04 Apr 2024
Machine Age	hrs	Client Info		68435	68278	68088
Oil Age	hrs	Client Info		77	190	48
Oil Changed	Client Info			N/A	N/A	N/A
Sample Status				NORMAL	NORMAL	NORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Fuel	WC Method	>4.0		<1.0	<1.0	<1.0
Water	WC Method	>0.1		NEG	NEG	NEG
Glycol	WC Method			NEG	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>45	26	11	4
Chromium	ppm	ASTM D5185m	>2	<1	<1	0
Nickel	ppm	ASTM D5185m	>2	<1	<1	0
Titanium	ppm	ASTM D5185m		<1	0	0
Silver	ppm	ASTM D5185m	>5	0	0	0
Aluminum	ppm	ASTM D5185m	>10	3	2	2
Lead	ppm	ASTM D5185m	>5	<1	0	0
Copper	ppm	ASTM D5185m	>14	<1	4	2
Tin	ppm	ASTM D5185m	>13	<1	2	0
Vanadium	ppm	ASTM D5185m		<1	0	0
Cadmium	ppm	ASTM D5185m		<1	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		2	<1	<1
Manganese	ppm	ASTM D5185m		<1	2	<1
Magnesium	ppm	ASTM D5185m		26	5	11
Calcium	ppm	ASTM D5185m		1391	1405	1330
Phosphorus	ppm	ASTM D5185m		426	413	388
Zinc	ppm	ASTM D5185m		485	461	432
Sulfur	ppm	ASTM D5185m		2246	2451	2421

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>200	47	125	29
Sodium	ppm	ASTM D5185m		1	6	4
Potassium	ppm	ASTM D5185m	>20	<1	1	0


INFRA-RED		method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844		0.1	0	0
Nitration	Abs/cm	*ASTM D7624	>20	5.0	5.2	4.4
Sulfation	Abs/.1mm	*ASTM D7415	>30	15.6	15.8	14.8

FLUID DEGRADATION		method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414	>25	9.9	10.2	9.1
Acid Number (AN)	mg KOH/g	ASTM D8045		0.51	1.004	0.50
Base Number (BN)	mg KOH/g	ASTM D2896	8.0	5.47	4.71	5.02




OIL ANALYSIS REPORT


FT-IR (Direct Trend)

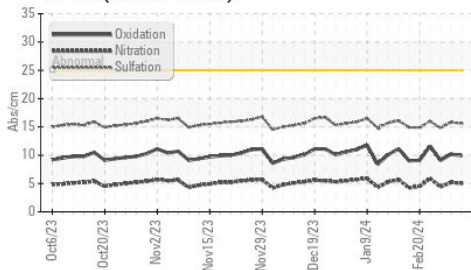


Acid Number

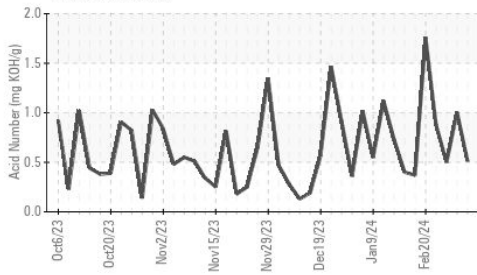

Base Number

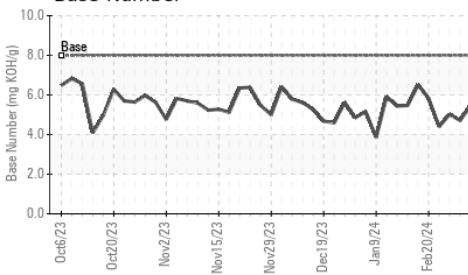


Viscosity @ 100°C

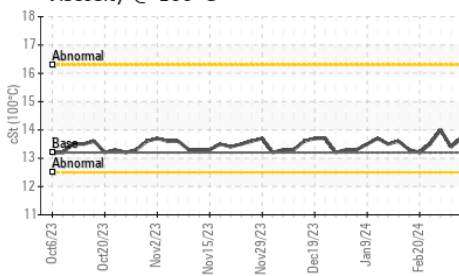

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	13.2	13.7	13.4

GRAPHS

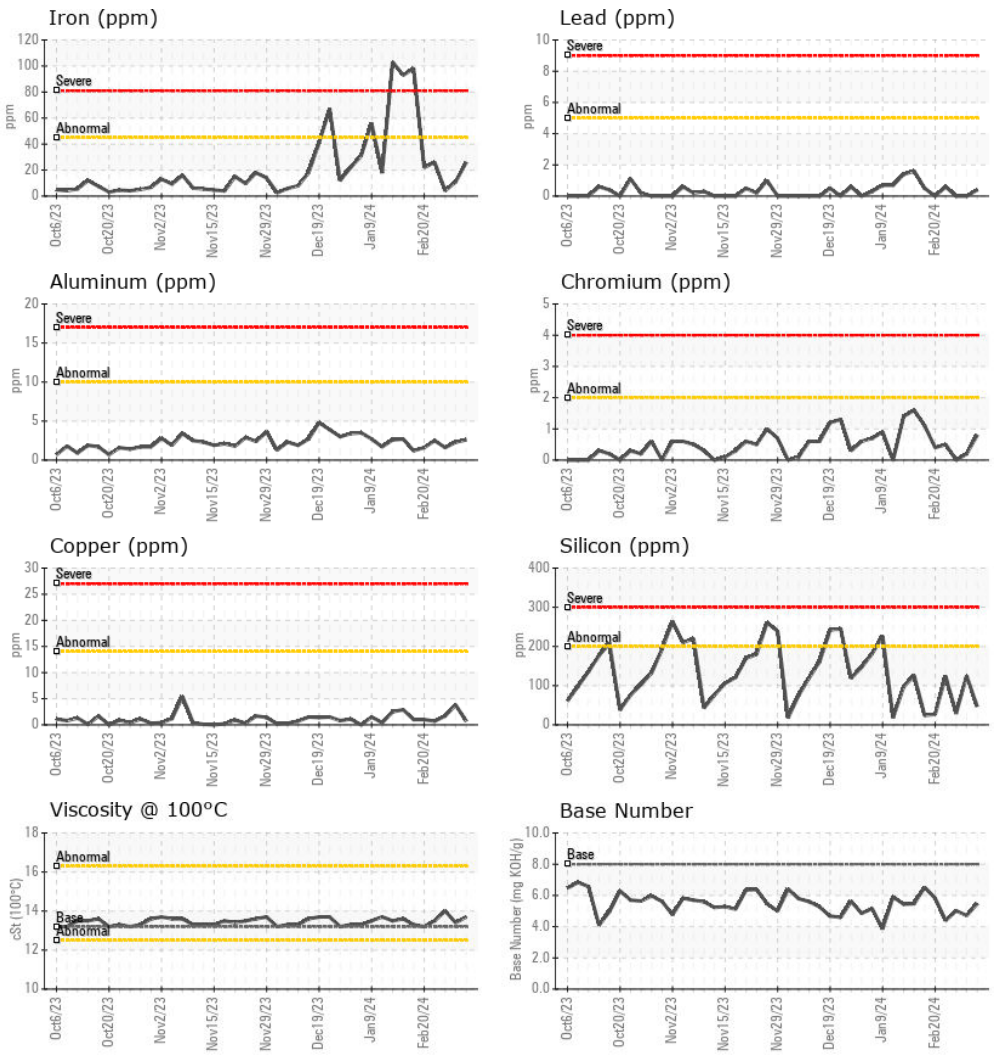

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0870555 **Received** : 24 Apr 2024
Lab Number : 06159310 **Tested** : 25 Apr 2024
Unique Number : 10994733 **Diagnosed** : 26 Apr 2024 - Don Baldrige
Test Package : MOB 2

OAK GROVE KS
 1150 E 700TH AVE
 ARCADIA, KS
 US 66711
 Contact: KALEB WEAVER
 kaleb.weaver@cubedistrictenergy.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)