



OIL ANALYSIS REPORT

Sample Rating Trend



ISO



Machine Id
TOTE 99
 Component
New (Unused) Oil
 Fluid
{not provided} (--- GAL)

DIAGNOSIS

▲ Recommendation

This is a baseline read-out on the submitted sample.

▲ Contamination

There is a high amount of particulates present in the oil.

SAMPLE INFORMATION	method	limit/base	current	history1	history2
Sample Number	Client Info		TLC0001647	---	---
Sample Date	Client Info		19 Apr 2024	---	---
Machine Age	hrs	Client Info	0	---	---
Oil Age	hrs	Client Info	0	---	---
Oil Changed	Client Info		N/A	---	---
Sample Status			ABNORMAL	---	---

WEAR METALS	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >5	0	---	---
Chromium	ppm	ASTM D5185m >5	0	---	---
Nickel	ppm	ASTM D5185m >5	<1	---	---
Titanium	ppm	ASTM D5185m	0	---	---
Silver	ppm	ASTM D5185m >5	0	---	---
Aluminum	ppm	ASTM D5185m >5	1	---	---
Lead	ppm	ASTM D5185m >5	0	---	---
Copper	ppm	ASTM D5185m >5	0	---	---
Tin	ppm	ASTM D5185m >5	<1	---	---
Vanadium	ppm	ASTM D5185m	0	---	---
Cadmium	ppm	ASTM D5185m	0	---	---

ADDITIVES	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	133	---	---
Barium	ppm	ASTM D5185m	0	---	---
Molybdenum	ppm	ASTM D5185m	35	---	---
Manganese	ppm	ASTM D5185m	0	---	---
Magnesium	ppm	ASTM D5185m	145	---	---
Calcium	ppm	ASTM D5185m	658	---	---
Phosphorus	ppm	ASTM D5185m	573	---	---
Zinc	ppm	ASTM D5185m	514	---	---
Sulfur	ppm	ASTM D5185m	6959	---	---






CONTAMINANTS	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	6	---	---
Sodium	ppm	ASTM D5185m	0	---	---
Potassium	ppm	ASTM D5185m >20	2	---	---
Water	%	ASTM D6304	NEG	---	---

FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>5000	▲ 127664	---	---
Particles >6µm	ASTM D7647	>1300	▲ 51191	---	---
Particles >14µm	ASTM D7647	>160	▲ 896	---	---
Particles >21µm	ASTM D7647	>40	31	---	---
Particles >38µm	ASTM D7647	>10	0	---	---
Particles >71µm	ASTM D7647	>3	0	---	---
Oil Cleanliness	ISO 4406 (c)	>19/17/14	▲ 24/23/17	---	---

FLUID DEGRADATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.32	---	---



OIL ANALYSIS REPORT

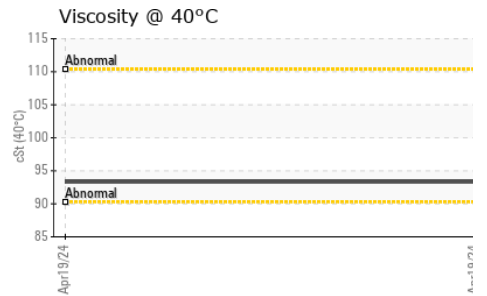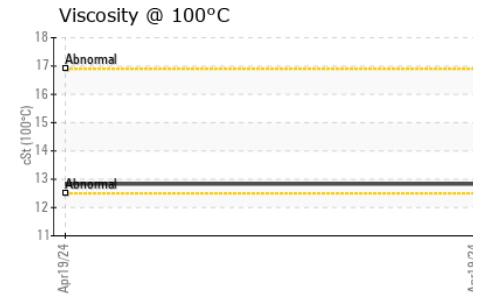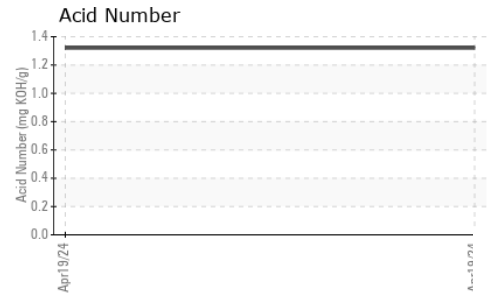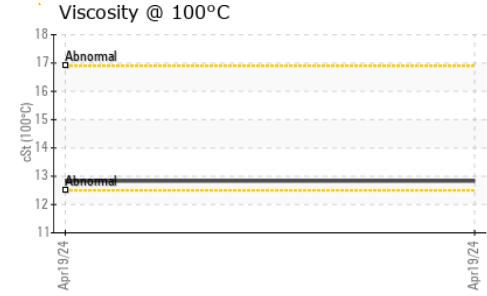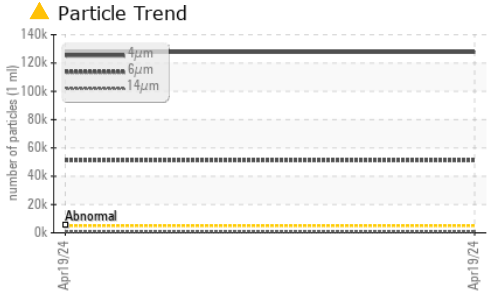





VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	NONE	---	---
Yellow Metal	scalar	*Visual	NONE	NONE	---	---
Precipitate	scalar	*Visual	NONE	NONE	---	---
Silt	scalar	*Visual	NONE	NONE	---	---
Debris	scalar	*Visual	NONE	NONE	---	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---	---
Appearance	scalar	*Visual	NORML	NORML	---	---
Odor	scalar	*Visual	NORML	NORML	---	---
Emulsified Water	scalar	*Visual	NEG	---	---	
Free Water	scalar	*Visual	NEG	---	---	

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	93.31	---	---
Visc @ 100°C	cSt	ASTM D445	12.83	---	---
Viscosity Index (VI)	Scale	ASTM D2270	134	---	---

SAMPLE IMAGES

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color				no image	no image
Bottom				no image	no image

GRAPHS

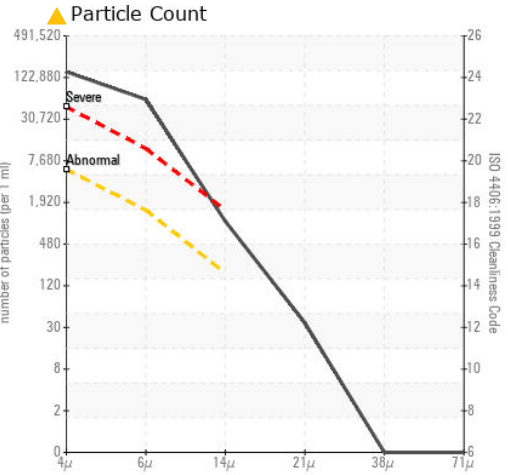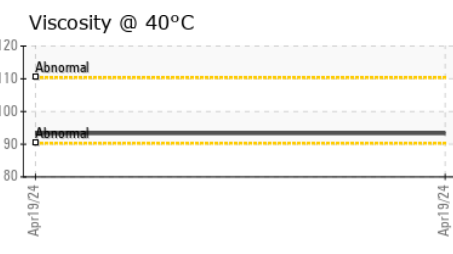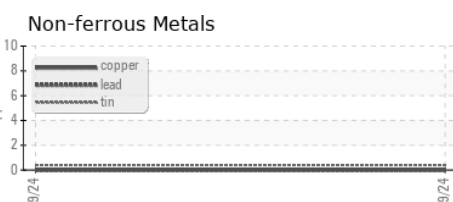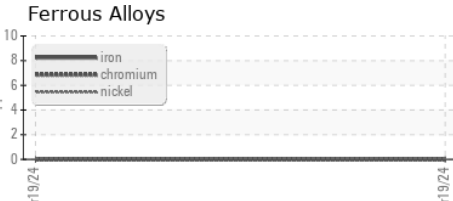

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : TLC0001647 **Received** : 24 Apr 2024
Lab Number : 06159546 **Tested** : 26 Apr 2024
Unique Number : 10994969 **Diagnosed** : 26 Apr 2024 - Jonathan Hester
Test Package : PLANT (Additional Tests: FT-IR, ICP-NewOil, KV100, VI)

SUPPLY PRO
 115 EMPIRE WAY
 ATLANTA, GA
 US 30354
 Contact: MICHAEL JACKSON
 mjackson@supplypro1.com
 T: (470)991-1693
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)