




# OIL ANALYSIS REPORT

## Sample Rating Trend

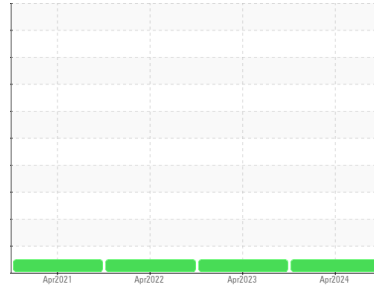

**NORMAL**



Area

[PMOAS3372437]

Machine Id

**LANDFALL 2 (S/N I120384917)**

Component

**Diesel Engine**

Fluid

**DIESEL ENGINE OIL SAE 15W40 (--- QTS)**

### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor. Please specify the component make and model with your next sample.

#### Wear

All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the oil.

#### Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>DC0035057</b>	DC0026349	DC0017056
Sample Date	Client Info			<b>12 Apr 2024</b>	06 Apr 2023	20 Apr 2022
Machine Age	hrs	Client Info		<b>0</b>	564	506
Oil Age	hrs	Client Info		<b>0</b>	0	0
Oil Changed	Client Info			<b>N/A</b>	Changed	Changed
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Fuel	WC Method	>5		<b>&lt;1.0</b>	<1.0	<1.0
Water	WC Method	>0.2		<b>NEG</b>	NEG	NEG
Glycol	WC Method			<b>NEG</b>	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>100	<b>2</b>	2	2
Chromium	ppm	ASTM D5185m	>20	<b>0</b>	<1	0
Nickel	ppm	ASTM D5185m	>4	<b>0</b>	<1	<1
Titanium	ppm	ASTM D5185m		<b>0</b>	0	<1
Silver	ppm	ASTM D5185m	>3	<b>0</b>	0	2
Aluminum	ppm	ASTM D5185m	>20	<b>&lt;1</b>	<1	<1
Lead	ppm	ASTM D5185m	>40	<b>0</b>	0	<1
Copper	ppm	ASTM D5185m	>330	<b>&lt;1</b>	1	1
Tin	ppm	ASTM D5185m	>15	<b>0</b>	<1	<1
Antimony	ppm	ASTM D5185m		<b>---</b>	---	---
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	<1

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	250	<b>5</b>	2	15
Barium	ppm	ASTM D5185m	10	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	100	<b>2</b>	2	2
Manganese	ppm	ASTM D5185m		<b>0</b>	<1	<1
Magnesium	ppm	ASTM D5185m	450	<b>56</b>	34	46
Calcium	ppm	ASTM D5185m	3000	<b>2449</b>	2404	2296
Phosphorus	ppm	ASTM D5185m	1150	<b>985</b>	949	917
Zinc	ppm	ASTM D5185m	1350	<b>1153</b>	1094	1013
Sulfur	ppm	ASTM D5185m	4250	<b>4948</b>	4731	3249

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>3</b>	2	2
Sodium	ppm	ASTM D5185m	>158	<b>&lt;1</b>	2	<1
Potassium	ppm	ASTM D5185m	>20	<b>&lt;1</b>	2	0


INFRA-RED		method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844	>3	<b>0.1</b>	0	0.1
Nitration	Abs/cm	*ASTM D7624	>20	<b>5.5</b>	5.0	5.7
Sulfation	Abs/.1mm	*ASTM D7415	>30	<b>15.6</b>	13.9	21.2

FLUID DEGRADATION		method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414	>25	<b>9.6</b>	8.9	16.5
Base Number (BN)	mg KOH/g	ASTM D2896	8.5	<b>7.7</b>	6.9	9.6




# OIL ANALYSIS REPORT


FT-IR (Direct Trend)

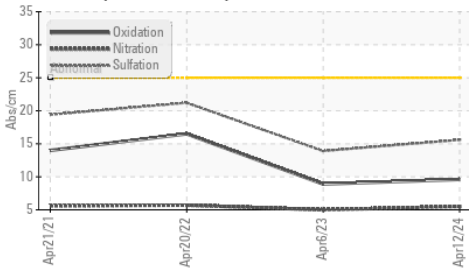

Base Number

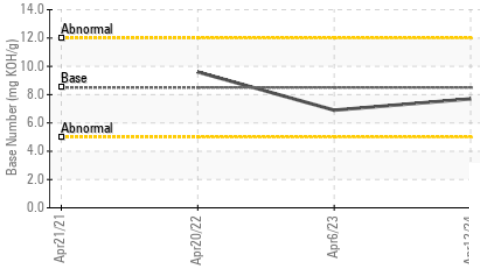









Viscosity @ 100°C

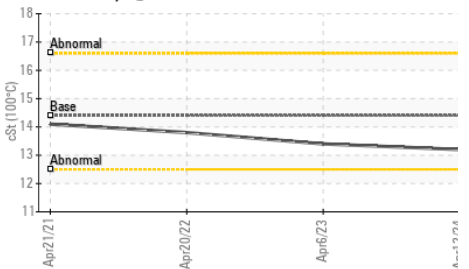

PARAMETER	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	14.4	13.2	13.4

GRAPHS

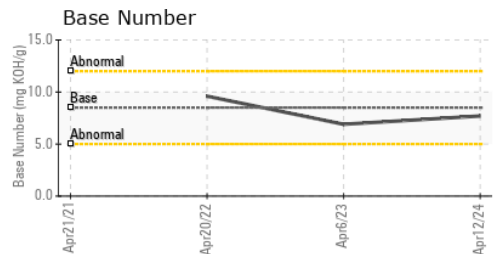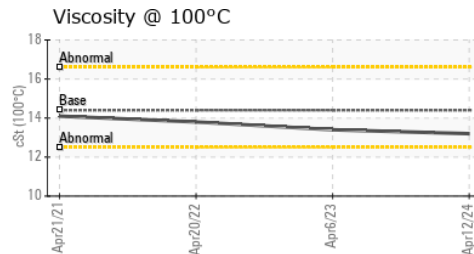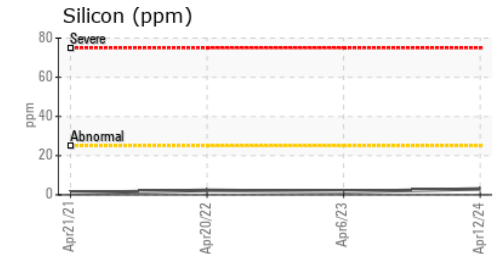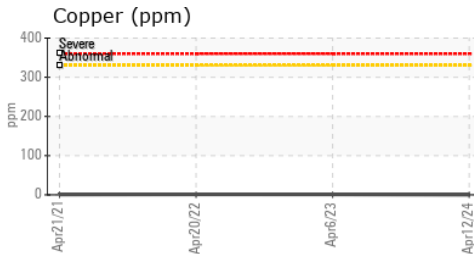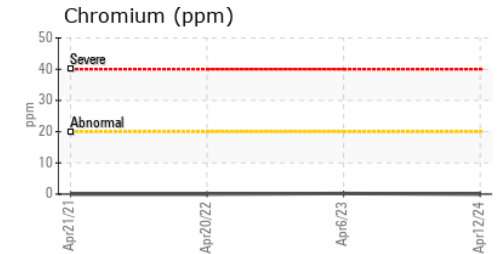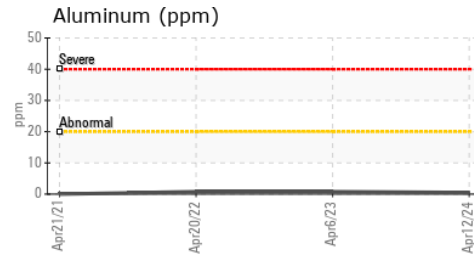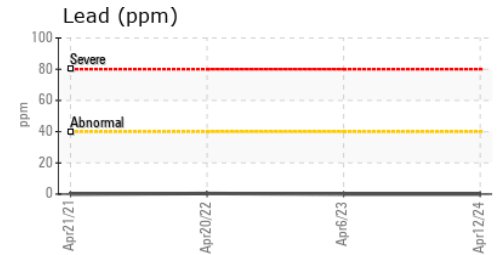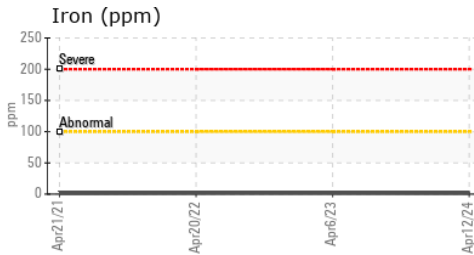

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513

Sample No. : DC0035057

Lab Number : 06159698

Unique Number : 10995121

Test Package : MOB 1 ( Additional Tests: TBN )

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Received : 24 Apr 2024

Tested : 25 Apr 2024

Diagnosed : 25 Apr 2024 - Wes Davis

KELLY GENERATOR & EQUIPMENT INC

1955 DALE LN

OWINGS, MD

US 20736

Contact: LESLIE SNURR

LSNURR@KGE.COM

T: (410)257-5225

F: (410)257-5227