




OIL ANALYSIS REPORT

Sample Rating Trend

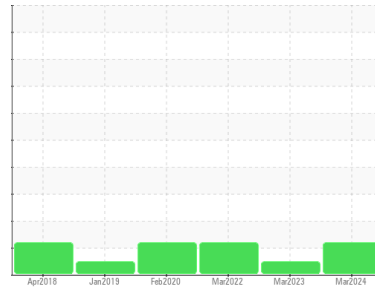

ISO



Machine Id
KAESER SFC 55T 5183038 (S/N 1015)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation

Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			KCPA015030	KCPA001406	KCP43666
Sample Date	Client Info			28 Mar 2024	31 Mar 2023	22 Mar 2022
Machine Age	hrs	Client Info		17485	15472	12968
Oil Age	hrs	Client Info		0	0	2442
Oil Changed	Client Info			Changed	N/A	Changed
Sample Status				ATTENTION	NORMAL	ABNORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	1
Chromium	ppm	ASTM D5185m	>10	<1	0	0
Nickel	ppm	ASTM D5185m	>3	1	0	0
Titanium	ppm	ASTM D5185m	>3	<1	0	0
Silver	ppm	ASTM D5185m	>2	<1	0	<1
Aluminum	ppm	ASTM D5185m	>10	2	<1	<1
Lead	ppm	ASTM D5185m	>10	1	0	0
Copper	ppm	ASTM D5185m	>50	6	5	7
Tin	ppm	ASTM D5185m	>10	1	0	<1
Antimony	ppm	ASTM D5185m		---	---	---
Vanadium	ppm	ASTM D5185m		<1	0	0
Cadmium	ppm	ASTM D5185m		<1	0	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	<1
Barium	ppm	ASTM D5185m	90	<1	0	0
Molybdenum	ppm	ASTM D5185m	0	1	0	0
Manganese	ppm	ASTM D5185m		<1	0	<1
Magnesium	ppm	ASTM D5185m	100	2	0	24
Calcium	ppm	ASTM D5185m	0	3	0	0
Phosphorus	ppm	ASTM D5185m	0	2	0	4
Zinc	ppm	ASTM D5185m	0	4	0	14
Sulfur	ppm	ASTM D5185m	23500	22262	22465	16501

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	2	0	<1
Sodium	ppm	ASTM D5185m		0	0	10
Potassium	ppm	ASTM D5185m	>20	2	0	2
Water	%	ASTM D6304	>0.05	0.009	0.007	0.005
ppm Water	ppm	ASTM D6304	>500	91	77.5	57.8

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		4878	2340	9015
Particles >6µm		ASTM D7647	>1300	1360	548	2188
Particles >14µm		ASTM D7647	>80	86	35	250
Particles >21µm		ASTM D7647	>20	20	8	66
Particles >38µm		ASTM D7647	>4	0	0	2
Particles >71µm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>--/17/13	19/18/14	18/16/12	18/15

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.51	0.47	0.46

OIL ANALYSIS REPORT

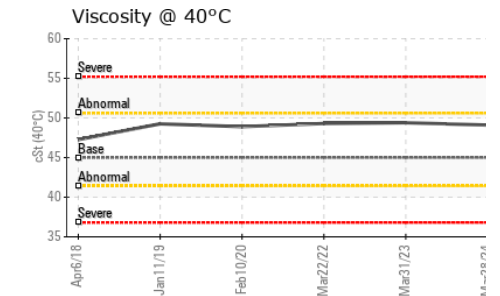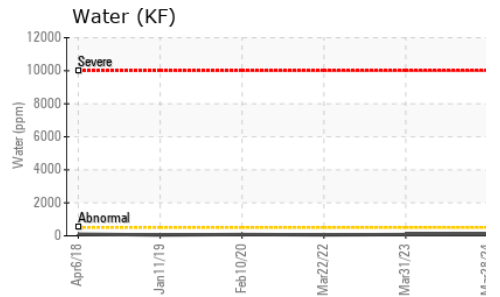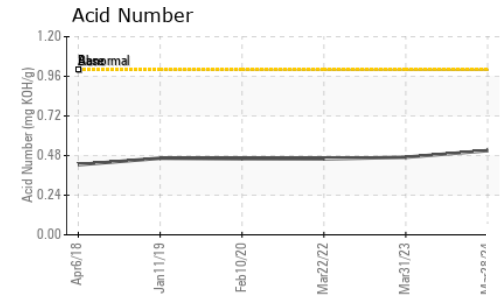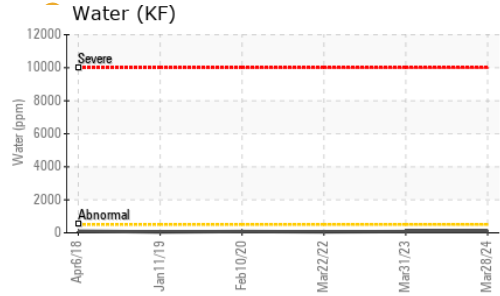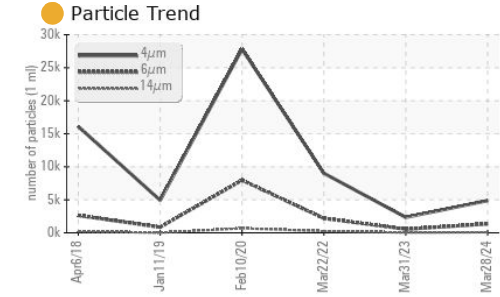

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 45	49.1	49.4	49.3

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

GRAPHS

Date	Iron (ppm)	Chromium (ppm)	Nickel (ppm)
Apr6/18	2.5	0.5	0.5
Jan11/19	2.0	0.5	0.5
Feb10/20	2.5	0.5	0.5
Mar22/22	2.0	0.5	0.5
Mar31/23	2.0	0.5	0.5
Mar28/24	2.0	0.5	0.5

Date	4µm	6µm	14µm	21µm	38µm	71µm
Apr6/18	491.520	122.880	30.720	7.680	1.920	0.480
Jan11/19	1920	480	120	30	8	2
Feb10/20	1920	480	120	30	8	2
Mar22/22	1920	480	120	30	8	2
Mar31/23	1920	480	120	30	8	2
Mar28/24	1920	480	120	30	8	2

Date	Copper (ppm)	Lead (ppm)	Tin (ppm)
Apr6/18	4	0.5	0.5
Jan11/19	4	0.5	0.5
Feb10/20	4	0.5	0.5
Mar22/22	4	0.5	0.5
Mar31/23	4	0.5	0.5
Mar28/24	4	0.5	0.5

Date	cSt (40°C)
Apr6/18	48
Jan11/19	49
Feb10/20	49
Mar22/22	49
Mar31/23	49
Mar28/24	49

Date	Acid Number (mg KOH/g)
Apr6/18	0.40
Jan11/19	0.42
Feb10/20	0.45
Mar22/22	0.48
Mar31/23	0.50
Mar28/24	0.52



Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA015030 **Received** : 24 Apr 2024
Lab Number : 06159790 **Tested** : 25 Apr 2024
Unique Number : 10995213 **Diagnosed** : 26 Apr 2024 - Don Baldrige
Test Package : IND 2 (Additional Tests: KF, PrtCount)

MEURER RESEARCH
 16133W 45TH DR
 GOLDEN, CO
 US 80403
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)