




# OIL ANALYSIS REPORT

Sample Rating Trend

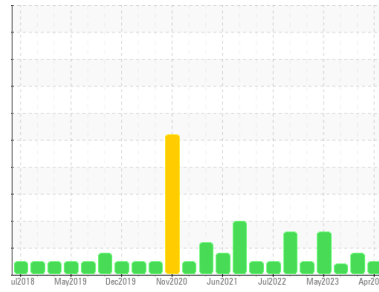

**NORMAL**



Machine Id  
**COMP J (S/N S082016)**  
 Component  
**Air Compressor**  
 Fluid  
**USPI MAX FG AIR 46 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

|               | method      | limit/base  | current            | history1    | history2    |
|---------------|-------------|-------------|--------------------|-------------|-------------|
| Sample Number | Client Info |             | <b>USPM160380</b>  | USPM30521   | USPM29630   |
| Sample Date   | Client Info |             | <b>24 Apr 2024</b> | 04 Jan 2024 | 13 Sep 2023 |
| Machine Age   | hrs         | Client Info | <b>0</b>           | 0           | 0           |
| Oil Age       | hrs         | Client Info | <b>0</b>           | 0           | 0           |
| Oil Changed   | Client Info |             | <b>N/A</b>         | N/A         | N/A         |
| Sample Status |             |             | <b>NORMAL</b>      | ABNORMAL    | ABNORMAL    |

## WEAR METALS

|          | method | limit/base      | current  | history1 | history2 |
|----------|--------|-----------------|----------|----------|----------|
| Iron     | ppm    | ASTM D5185m >50 | <b>0</b> | 0        | 0        |
| Chromium | ppm    | ASTM D5185m >4  | <b>0</b> | <1       | <1       |
| Nickel   | ppm    | ASTM D5185m >4  | <b>0</b> | 0        | 0        |
| Titanium | ppm    | ASTM D5185m     | <b>0</b> | <1       | <1       |
| Silver   | ppm    | ASTM D5185m     | <b>0</b> | 0        | 0        |
| Aluminum | ppm    | ASTM D5185m >10 | <b>0</b> | 0        | <1       |
| Lead     | ppm    | ASTM D5185m >20 | <b>0</b> | <1       | <1       |
| Copper   | ppm    | ASTM D5185m >40 | <b>0</b> | <1       | 0        |
| Tin      | ppm    | ASTM D5185m >5  | <b>0</b> | <1       | <1       |
| Vanadium | ppm    | ASTM D5185m     | <b>0</b> | 0        | <1       |
| Cadmium  | ppm    | ASTM D5185m     | <b>0</b> | <1       | <1       |

## ADDITIVES

|            | method | limit/base    | current  | history1 | history2 |
|------------|--------|---------------|----------|----------|----------|
| Boron      | ppm    | ASTM D5185m 0 | <b>0</b> | 0        | 0        |
| Barium     | ppm    | ASTM D5185m 0 | <b>0</b> | 0        | 0        |
| Molybdenum | ppm    | ASTM D5185m 0 | <b>0</b> | <1       | 0        |
| Manganese  | ppm    | ASTM D5185m   | <b>0</b> | <1       | <1       |
| Magnesium  | ppm    | ASTM D5185m 0 | <b>0</b> | 0        | 0        |
| Calcium    | ppm    | ASTM D5185m 0 | <b>0</b> | 0        | 0        |
| Phosphorus | ppm    | ASTM D5185m 0 | <b>0</b> | 1        | 0        |
| Zinc       | ppm    | ASTM D5185m 0 | <b>0</b> | 0        | 0        |
| Sulfur     | ppm    | ASTM D5185m 0 | <b>3</b> | 0        | 4        |

## CONTAMINANTS

|           | method | limit/base       | current      | history1 | history2 |
|-----------|--------|------------------|--------------|----------|----------|
| Silicon   | ppm    | ASTM D5185m >25  | <b>4</b>     | 2        | 3        |
| Sodium    | ppm    | ASTM D5185m      | <b>&lt;1</b> | 0        | 1        |
| Potassium | ppm    | ASTM D5185m >20  | <b>&lt;1</b> | <1       | 3        |
| Water     | %      | ASTM D6304 >0.6  | <b>0.005</b> | 0.025    | 0.014    |
| ppm Water | ppm    | ASTM D6304 >6000 | <b>52</b>    | 251      | 149.1    |

## FLUID CLEANLINESS






|                 | method       | limit/base | current         | history1 | history2 |
|-----------------|--------------|------------|-----------------|----------|----------|
| Particles >4µm  | ASTM D7647   | >10000     | <b>4903</b>     | ---      | ---      |
| Particles >6µm  | ASTM D7647   | >2500      | <b>933</b>      | ---      | ---      |
| Particles >14µm | ASTM D7647   | >320       | <b>53</b>       | ---      | ---      |
| Particles >21µm | ASTM D7647   | >80        | <b>11</b>       | ---      | ---      |
| Particles >38µm | ASTM D7647   | >20        | <b>0</b>        | ---      | ---      |
| Particles >71µm | ASTM D7647   | >4         | <b>0</b>        | ---      | ---      |
| Oil Cleanliness | ISO 4406 (c) | >20/18/15  | <b>19/17/13</b> | ---      | ---      |

## FLUID DEGRADATION

|                  | method   | limit/base      | current     | history1 | history2 |
|------------------|----------|-----------------|-------------|----------|----------|
| Acid Number (AN) | mg KOH/g | ASTM D8045 0.16 | <b>0.26</b> | 0.089    | 0.093    |




# OIL ANALYSIS REPORT

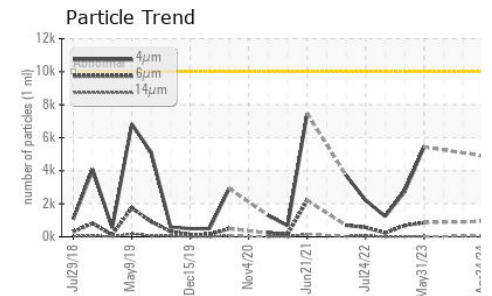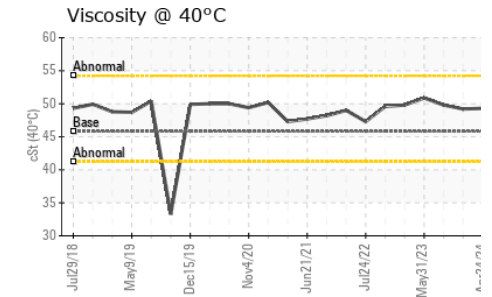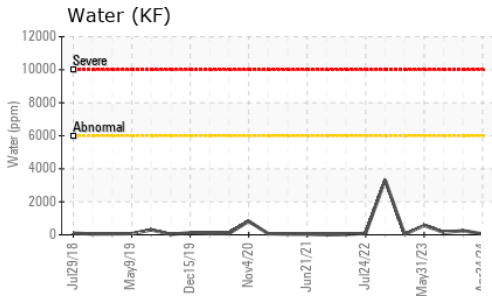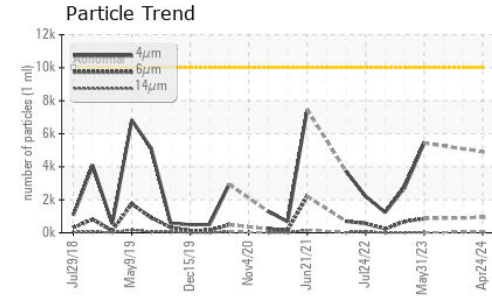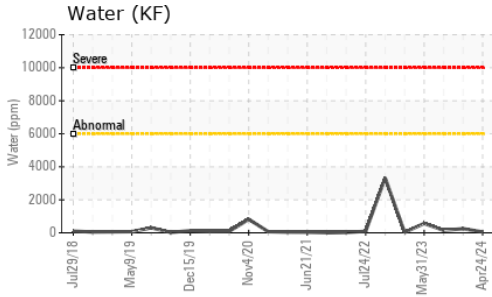






| VISUAL           | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| White Metal      | scalar | *Visual    | NONE    | NONE     | NONE     |
| Yellow Metal     | scalar | *Visual    | NONE    | NONE     | NONE     |
| Precipitate      | scalar | *Visual    | NONE    | NONE     | NONE     |
| Silt             | scalar | *Visual    | NONE    | ▲ MODER  | NONE     |
| Debris           | scalar | *Visual    | NONE    | ▲ MODER  | NONE     |
| Sand/Dirt        | scalar | *Visual    | NONE    | NONE     | NONE     |
| Appearance       | scalar | *Visual    | NORML   | NORML    | NORML    |
| Odor             | scalar | *Visual    | NORML   | NORML    | NORML    |
| Emulsified Water | scalar | *Visual    | >0.6    | NEG      | NEG      |
| Free Water       | scalar | *Visual    |         | NEG      | NEG      |

| FLUID PROPERTIES | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| Visc @ 40°C      | cSt    | ASTM D445  | 45.8    | 49.3     | 49.2     |

| SAMPLE IMAGES | method | limit/base | current | history1 | history2 |
|---------------|--------|------------|---------|----------|----------|
|---------------|--------|------------|---------|----------|----------|

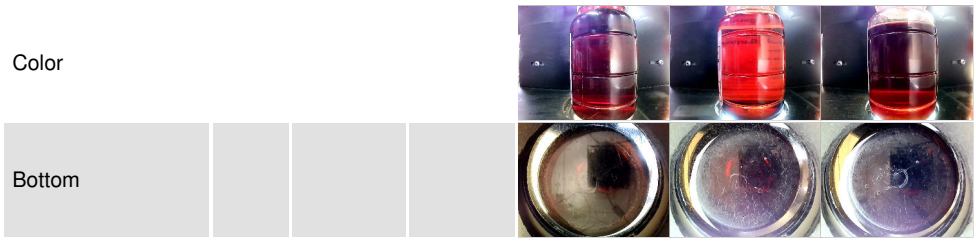

## GRAPHS

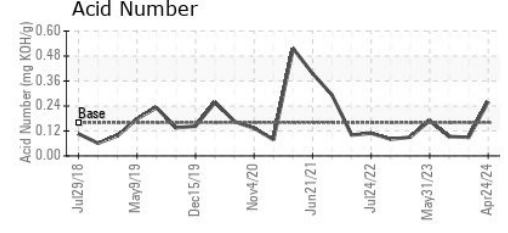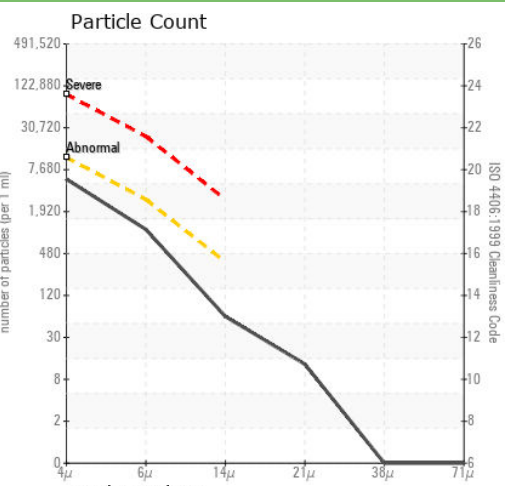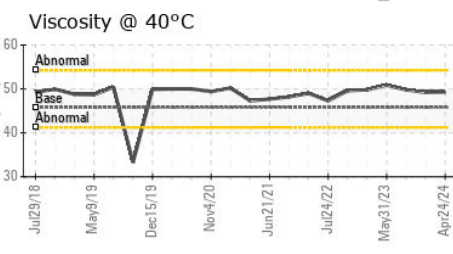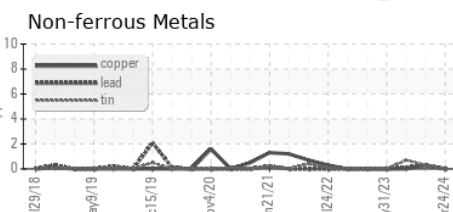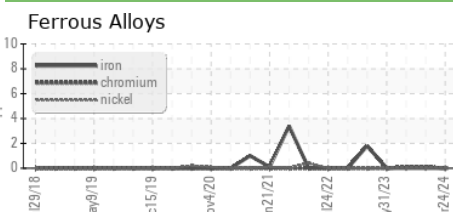

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
 Sample No. : USPM160380  
 Lab Number : 06160380  
 Unique Number : 10995803  
 Test Package : IND 2

Received : 25 Apr 2024  
 Tested : 26 Apr 2024  
 Diagnosed : 29 Apr 2024 - Doug Bogart

SMITHFIELD - CRETE  
 2223 COUNTY RD I  
 CRETE, NE  
 US 68333  
 Contact:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: