




# OIL ANALYSIS REPORT

Sample Rating Trend

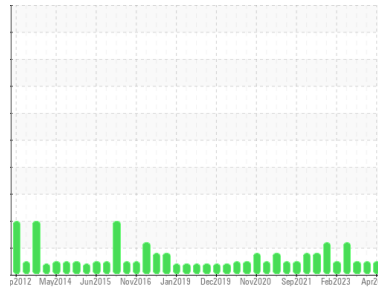

**NORMAL**



Machine Id  
**FES AB10856V**  
 Component  
**Refrigeration Compressor**  
 Fluid  
**USPI 1009-68 SC (--- QTS)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>USP0006575</b>	USP0005135	USP0000076
Sample Date	Client Info	<b>24 Apr 2024</b>	04 Jan 2024	13 Sep 2023
Machine Age	hrs Client Info	<b>0</b>	0	0
Oil Age	hrs Client Info	<b>0</b>	0	0
Oil Changed	Client Info	<b>N/A</b>	N/A	N/A
Sample Status		<b>NORMAL</b>	NORMAL	NORMAL

## WEAR METALS

method	limit/base	current	history1	history2
Iron	ppm ASTM D5185m >8	<b>0</b>	<1	0
Chromium	ppm ASTM D5185m >2	<b>0</b>	<1	0
Nickel	ppm ASTM D5185m	<b>0</b>	0	0
Titanium	ppm ASTM D5185m	<b>0</b>	<1	<1
Silver	ppm ASTM D5185m >2	<b>0</b>	0	0
Aluminum	ppm ASTM D5185m >3	<b>0</b>	0	<1
Lead	ppm ASTM D5185m >2	<b>0</b>	<1	0
Copper	ppm ASTM D5185m >8	<b>0</b>	<1	0
Tin	ppm ASTM D5185m >4	<b>0</b>	<1	<1
Vanadium	ppm ASTM D5185m	<b>0</b>	0	<1
Cadmium	ppm ASTM D5185m	<b>0</b>	<1	<1

## ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm ASTM D5185m	<b>0</b>	0	0
Barium	ppm ASTM D5185m	<b>0</b>	0	0
Molybdenum	ppm ASTM D5185m	<b>0</b>	<1	0
Manganese	ppm ASTM D5185m	<b>0</b>	<1	<1
Magnesium	ppm ASTM D5185m	<b>0</b>	0	0
Calcium	ppm ASTM D5185m	<b>&lt;1</b>	0	0
Phosphorus	ppm ASTM D5185m	<b>0</b>	0	0
Zinc	ppm ASTM D5185m	<b>0</b>	0	0
Sulfur	ppm ASTM D5185m 50	<b>9</b>	0	6

## CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185m >15	<b>2</b>	<1	2
Sodium	ppm ASTM D5185m	<b>&lt;1</b>	0	1
Potassium	ppm ASTM D5185m >20	<b>&lt;1</b>	<1	2
Water	% ASTM D6304 >0.01	<b>0.003</b>	0.002	0.00
ppm Water	ppm ASTM D6304 >100	<b>29</b>	21	0.00

## FLUID CLEANLINESS






method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647 >10000	<b>5889</b>	6644	2517
Particles >6µm	ASTM D7647 >2500	<b>1118</b>	1400	638
Particles >14µm	ASTM D7647 >320	<b>37</b>	46	29
Particles >21µm	ASTM D7647 >80	<b>5</b>	7	7
Particles >38µm	ASTM D7647 >20	<b>0</b>	0	0
Particles >71µm	ASTM D7647 >4	<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c) >20/18/15	<b>20/17/12</b>	20/18/13	19/16/12

## FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g ASTM D974 0.005	<b>0.013</b>	0.014	0.014



# OIL ANALYSIS REPORT

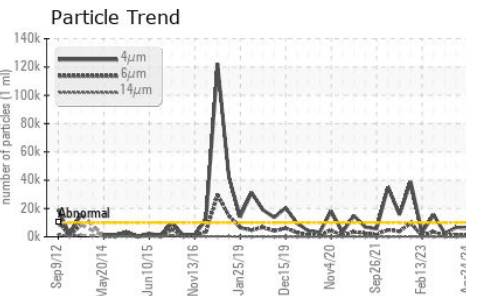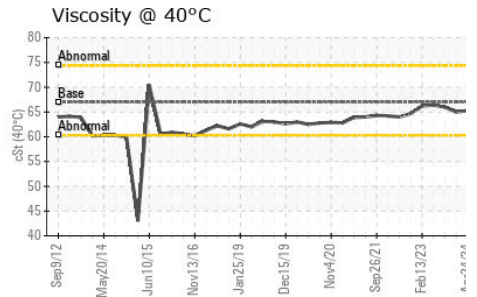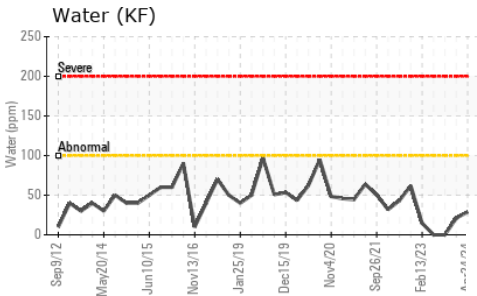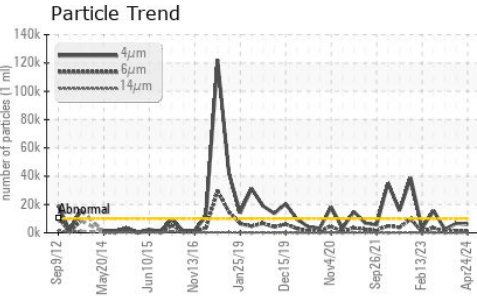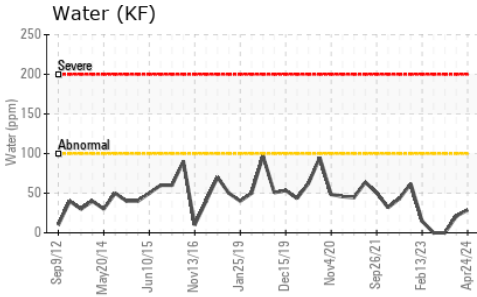


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.01	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 67	65.3	65.0	66.0






SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color

Bottom

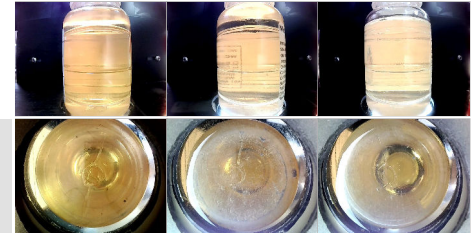

## GRAPHS

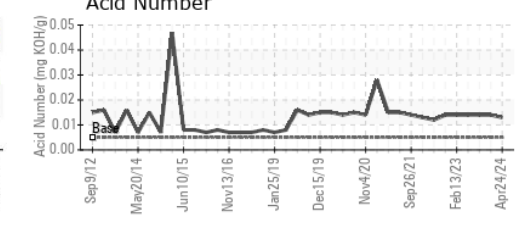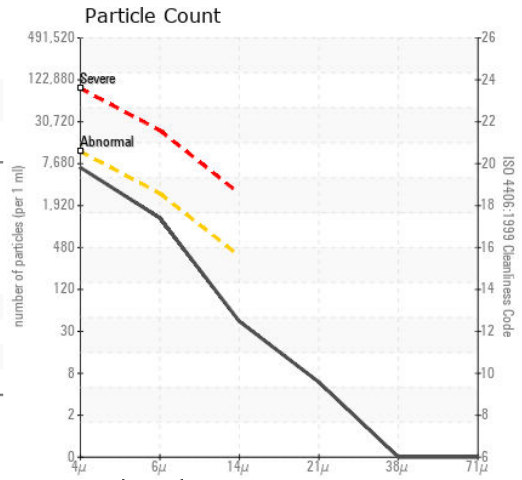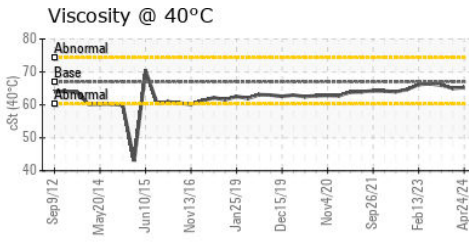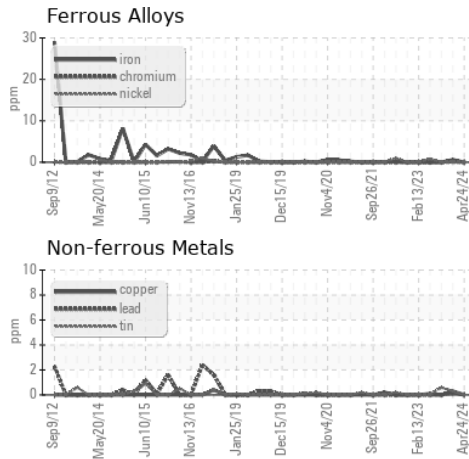

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513

Sample No. : USP006575

Lab Number : 06160406

Unique Number : 10995829

Test Package : IND 2

Received : 25 Apr 2024

Tested : 26 Apr 2024

Diagnosed : 29 Apr 2024 - Doug Bogart

FARMLAND FOODS -CRETE

S HIGHWAY 103

CRETE, NE

US 68333

Contact:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:

F: