


OIL ANALYSIS REPORT

Sample Rating Trend







Machine Id 05 (S/N 25851 AGR)

Refrigeration Compressor

USPI 1009-68 SC (--- GAL)

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


		Apr2020 Nov2	020 Apr2021 Oct2021	Aprz022 Nov2022 Aprz023 Octz	023 Apr2024	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		USP0006591	USP0005683	USP0002780
Sample Date		Client Info		22 Apr 2024	22 Jan 2024	20 Oct 2023
Machine Age	hrs	Client Info		1475	10292	11865
Oil Age	hrs	Client Info		1475	0	6027
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				NORMAL	NORMAL	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>8	0	0	0
Chromium	ppm	ASTM D5185m	>2	0	0	<1
Nickel	ppm	ASTM D5185m		0	0	0
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>3	0	0	0
Lead	ppm	ASTM D5185m	>2	0	0	0
Copper	ppm	ASTM D5185m	>8	0	0	<1
Tin	ppm	ASTM D5185m	>4	0	0	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	<1
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		0	0	<1
Manganese	ppm	ASTM D5185m		0	0	0
Magnesium	ppm	ASTM D5185m		0	0	0
Calcium	ppm	ASTM D5185m		0	0	0
Phosphorus	ppm	ASTM D5185m		0	0	0
Zinc	ppm	ASTM D5185m		0	0	0
Sulfur	ppm	ASTM D5185m	50	0	0	0
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	<1	0	0
Sodium	ppm	ASTM D5185m		<1	2	0
Potassium	ppm	ASTM D5185m	>20	<1	0	1
Water	%	ASTM D6304	>0.01	0.003	0.002	0.006
ppm Water	ppm	ASTM D6304	>100	29	24	66.4
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	2456	1013	1087
Particles >6µm		ASTM D7647	>2500	550	244	271
Particles >14µm		ASTM D7647	>320	36	10	23
Particles >21µm		ASTM D7647	>80	10	3	7
Particles >38µm		ASTM D7647	>20	0	0	0
Particles >71µm		ASTM D7647	>4	0	0	0
Oil Cleanliness		ISO 4406 (c)	>20/18/15	18/16/12	17/15/10	17/15/12
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974	0.005	0.014	0.014	0.013





OIL ANALYSIS REPORT



35k 30k - E 25k -	4 <i>j</i> 6 <i>j</i> .	um um hum						
25k - 25k - 15k - 10k - Abn	omal							
5k Ok	1		1	7	2	.33	23	
Apr21/2	Nov9/2	Apr27/2	Oct25/21	Apr22/2	Nov1/2	Apr21/2	0ct20/2	Anr72/74








VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.01	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG
FLUID PROPERT	TIES	method	limit/base	current	history1	history2

Visc @ 40°C	cSt	ASTM D445	67	65.9	65.7	65.5

SAMPLE	IMAGES

Bottom

Color

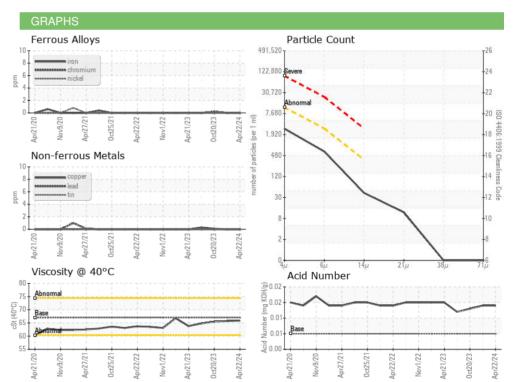





Laboratory Sample No.

: USP0006591 Lab Number : 06160417 Unique Number : 10995840

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 25 Apr 2024 **Tested**

: 26 Apr 2024 Diagnosed : 29 Apr 2024 - Doug Bogart

544 ACME ST

GREEN BAY, WI US 54302 Contact:

Test Package : IND 2 Certificate 12367

To discuss this sample report, contact Customer Service at 1-800-237-1369. * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

AMERICAN FOODS GROUP - DRESSED BEEF (AMEGREDRE)

T:

F: