OIL ANALYSIS REPORT

Sample Rating Trend

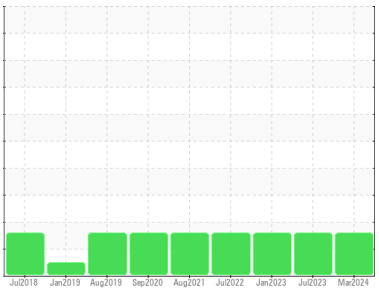

WATER

Machine Id
YORK 9609 MEDICAL CENTER DR CH 3 (S/N SHXM061650)
Component
Refrigeration Compressor
Fluid
YORK TYPE K (--- GAL)

DIAGNOSIS

Recommendation
No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear
All component wear rates are normal.

Contamination
There is a light concentration of water present in the oil. No other contaminants were detected in the oil.

Fluid Condition
The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number		Client Info		**WC0830585**	WC0830532	WC0713871
Sample Date		Client Info		**08 Mar 2024**	26 Jul 2023	25 Jan 2023
Machine Age	hrs	Client Info		**19717**	18313	16697
Oil Age	hrs	Client Info		**0**	0	0
Oil Changed		Client Info		**N/A**	Not Changd	N/A
Sample Status				**MARGINAL**	MARGINAL	MARGINAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>8	**<1**	0	0
Chromium	ppm	ASTM D5185m	>2	**<1**	0	0
Nickel	ppm	ASTM D5185m		**<1**	0	0
Titanium	ppm	ASTM D5185m		**<1**	0	0
Silver	ppm	ASTM D5185m	>2	**0**	0	0
Aluminum	ppm	ASTM D5185m	>3	**2**	0	<1
Lead	ppm	ASTM D5185m	>2	**<1**	0	0
Copper	ppm	ASTM D5185m	>8	**<1**	0	0
Tin	ppm	ASTM D5185m	>4	**<1**	<1	0
Vanadium	ppm	ASTM D5185m		**<1**	<1	0
Cadmium	ppm	ASTM D5185m		**<1**	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	**0**	0	0
Barium	ppm	ASTM D5185m	0	**0**	0	2
Molybdenum	ppm	ASTM D5185m	0	**<1**	0	0
Manganese	ppm	ASTM D5185m	0	**<1**	0	0
Magnesium	ppm	ASTM D5185m	0	**<1**	<1	<1
Calcium	ppm	ASTM D5185m	0	**0**	0	0
Phosphorus	ppm	ASTM D5185m	5	**0**	<1	11
Zinc	ppm	ASTM D5185m	0	**0**	0	0
Sulfur	ppm	ASTM D5185m	10	**0**	0	16

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	**5**	3	5
Sodium	ppm	ASTM D5185m		**2**	<1	0
Potassium	ppm	ASTM D5185m	>20	**<1**	<1	<1
Water	%	ASTM D6304	>0.03	▲ **0.016**	▲ 0.014	▲ 0.032
ppm Water	ppm	ASTM D6304	>300	▲ **163**	▲ 146.3	▲ 321.4

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974	0.03	**0.041**	0.028	0.04

OIL ANALYSIS REPORT

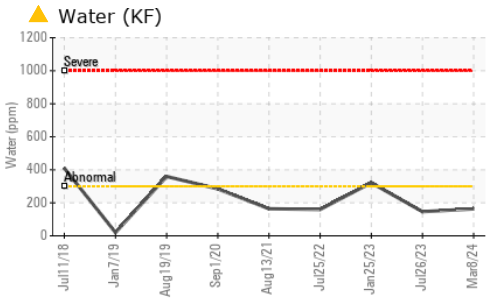

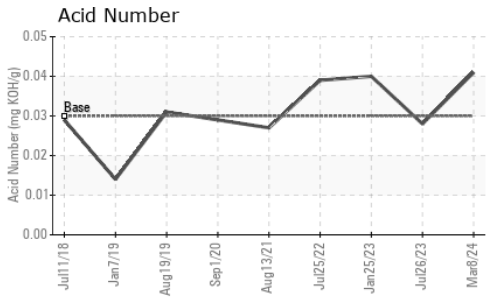

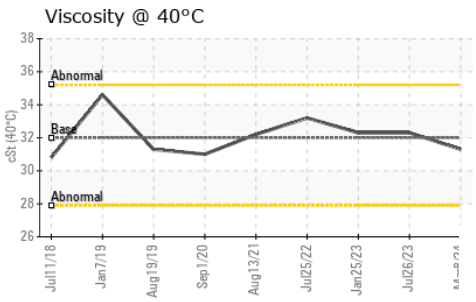

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	**NONE**	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	**NONE**	NONE	NONE
Precipitate	scalar	*Visual	NONE	**NONE**	NONE	NONE
Silt	scalar	*Visual	NONE	**NONE**	NONE	NONE
Debris	scalar	*Visual	NONE	**NONE**	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	**NONE**	NONE	NONE
Appearance	scalar	*Visual	NORML	**NORML**	NORML	NORML
Odor	scalar	*Visual	NORML	**NORML**	NORML	NORML
Emulsified Water	scalar	*Visual	>0.03	**NEG**	NEG	NEG
Free Water	scalar	*Visual		**NEG**	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	32.0	**31.3**	32.3	32.3

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom			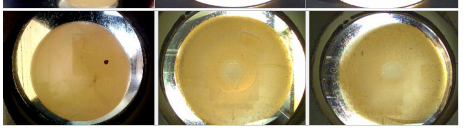		

GRAPHS

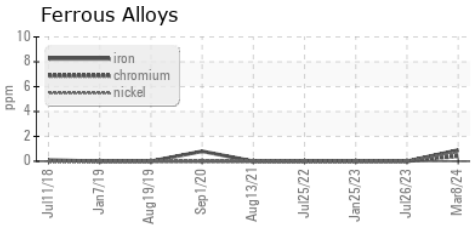

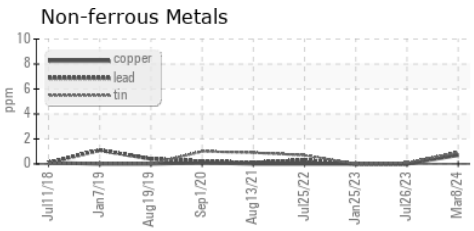

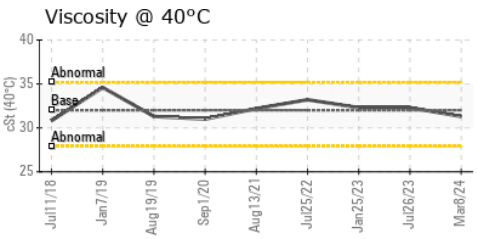

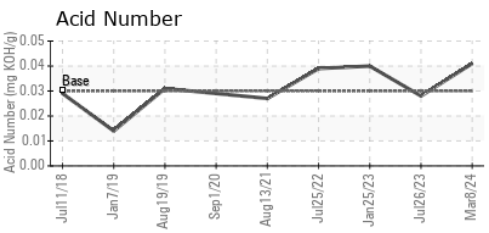

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0830585
Lab Number : 06160445
Unique Number : 10995868
Test Package : IND 2

Received : 25 Apr 2024
Tested : 26 Apr 2024
Diagnosed : 27 Apr 2024 - Don Baldridge

To discuss this sample report, contact Customer Service at 1-800-237-1369.
** - Denotes test methods that are outside of the ISO 17025 scope of accreditation.*
Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

CDS MECHANICAL SERVICES INC
1654 CROFTON BLVD, SUITE 9
CROFTON, MD
US 21114
Contact: DAVID BEALE
DBEALE@CDSMECHANICAL.NET
T:
F:

Report Id: CDSCRO [WUSCAR] 06160445 (Generated: 04/27/2024 10:53:05) Rev: 1

Submitted By: MIKE JARCY