



# OIL ANALYSIS REPORT

Sample Rating Trend



Machine Id  
**TRANE L87M05789 CH-1**  
 Component  
**Refrigeration Compressor**  
 Fluid  
**TRANE 0022 (10 GAL)**

## DIAGNOSIS

### Recommendation

No corrective action is recommended at this time. The oil filtered at the time of sampling has been noted. Resample at the next service interval to monitor.

### Wear

The tin level is abnormal. All other component wear rates are normal.

### Contamination

Elemental level of silicon (Si) above normal.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0930542</b>	---	---
Sample Date	Client Info		<b>05 Apr 2024</b>	---	---
Machine Age	hrs	Client Info	<b>104000</b>	---	---
Oil Age	hrs	Client Info	<b>17000</b>	---	---
Oil Changed	Client Info		<b>Filtered</b>	---	---
Sample Status			<b>ABNORMAL</b>	---	---

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >8	<b>5</b>	---	---
Chromium	ppm	ASTM D5185m >2	<b>&lt;1</b>	---	---
Nickel	ppm	ASTM D5185m	<b>&lt;1</b>	---	---
Titanium	ppm	ASTM D5185m	<b>&lt;1</b>	---	---
Silver	ppm	ASTM D5185m >2	<b>0</b>	---	---
Aluminum	ppm	ASTM D5185m >3	<b>2</b>	---	---
Lead	ppm	ASTM D5185m >2	<b>&lt;1</b>	---	---
Copper	ppm	ASTM D5185m >8	<b>2</b>	---	---
Tin	ppm	ASTM D5185m >4	<b>▲ 6</b>	---	---
Vanadium	ppm	ASTM D5185m	<b>&lt;1</b>	---	---
Cadmium	ppm	ASTM D5185m	<b>&lt;1</b>	---	---

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	---	---
Barium	ppm	ASTM D5185m	<b>0</b>	---	---
Molybdenum	ppm	ASTM D5185m	<b>&lt;1</b>	---	---
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	---	---
Magnesium	ppm	ASTM D5185m	<b>&lt;1</b>	---	---
Calcium	ppm	ASTM D5185m	<b>2</b>	---	---
Phosphorus	ppm	ASTM D5185m	<b>&lt;1</b>	---	---
Zinc	ppm	ASTM D5185m	<b>0</b>	---	---
Sulfur	ppm	ASTM D5185m	<b>0</b>	---	---

## CONTAMINANTS






	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	<b>▲ 22</b>	---	---
Sodium	ppm	ASTM D5185m	<b>&lt;1</b>	---	---
Potassium	ppm	ASTM D5185m >20	<b>&lt;1</b>	---	---
Water	%	ASTM D6304 >0.005	<b>0.004</b>	---	---
ppm Water	ppm	ASTM D6304 >50	<b>40</b>	---	---

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974	<b>0.028</b>	---	---



# OIL ANALYSIS REPORT

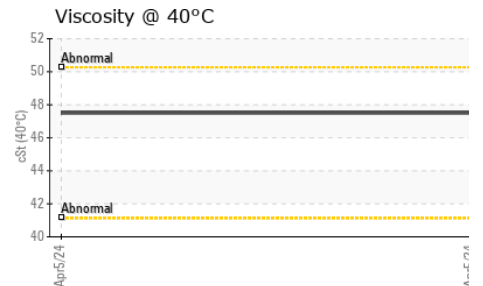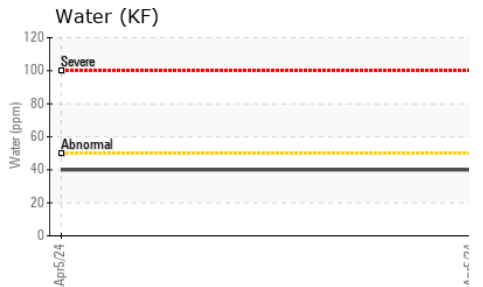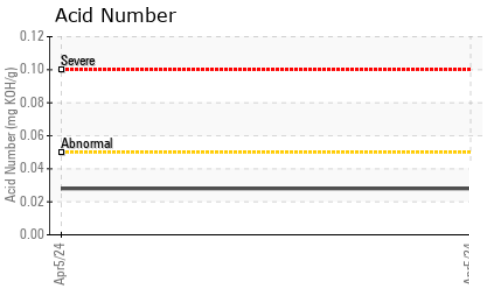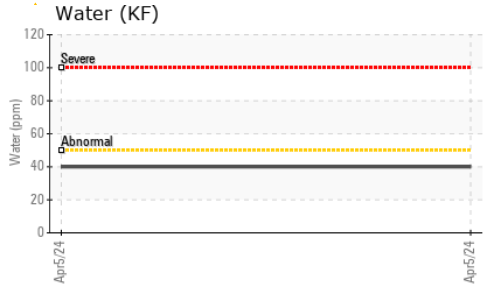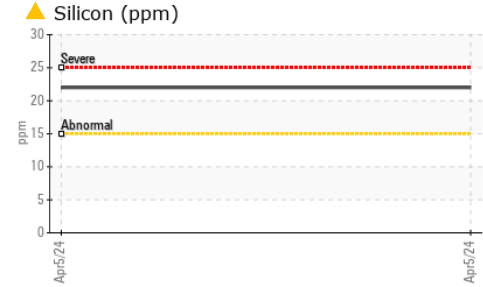





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.005	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	47.5	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color				no image	no image
Bottom				no image	no image

## GRAPHS

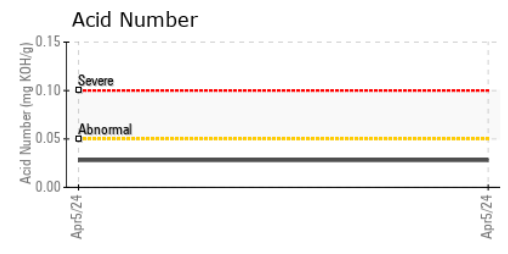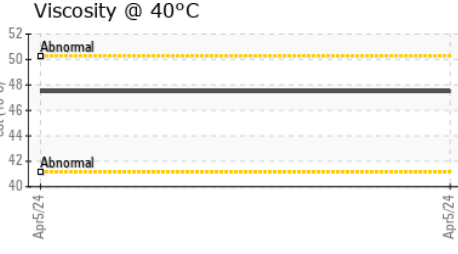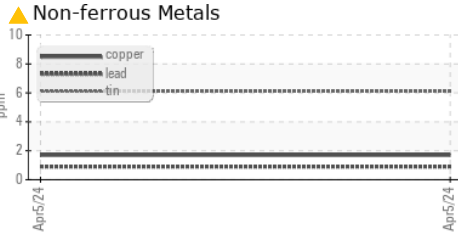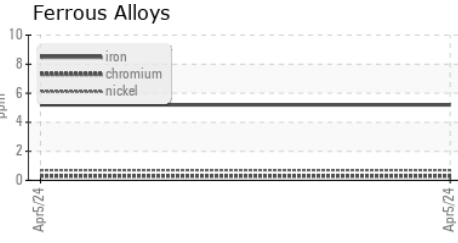

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0930542 **Received** : 25 Apr 2024  
**Lab Number** : 06160451 **Tested** : 26 Apr 2024  
**Unique Number** : 10995874 **Diagnosed** : 27 Apr 2024 - Don Baldrige  
**Test Package** : IND 2

**SCHNEIDER ELECTRIC**  
 PO DRAWER 185  
 MORRISVILLE, NC  
 US 27560  
 Contact: ERICH WEBBER  
 erich.webber@se.com  
 T: (919)274-4145  
 F: (919)467-7466

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)