

OIL ANALYSIS REPORT

Sample Rating Trend



QUINSYN PG QUINCY UTY307575

Component Compressor



Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the


Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		UAC06160478		
Sample Date		Client Info		24 Apr 2024		
Machine Age	hrs	Client Info		7331		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		Not Changd		
Sample Status				NORMAL		
CONTAMINATIO	N	method	limit/base	current	history1	history2
Water		WC Method	>0.1	NEG		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	4		
Chromium	ppm	ASTM D5185m	>10	<1		
Nickel	ppm	ASTM D5185m		3		
Titanium	ppm	ASTM D5185m		<1		
Silver	ppm	ASTM D5185m		0		
Aluminum	ppm	ASTM D5185m	>25	2		
Lead	ppm	ASTM D5185m	>25	1		
Copper	ppm	ASTM D5185m	>50	2		
Tin	ppm	ASTM D5185m	>15	<1		
Vanadium	ppm	ASTM D5185m		<1		
Cadmium	ppm	ASTM D5185m		<1		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m		430		
Molybdenum	ppm	ASTM D5185m		<1		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m		3		
Calcium	ppm	ASTM D5185m		13		
Phosphorus	ppm	ASTM D5185m		8		
Zinc	ppm	ASTM D5185m		48		
Sulfur	ppm	ASTM D5185m		485		
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	6		
Sodium	ppm	ASTM D5185m		115		
Potassium	ppm	ASTM D5185m	>20	9		
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.54		



OIL ANALYSIS REPORT

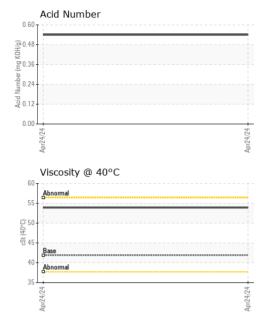

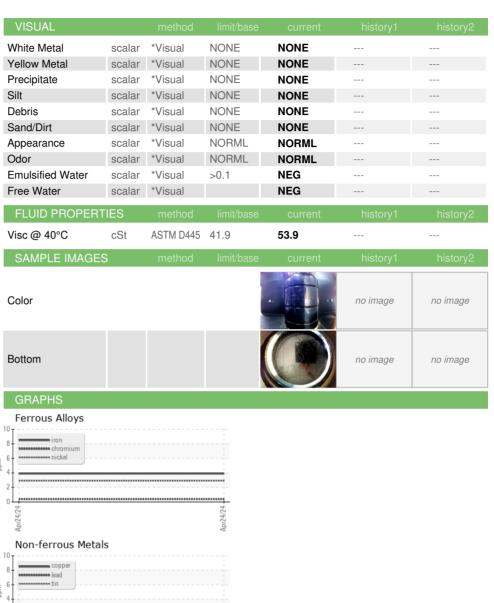





Certificate 12367

Laboratory Sample No.

Lab Number : 06160478

Test Package : IND 2

40

35

: UAC06160478 Unique Number : 10995901

Abnormal

Viscosity @ 40°C

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 25 Apr 2024

Tested : 26 Apr 2024

Diagnosed : 26 Apr 2024 - Sean Felton

Acid Number

등 0.48 E 0.36

은 0.24

0.12

0.00

US 30548 Contact: Derik Bray Derik@atlantaaircompressor.com

123 MERCHANTS PARK DR

HOSCHTON, GA

ATLANTA AIR COMPRESSOR

T: (470)252-9952 F: x:

To discuss this sample report, contact Customer Service at 1-800-237-1369. * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)