




OIL ANALYSIS REPORT

Sample Rating Trend

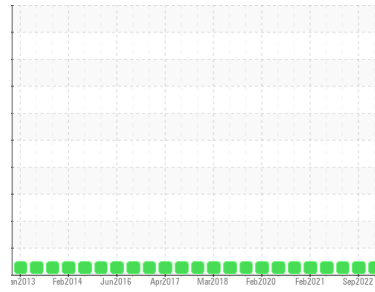

NORMAL



Area
AURORA PO 4010
 Machine Id
QUINCY UN119904 - ONDAL
 Component
Compressor

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

| | method | limit/base | current | history1 | history2 |
|---------------|-------------|-------------|--------------------|-------------|-------------|
| Sample Number | Client Info | | UCP06160494 | UCP05649394 | UCP05461453 |
| Sample Date | Client Info | | 04 Dec 2023 | 21 Sep 2022 | 26 Jan 2022 |
| Machine Age | hrs | Client Info | 23190 | 21211 | 19760 |
| Oil Age | hrs | Client Info | 2000 | 1000 | 0 |
| Oil Changed | Client Info | | Changed | Changed | N/A |
| Sample Status | | | NORMAL | NORMAL | NORMAL |

CONTAMINATION

| | method | limit/base | current | history1 | history2 |
|-------|-----------|------------|------------|----------|----------|
| Water | WC Method | >0.1 | NEG | NEG | NEG |

WEAR METALS

| | method | limit/base | current | history1 | history2 | |
|----------|--------|-------------|---------|--------------|----------|----|
| Iron | ppm | ASTM D5185m | >50 | <1 | 0 | <1 |
| Chromium | ppm | ASTM D5185m | >10 | <1 | 0 | 0 |
| Nickel | ppm | ASTM D5185m | | <1 | 0 | 0 |
| Titanium | ppm | ASTM D5185m | | <1 | 0 | 0 |
| Silver | ppm | ASTM D5185m | | 0 | 0 | 0 |
| Aluminum | ppm | ASTM D5185m | >25 | 2 | 0 | 0 |
| Lead | ppm | ASTM D5185m | >25 | <1 | 0 | 0 |
| Copper | ppm | ASTM D5185m | >50 | 1 | 0 | 0 |
| Tin | ppm | ASTM D5185m | >15 | <1 | <1 | <1 |
| Antimony | ppm | ASTM D5185m | | --- | --- | 0 |
| Vanadium | ppm | ASTM D5185m | | <1 | 0 | 0 |
| Cadmium | ppm | ASTM D5185m | | <1 | 0 | 0 |

ADDITIVES

| | method | limit/base | current | history1 | history2 | |
|------------|--------|-------------|---------|--------------|----------|-----|
| Boron | ppm | ASTM D5185m | 0 | 0 | 0 | 0 |
| Barium | ppm | ASTM D5185m | 0.4 | 6 | 0 | 0 |
| Molybdenum | ppm | ASTM D5185m | 0.5 | <1 | 0 | 0 |
| Manganese | ppm | ASTM D5185m | 0.4 | <1 | 0 | 0 |
| Magnesium | ppm | ASTM D5185m | 0 | <1 | 0 | 0 |
| Calcium | ppm | ASTM D5185m | 0.3 | 0 | 0 | 0 |
| Phosphorus | ppm | ASTM D5185m | 1376 | 793 | 780 | 834 |
| Zinc | ppm | ASTM D5185m | 0 | 3 | 0 | 0 |
| Sulfur | ppm | ASTM D5185m | 320 | 936 | 364 | 290 |



CONTAMINANTS

| | method | limit/base | current | history1 | history2 | |
|-----------|--------|-------------|---------|--------------|----------|----|
| Silicon | ppm | ASTM D5185m | >25 | <1 | <1 | <1 |
| Sodium | ppm | ASTM D5185m | | 2 | 0 | 0 |
| Potassium | ppm | ASTM D5185m | >20 | <1 | 0 | 0 |

FLUID DEGRADATION

| | method | limit/base | current | history1 | history2 | |
|------------------|----------|------------|---------|-------------|----------|------|
| Acid Number (AN) | mg KOH/g | ASTM D8045 | 0.573 | 0.48 | 0.30 | 0.22 |


OIL ANALYSIS REPORT

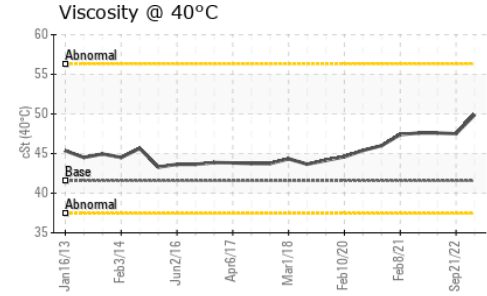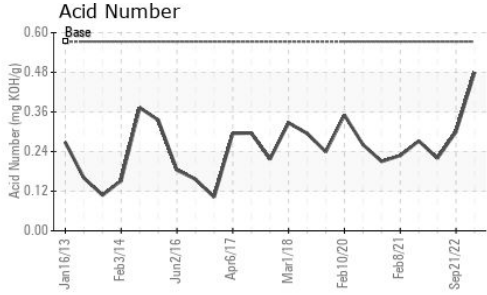





| VISUAL | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| White Metal | scalar | *Visual | NONE | NONE | NONE |
| Yellow Metal | scalar | *Visual | NONE | NONE | NONE |
| Precipitate | scalar | *Visual | NONE | NONE | NONE |
| Silt | scalar | *Visual | NONE | NONE | NONE |
| Debris | scalar | *Visual | NONE | NONE | NONE |
| Sand/Dirt | scalar | *Visual | NONE | NONE | NONE |
| Appearance | scalar | *Visual | NORML | NORML | NORML |
| Odor | scalar | *Visual | NORML | NORML | NORML |
| Emulsified Water | scalar | *Visual | >0.1 | NEG | NEG |
| Free Water | scalar | *Visual | | NEG | NEG |

| FLUID PROPERTIES | method | limit/base | current | history1 | history2 | |
|------------------|--------|------------|---------|-------------|----------|------|
| Visc @ 40°C | cSt | ASTM D445 | 41.57 | 49.9 | 47.5 | 47.6 |

| SAMPLE IMAGES | method | limit/base | current | history1 | history2 |
|---------------|--------|------------|---------|----------|----------|
|---------------|--------|------------|---------|----------|----------|

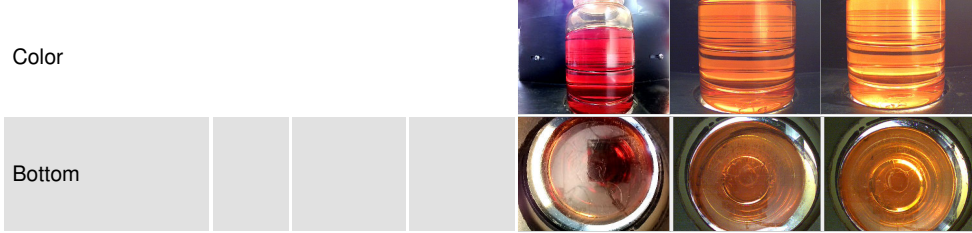

GRAPHS

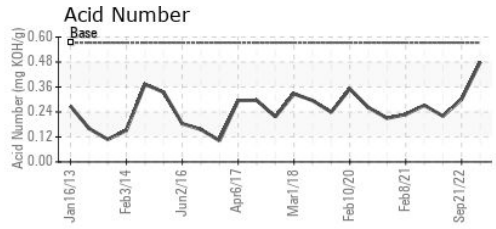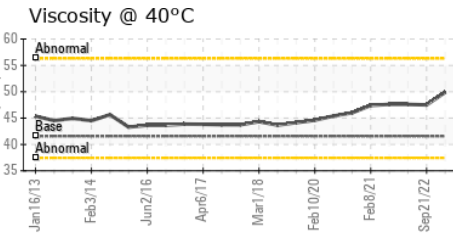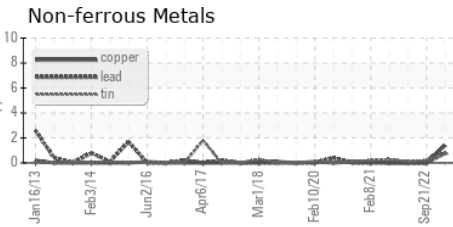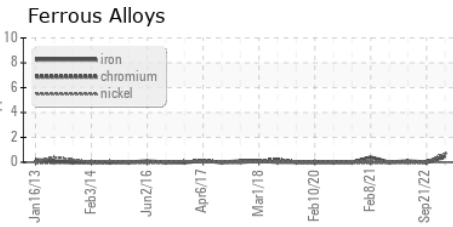

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : UCP06160494 **Received** : 25 Apr 2024
Lab Number : **06160494** **Tested** : 26 Apr 2024
Unique Number : 10995917 **Diagnosed** : 26 Apr 2024 - Sean Felton
Test Package : IND 2

PATTONS INC - RICHMOND
 10394 LAKERIDGE PARKWAY
 ASHLAND, VA
 US 23005
 Contact: AARON MCCOY
 AARON.MCCOY@PATTONSINC.COM

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012) F: (804)249-6831