




OIL ANALYSIS REPORT

Area
PO-6030
 Machine Id
SULLAIR 003-102107 - GEORGIA PACIFIC
 Component
Compressor

Sample Rating Trend

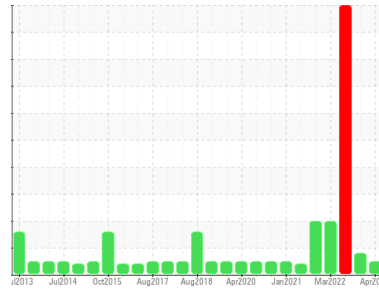

NORMAL



DIAGNOSIS

Recommendation

The oil change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		UCP06160497	UCP05753656	UCP05649398
Sample Date	Client Info		24 Apr 2024	25 Nov 2022	01 Jul 2022
Machine Age	hrs	Client Info	313782	226254	0
Oil Age	hrs	Client Info	300	0	8000
Oil Changed	Client Info		Changed	N/A	Changed
Sample Status			NORMAL	ABNORMAL	SEVERE

CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.1	NEG	NEG	NEG

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	2	<1	21
Chromium	ppm	ASTM D5185m >10	<1	0	<1
Nickel	ppm	ASTM D5185m	<1	<1	<1
Titanium	ppm	ASTM D5185m	<1	0	<1
Silver	ppm	ASTM D5185m	0	0	0
Aluminum	ppm	ASTM D5185m >25	2	0	6
Lead	ppm	ASTM D5185m >25	<1	<1	2
Copper	ppm	ASTM D5185m >50	4	<1	1
Tin	ppm	ASTM D5185m >15	<1	<1	3
Vanadium	ppm	ASTM D5185m	<1	0	0
Cadmium	ppm	ASTM D5185m	<1	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	0	0	12
Barium	ppm	ASTM D5185m 700	509	<1	38
Molybdenum	ppm	ASTM D5185m 0	<1	<1	1
Manganese	ppm	ASTM D5185m 0	<1	0	<1
Magnesium	ppm	ASTM D5185m 0	<1	2	15
Calcium	ppm	ASTM D5185m 0	0	0	66
Phosphorus	ppm	ASTM D5185m 0	2	30	63
Zinc	ppm	ASTM D5185m 0	6	0	129
Sulfur	ppm	ASTM D5185m 630	319	448	527



CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	3	<1	77
Sodium	ppm	ASTM D5185m	72	82	166
Potassium	ppm	ASTM D5185m >20	6	8	13

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.200	0.38	0.85	2.78


OIL ANALYSIS REPORT

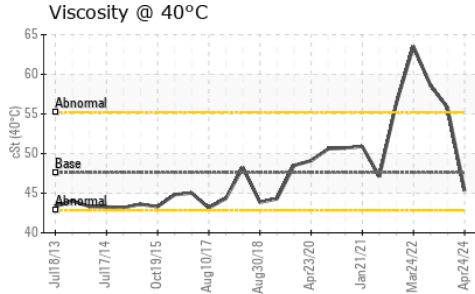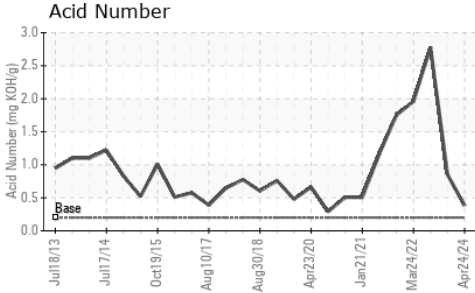





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	MODER	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	47.6	45.3	▲ 55.8 ▲ 58.6

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

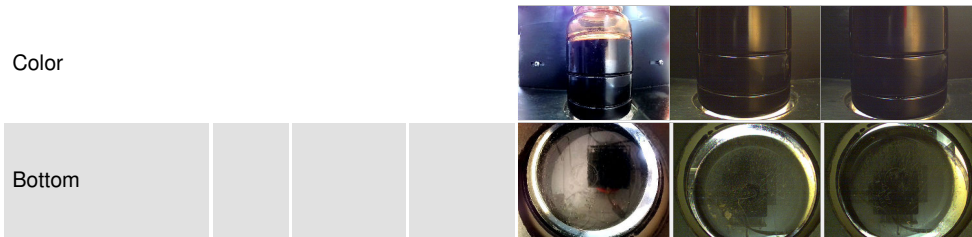

GRAPHS

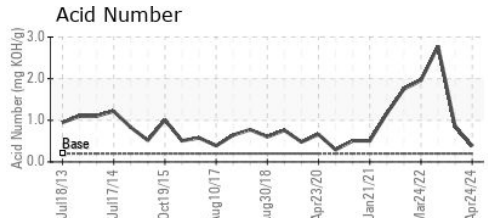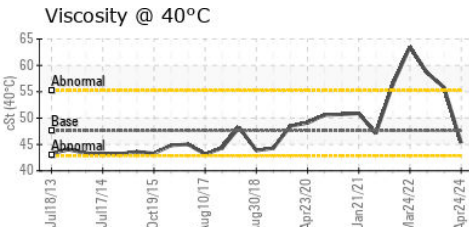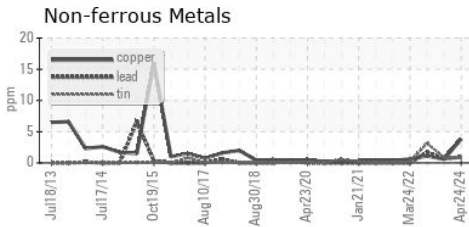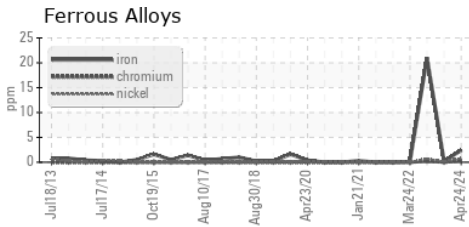

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : UCP06160497 **Received** : 25 Apr 2024
Lab Number : **06160497** **Tested** : 26 Apr 2024
Unique Number : 10995920 **Diagnosed** : 29 Apr 2024 - Sean Felton
Test Package : IND 2

PATTONS INC - RICHMOND
 10394 LAKERIDGE PARKWAY
 ASHLAND, VA
 US 23005
 Contact: AARON MCCOY
 AARON.MCCOY@PATTONSINC.COM

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: (804)249-6831