


OIL ANALYSIS REPORT

Area **S-460** [9229] **KAESER 1068 - AJ ANTUNES**

Component Compressor

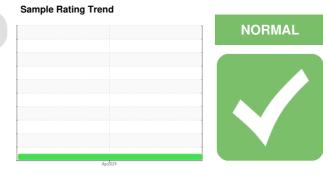

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.


Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

| SAMPLE INFORM | MATION | method | limit/base | current | history1 | history2 |
|------------------|----------|-------------|------------|-------------|----------|----------|
| Sample Number | | Client Info | | UDI06160504 | | |
| Sample Date | | Client Info | | 02 Apr 2024 | | |
| Machine Age | hrs | Client Info | | 40350 | | |
| Oil Age | hrs | Client Info | | 1308 | | |
| Oil Changed | | Client Info | | Changed | | |
| Sample Status | | | | NORMAL | | |
| CONTAMINATION | N | method | limit/base | current | history1 | history2 |
| Water | | WC Method | >0.05 | NEG | | |
| WEAR METALS | | method | limit/base | current | history1 | history2 |
| Iron | ppm | ASTM D5185m | >50 | <1 | | |
| Chromium | ppm | ASTM D5185m | >10 | <1 | | |
| Nickel | ppm | ASTM D5185m | >3 | <1 | | |
| Titanium | ppm | ASTM D5185m | >3 | <1 | | |
| Silver | ppm | ASTM D5185m | >2 | 0 | | |
| Aluminum | ppm | ASTM D5185m | >10 | 2 | | |
| Lead | ppm | ASTM D5185m | >10 | 6 | | |
| Copper | ppm | ASTM D5185m | >50 | <1 | | |
| Tin | ppm | ASTM D5185m | >10 | <1 | | |
| Vanadium | ppm | ASTM D5185m | | <1 | | |
| Cadmium | ppm | ASTM D5185m | | 2 | | |
| ADDITIVES | | method | limit/base | current | history1 | history2 |
| Boron | ppm | ASTM D5185m | | 0 | | |
| Barium | ppm | ASTM D5185m | 90 | 571 | | |
| Molybdenum | ppm | ASTM D5185m | | <1 | | |
| Manganese | ppm | ASTM D5185m | | <1 | | |
| Magnesium | ppm | ASTM D5185m | 90 | 3 | | |
| Calcium | ppm | ASTM D5185m | 2 | 5 | | |
| Phosphorus | ppm | ASTM D5185m | | 36 | | |
| Zinc | ppm | ASTM D5185m | | 0 | | |
| Sulfur | ppm | ASTM D5185m | | 1054 | | |
| CONTAMINANTS | ; | method | limit/base | current | history1 | history2 |
| Silicon | ppm | ASTM D5185m | >25 | 3 | | |
| Sodium | ppm | ASTM D5185m | | 12 | | |
| Potassium | ppm | ASTM D5185m | >20 | 1 | | |
| FLUID DEGRADA | ATION | method | limit/base | current | history1 | history2 |
| Acid Number (AN) | mg KOH/g | ASTM D8045 | 0.4 | 0.125 | | |





OIL ANALYSIS REPORT

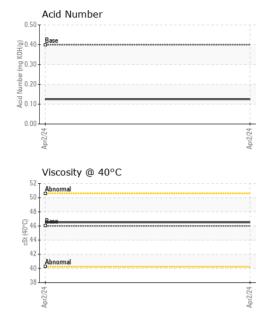


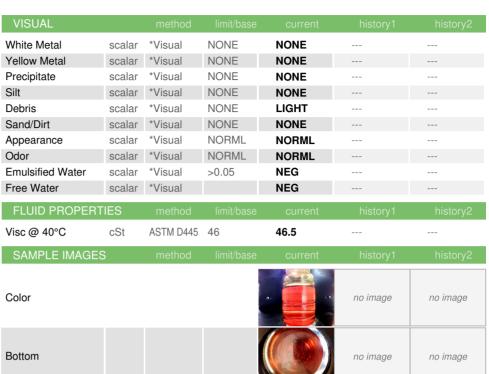


GRAPHS













Certificate 12367

Laboratory Sample No.

Lab Number : 06160504

: UDI06160504 Unique Number : 10995927 Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 25 Apr 2024

Tested : 26 Apr 2024 Diagnosed : 26 Apr 2024 - Sean Felton

DELTA INDUSTRIES - DOWNERS GROVE

2201 CURTISS STREET DOWNERS GROVE, IL US 60515

Contact: MICHAEL FERRIS

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: (630)960-3931