


# **OIL ANALYSIS REPORT**

Area **\$-460** [9238]

# **KAESER 1044 - WISE PLASTICS TECH**

Component Compressor



## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

			May2021	Mar2024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		UDI06160508	UCH05264493	
Sample Date		Client Info		29 Mar 2024	17 May 2021	
Machine Age	hrs	Client Info		0	16694	
Oil Age	hrs	Client Info		0	7804	
Oil Changed		Client Info		Changed	Changed	
Sample Status				NORMAL	NORMAL	
CONTAMINATION	V	method	limit/base	current	history1	history2
Water		WC Method	>0.05	NEG	NEG	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	0	
Chromium	ppm	ASTM D5185m	>10	<1	0	
Nickel	ppm	ASTM D5185m	>3	<1	0	
Titanium	ppm	ASTM D5185m	>3	<1	0	
Silver	ppm	ASTM D5185m	>2	0	<1	
Aluminum	ppm	ASTM D5185m	>10	2	<1	
Lead	ppm	ASTM D5185m	>10	<1	<1	
Copper	ppm	ASTM D5185m	>50	5	11	
Tin	ppm	ASTM D5185m	>10	<1	<1	
Antimony	ppm	ASTM D5185m			0	
Vanadium	ppm	ASTM D5185m		<1	0	
Cadmium	ppm	ASTM D5185m		<1	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	1	
Barium	ppm	ASTM D5185m	90	0	<1	
Molybdenum	ppm	ASTM D5185m		<1	0	
Manganese	ppm	ASTM D5185m		<1	0	
Magnesium	ppm	ASTM D5185m	90	19	6	
Calcium	ppm	ASTM D5185m	2	0	0	
Phosphorus	ppm	ASTM D5185m		<1	3	
Zinc	ppm	ASTM D5185m		15	0	
Sulfur	ppm	ASTM D5185m		21960	13662	
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	14	18	
Sodium	ppm	ASTM D5185m		6	2	
Potassium	ppm	ASTM D5185m	>20	2	<1	
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2
	1/011/	4 OTM   DOG 45	0.4		0.074	

Acid Number (AN)


mg KOH/g ASTM D8045 0.4

0.371


0.38





# **OIL ANALYSIS REPORT**

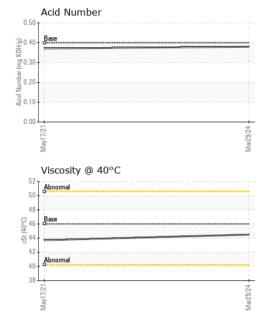

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	MODER	
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	
Precipitate	scalar	*Visual	NONE	NONE	NONE	
Silt	scalar	*Visual	NONE	NONE	NONE	
Debris	scalar	*Visual	NONE	NONE	NONE	
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	
Appearance	scalar	*Visual	NORML	NORML	NORML	
Odor	scalar	*Visual	NORML	NORML	NORML	
<b>Emulsified Water</b>	scalar	*Visual	>0.05	NEG	NEG	
Free Water	scalar	*Visual		NEG	NEG	
FLUID PROPERTIES		method	limit/base	current	history1	history2
\"						
Visc @ 40°C	cSt	ASTM D445	46	44.5	43.7	
Visc @ 40°C  SAMPLE IMAGES		ASTM D445 method	46 limit/base	44.5 current	43.7 history1	history2
						history2 no image
SAMPLE IMAGES				current		
SAMPLE IMAGES Color				current		no image











Laboratory Sample No.

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Lab Number : 06160508

: UDI06160508 Unique Number : 10995931

Received : 25 Apr 2024 **Tested** 

: 26 Apr 2024 Diagnosed : 26 Apr 2024 - Sean Felton

**DELTA INDUSTRIES - DOWNERS GROVE** 

2201 CURTISS STREET DOWNERS GROVE, IL US 60515 Contact: DARRELL WHITLEDGE

Test Package : IND 2 Certificate 12367 To discuss this sample report, contact Customer Service at 1-800-237-1369.

darrellwhitledge@deltaind.net T: (630)960-3900

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: (630)960-3931 Contact/Location: DARRELL WHITLEDGE - UCDELDOW