


OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL



WHEY Machine to PO01PP02BB01

Bearing

MOBIL SHC 626 (--- QTS)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The condition of the oil is acceptable for the time in service.

SAMPLE INFORMA	ATION	method	limit/base	current	history1	history2
	THON		— IIIIII/Dase			,
Sample Number		Client Info		WC0927478	WC0864105	WC04841707
Sample Date		Client Info		17 Apr 2024	24 Oct 2023	20 Oct 2019
	nrs	Client Info		0	0	0
- 9-	nrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				NORMAL	NORMAL	NORMAL
CONTAMINATION		method	limit/base	current	history1	history2
Water		WC Method	>2	NEG	NEG	NEG
WEAR METALS		method	limit/base	current	history1	history2
lron p	opm	ASTM D5185m	>20	2	0	<1
Chromium p	opm	ASTM D5185m	>20	0	0	0
Nickel	opm	ASTM D5185m	>20	0	0	0
Titanium p	opm	ASTM D5185m		0	0	0
Silver	opm	ASTM D5185m		0	0	0
Aluminum p	opm	ASTM D5185m	>20	0	0	0
Lead	opm	ASTM D5185m	>20	0	0	0
Copper	opm	ASTM D5185m	>20	6	1	1
Tin p	opm	ASTM D5185m	>20	0	0	0
Antimony p	opm	ASTM D5185m				0
Vanadium p	opm	ASTM D5185m		0	0	0
Cadmium p	opm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron p	opm	ASTM D5185m		0	0	2
Barium p	opm	ASTM D5185m		0	<1	0
Molybdenum p	opm	ASTM D5185m		0	0	0
Manganese p	opm	ASTM D5185m		<1	0	<1
Magnesium p	opm	ASTM D5185m		0	0	0
Calcium	opm	ASTM D5185m		0	2	0
Phosphorus p	opm	ASTM D5185m		484	437	418
Zinc	opm	ASTM D5185m		0	2	<1
Sulfur p	opm	ASTM D5185m		114	92	103
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon p	opm	ASTM D5185m	>15	<1	0	<1
Sodium	opm	ASTM D5185m		0	0	<1
Potassium p	opm	ASTM D5185m	>20	<1	0	1
VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
	scalar	*Visual	NONE	NONE	NONE	NONE
	scalar	*Visual	NONE	NONE	NONE	NONE
	scalar	*Visual	NONE	NONE	NONE	LIGHT
	scalar	*Visual	NONE	NONE	NONE	NONE
	scalar	*Visual	NORML	NORML	NORML	NORML
L-1						

NORML

>2

scalar *Visual

scalar *Visual

*Visual

scalar

NORML

NEG

NEG

NORML

0.2%

Odor

Emulsified Water


NORML

NEG


ed ByHAICHAEL VILLASENOR



OIL ANALYSIS REPORT





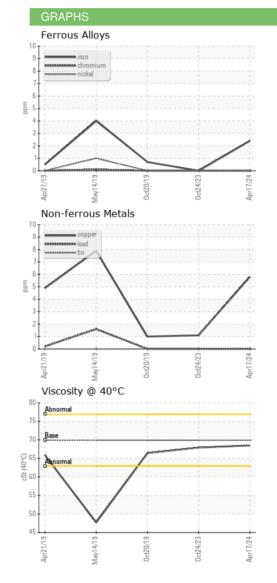





Certificate 12367

Laboratory Test Package : IND 1

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Sample No. : WC0927478 Lab Number : 06160871 Unique Number : 10996294

Received : 25 Apr 2024 Tested Diagnosed

: 26 Apr 2024 : 29 Apr 2024 - Don Baldridge **LEPRINO FOODS-GREELEY** 1302 1ST AVE GREELEY, CO US 80631-5909 Contact: ERIC KLINE

EKLINE@LEPRINOFOODS.COM

To discuss this sample report, contact Customer Service at 1-800-237-1369. * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

F: (970)347-5190 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)