


## **OIL ANALYSIS REPORT**

Sample Rating Trend

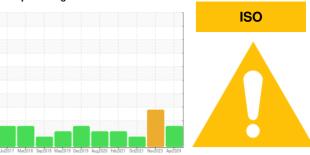

Machine Id

# KAESER ASD30 2423632 (S/N 1171)

Compressor

KAESER SIGMA (OEM) FG-460 (--- GAL)

#### **DIAGNOSIS**

#### Recommendation

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is a high amount of particulates present in the oil.


#### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Jul2017 Mar2	018 Sep2018 May2019 Dec20	019 Aug2020 Feb2021 Oct2021 Nov2	023 Apr2024	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA016608	KCPA011300	KCP36595
Sample Date		Client Info		17 Apr 2024	15 Nov 2023	18 Oct 2021
Machine Age	hrs	Client Info		1542	97741	91150
Oil Age	hrs	Client Info		0	0	3001
Oil Changed		Client Info		Changed	N/A	N/A
Sample Status				ABNORMAL	ABNORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	4	8	6
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	1	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	10	8	4
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	3	2	2
Tin	ppm	ASTM D5185m	>10	0	<1	0
Antimony	ppm	ASTM D5185m				0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	<1
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		<1	<1	<1
Magnesium	ppm	ASTM D5185m		<1	2	0
Calcium	ppm	ASTM D5185m		1	2	0
Phosphorus	ppm	ASTM D5185m	500	431	507	450
Zinc	ppm	ASTM D5185m		224	292	313
Sulfur	ppm	ASTM D5185m		1897	1617	1416
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	<1	0
Sodium	ppm	ASTM D5185m		2	1	0
Potassium	ppm	ASTM D5185m	>20	2	2	0
Water	%	ASTM D6304	>0.05	0.004	△ 0.086	0.007
ppm Water	ppm	ASTM D6304	>500	41	<u>▲</u> 860	77.3
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4μm		ASTM D7647		7338	24248	3276
Particles >6µm		ASTM D7647	>1300	<u> </u>	<u>4288</u>	1158
Particles >14μm		ASTM D7647	>80	<u> </u>	157	<u> </u>
Particles >21µm		ASTM D7647	>20	<u></u> 50	28	<u></u> 54
Particles >38μm		ASTM D7647	>4	2	3	1
Particles >71μm		ASTM D7647	>3	0	1	0
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u>^</u> 20/18/15	<u>22/19/14</u>	<b>△</b> 17/15
FLUID DEGRADA	TION	method	limit/base	current	history1	history2



### **OIL ANALYSIS REPORT**

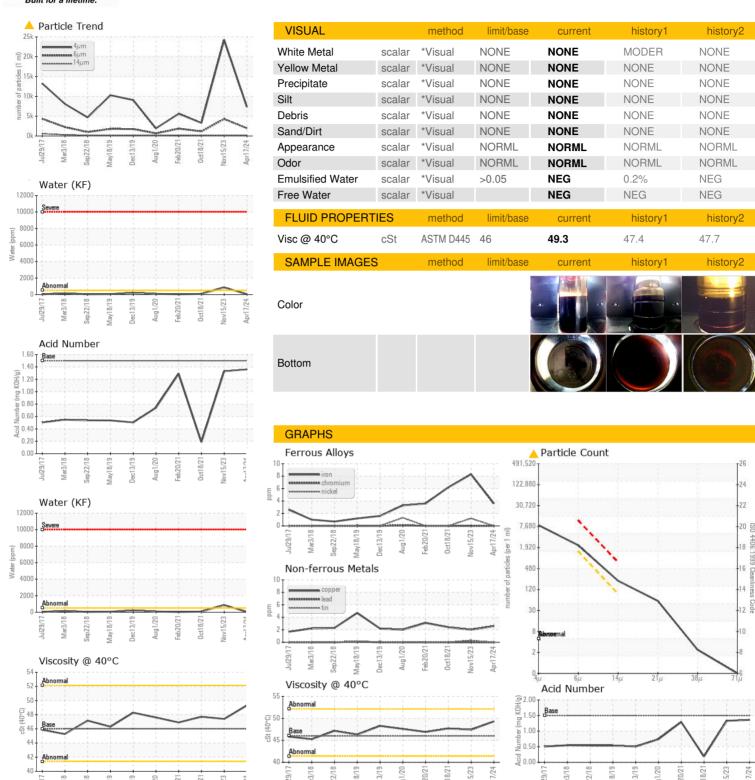





Certificate 12367

Laboratory Sample No.

Lab Number

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 : KCPA016608 : 06160939 Unique Number : 10996362

Received **Tested** 

Diagnosed

: 26 Apr 2024 : 29 Apr 2024 - Don Baldridge

: 25 Apr 2024

Test Package : IND 2 ( Additional Tests: KF, PrtCount ) To discuss this sample report, contact Customer Service at 1-800-237-1369.

 $^st$  - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

HIAWATHA, KS US 66434

**CROSSWIND IND** 

812 S 12TH ST

Contact: EDWIN WEHNEN edwin.wehnen@adm.com

F: Contact/Location: EDWIN WEHNEN - CROHIA

T: