


## **OIL ANALYSIS REPORT**

Sample Rating Trend

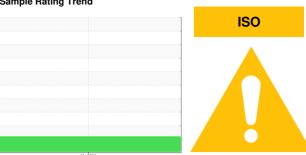

Machine Id

# KAESER SK 15 8594434 (S/N 1967)

Component Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

### **DIAGNOSIS**

#### Recommendation

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

## Contamination

There is a high amount of particulates present in the oil.

#### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		,		Mar2024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA015665		
Sample Number		Client Info		08 Mar 2024		
Machine Age	hrs	Client Info		969		
Oil Age	hrs	Client Info		0		
Oil Changed	1113	Client Info		Changed		
Sample Status		Ciletit IIIIO		ABNORMAL		
Sample Status				ABNORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	<1		
Lead	ppm	ASTM D5185m	>10	0		
Copper	ppm	ASTM D5185m	>50	<1		
Tin	ppm	ASTM D5185m	>10	<1		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0		
Barium	ppm	ASTM D5185m	90	5		
Molybdenum	ppm	ASTM D5185m	0	0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m	100	68		
Calcium	ppm	ASTM D5185m	0	<1		
Phosphorus	ppm	ASTM D5185m	0	3		
Zinc	ppm	ASTM D5185m	0	2		
Sulfur	ppm	ASTM D5185m	23500	23964		
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1		
Sodium	ppm	ASTM D5185m		10		
Potassium	ppm	ASTM D5185m	>20	9		
Water	%	ASTM D6304	>0.05	0.025		
ppm Water	ppm	ASTM D6304	>500	252		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		29198		
Particles >6µm		ASTM D7647	>1300	<u> </u>		
Particles >14µm		ASTM D7647	>80	<b>487</b>		
Particles >21µm		ASTM D7647	>20	17		
Particles >38µm		ASTM D7647	>4	0		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u>22/21/16</u>		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
	1/011/	1071100015	4.0	0.40		


Acid Number (AN)

mg KOH/g ASTM D8045 1.0

0.40



# **OIL ANALYSIS REPORT**

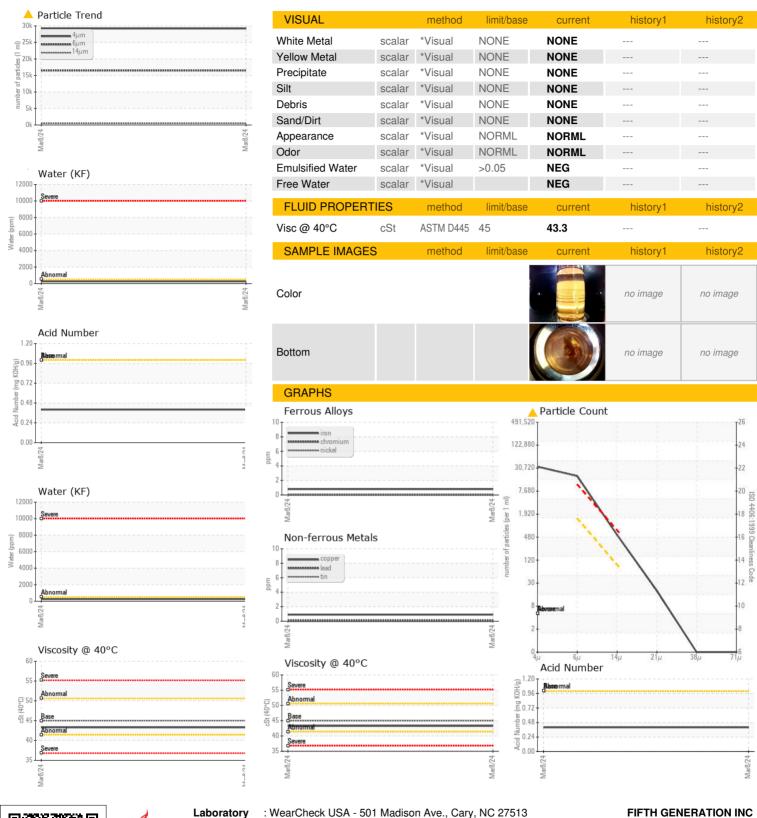



Certificate 12367

Laboratory Sample No.

: KCPA015665 Lab Number : 06160940 Unique Number : 10996363

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 25 Apr 2024 **Tested** : 26 Apr 2024 : 29 Apr 2024 - Don Baldridge

Diagnosed Test Package : IND 2 ( Additional Tests: KF, PrtCount )

To discuss this sample report, contact Customer Service at 1-800-237-1369.

 $^st$  - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

12101 MOORE RD AUSTIN, TX US 78719

Contact: Service Manager

T: F: