




# OIL ANALYSIS REPORT

Sample Rating Trend

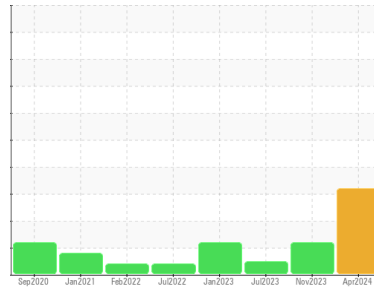

**WATER**



Machine Id

**KAESER 7069146**

Component

**Compressor**

Fluid

**KAESER SIGMA (OEM) M-460 (--- GAL)**

**DIAGNOSIS**

**Recommendation**

The filter change at the time of sampling has been noted. We advise that you stop the unit and follow the water drain-off procedure for this component. We recommend an early resample in 500 hours to monitor this condition.

**Wear**

All component wear rates are normal.

**Contamination**

There is a moderate amount of particulates present in the oil. There is a light concentration of water present in the oil.

**Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

**SAMPLE INFORMATION**

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>KCPA012764</b>	KCPA007075	KC95942
Sample Date	Client Info		<b>22 Apr 2024</b>	16 Nov 2023	11 Jul 2023
Machine Age	hrs	Client Info	<b>34344</b>	30751	0
Oil Age	hrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>Not Chngd</b>	N/A	N/A
Sample Status			<b>ABNORMAL</b>	ATTENTION	NORMAL

**WEAR METALS**

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>0</b>	0	0
Chromium	ppm	ASTM D5185m >10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m >3	<b>0</b>	<1	0
Titanium	ppm	ASTM D5185m >3	<b>0</b>	<1	0
Silver	ppm	ASTM D5185m >2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >10	<b>0</b>	2	0
Lead	ppm	ASTM D5185m >10	<b>0</b>	<1	0
Copper	ppm	ASTM D5185m >50	<b>13</b>	7	6
Tin	ppm	ASTM D5185m >10	<b>&lt;1</b>	<1	<1
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	<1
Cadmium	ppm	ASTM D5185m	<b>0</b>	<1	0

**ADDITIVES**

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	<b>0</b>	0	0
Barium	ppm	ASTM D5185m 90	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m 0	<b>0</b>	<1	0
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	<1	0
Magnesium	ppm	ASTM D5185m 100	<b>0</b>	1	2
Calcium	ppm	ASTM D5185m 0	<b>0</b>	<1	0
Phosphorus	ppm	ASTM D5185m 0	<b>0</b>	0	<1
Zinc	ppm	ASTM D5185m 0	<b>0</b>	0	0
Sulfur	ppm	ASTM D5185m 23500	<b>20311</b>	16994	17049

**CONTAMINANTS**

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>&lt;1</b>	<1	<1
Sodium	ppm	ASTM D5185m	<b>1</b>	0	0
Potassium	ppm	ASTM D5185m >20	<b>2</b>	1	0
Water	%	ASTM D6304 >0.05	<b>▲ 0.300</b>	0.008	0.006
ppm Water	ppm	ASTM D6304 >500	<b>▲ 3000</b>	88	63.7






**FLUID CLEANLINESS**

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		<b>1548</b>	5503	2083
Particles >6µm	ASTM D7647 >1300		<b>844</b>	● 1934	591
Particles >14µm	ASTM D7647 >80		● <b>144</b>	● 85	45
Particles >21µm	ASTM D7647 >20		● <b>48</b>	17	10
Particles >38µm	ASTM D7647 >4		● <b>7</b>	0	0
Particles >71µm	ASTM D7647 >3		● <b>1</b>	0	0
Oil Cleanliness	ISO 4406 (c)	>--/17/13	● <b>18/17/14</b>	● 20/18/14	18/16/13

**FLUID DEGRADATION**

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 1.0	<b>0.41</b>	0.39	0.37

# OIL ANALYSIS REPORT

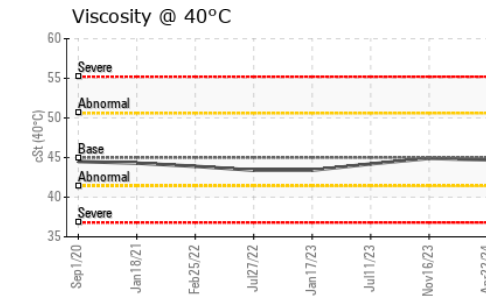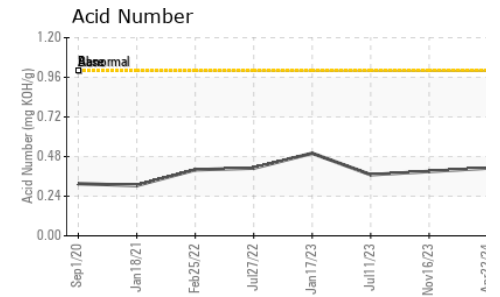
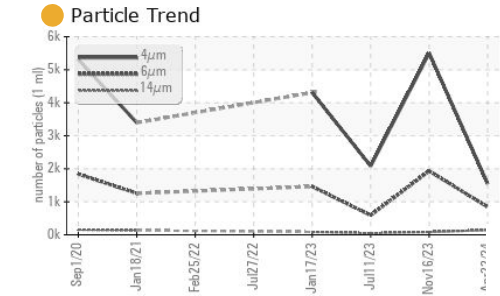
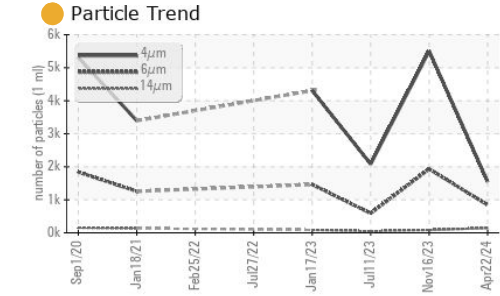
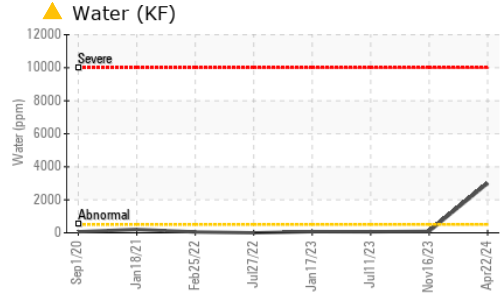


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	0.2%	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	44.7	44.9

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

## GRAPHS

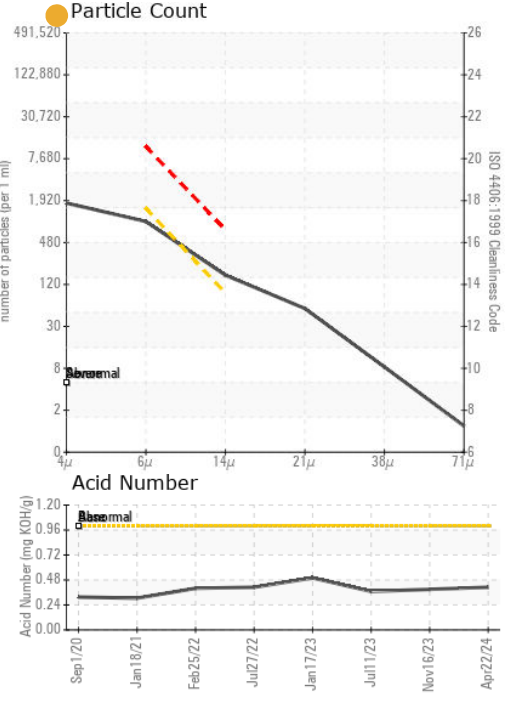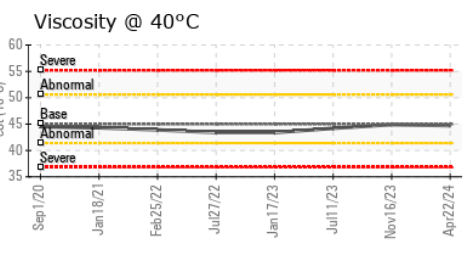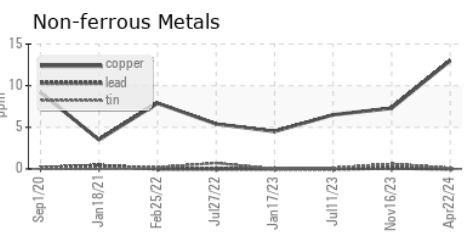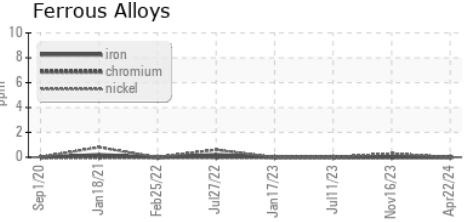

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCPA012764 **Received** : 25 Apr 2024  
**Lab Number** : 06160949 **Tested** : 01 May 2024  
**Unique Number** : 10996372 **Diagnosed** : 01 May 2024 - Jonathan Hester  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**NASA**  
 MAIL STOP 204-15  
 MOFFETT FIELD, CA  
 US 94035  
 Contact: MICHEAL NINOKATA  
 micheal.d.ninokata@nasa.gov  
 T:  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)