




# OIL ANALYSIS REPORT

Sample Rating Trend

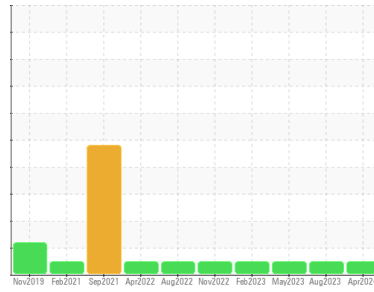

Machine Id  
**6933359 (S/N 1353)**  
 Component  
**Compressor**  
 Fluid  
**KAESER SIGMA (OEM) S-460 (--- GAL)**

## DIAGNOSIS

**Recommendation**  
 Resample at the next service interval to monitor.

**Wear**  
 All component wear rates are normal.

**Contamination**  
 There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

**Fluid Condition**  
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>KC128319</b>	KC105887	KC110771
Sample Date	Client Info		<b>17 Apr 2024</b>	17 Aug 2023	12 May 2023
Machine Age	hrs	Client Info	<b>41492</b>	35675	33349
Oil Age	hrs	Client Info	<b>5816</b>	9414	7089
Oil Changed	Client Info		<b>Not Changed</b>	Changed	Not Changed
Sample Status			<b>NORMAL</b>	NORMAL	NORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>0</b>	0	0
Chromium	ppm	ASTM D5185m >10	<b>0</b>	0	<1
Nickel	ppm	ASTM D5185m >3	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m >3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m >2	<b>0</b>	0	<1
Aluminum	ppm	ASTM D5185m >10	<b>0</b>	0	<1
Lead	ppm	ASTM D5185m >10	<b>0</b>	0	<1
Copper	ppm	ASTM D5185m >50	<b>7</b>	2	4
Tin	ppm	ASTM D5185m >10	<b>0</b>	0	<1
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	0	0
Barium	ppm	ASTM D5185m 90	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0	<1
Manganese	ppm	ASTM D5185m	<b>0</b>	0	<1
Magnesium	ppm	ASTM D5185m 90	<b>0</b>	<1	12
Calcium	ppm	ASTM D5185m 2	<b>0</b>	0	0
Phosphorus	ppm	ASTM D5185m	<b>&lt;1</b>	<1	0
Zinc	ppm	ASTM D5185m	<b>0</b>	4	4

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>0</b>	<1	<1
Sodium	ppm	ASTM D5185m	<b>0</b>	<1	1
Potassium	ppm	ASTM D5185m >20	<b>&lt;1</b>	2	<1
Water	%	ASTM D6304 >0.05	<b>0.005</b>	0.006	0.007
ppm Water	ppm	ASTM D6304 >500	<b>59</b>	61.4	72.8






## FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		<b>968</b>	235	168
Particles >6µm	ASTM D7647 >1300		<b>345</b>	110	60
Particles >14µm	ASTM D7647 >80		<b>35</b>	22	10
Particles >21µm	ASTM D7647 >20		<b>7</b>	8	4
Particles >38µm	ASTM D7647 >4		<b>0</b>	1	0
Particles >71µm	ASTM D7647 >3		<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c)	>--/17/13	<b>17/16/12</b>	15/14/12	15/13/10

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	<b>0.29</b>	0.32	0.36


# OIL ANALYSIS REPORT

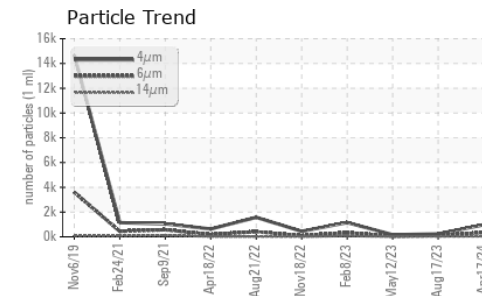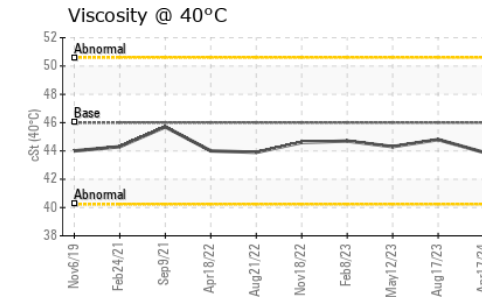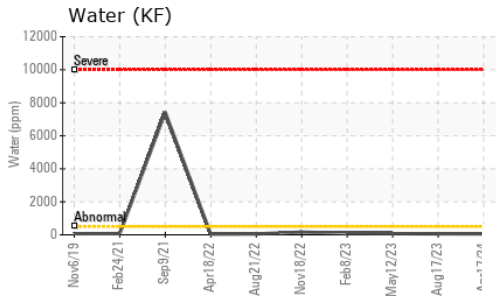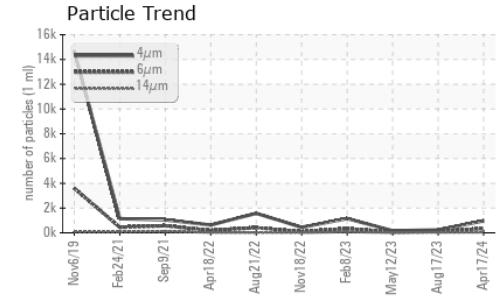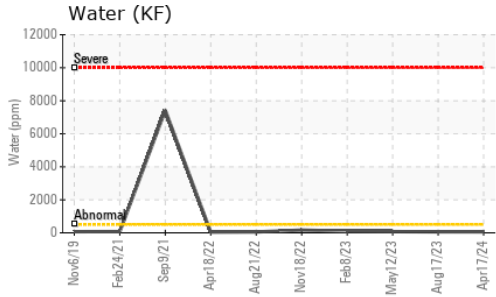






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	43.9	44.8	44.3

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

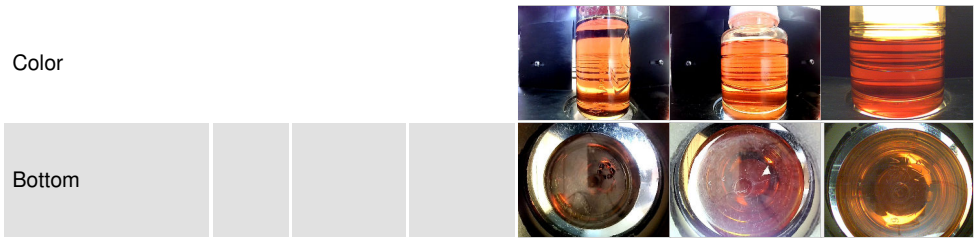

## GRAPHS

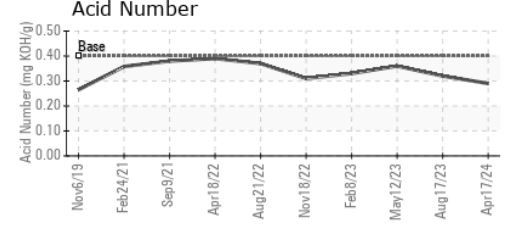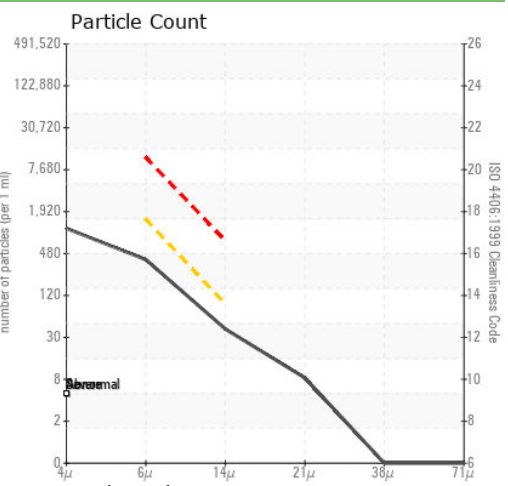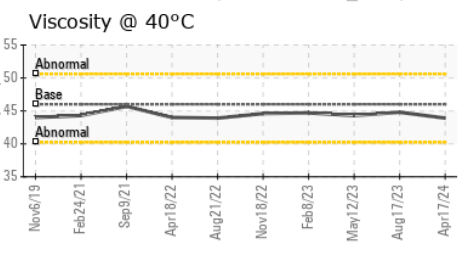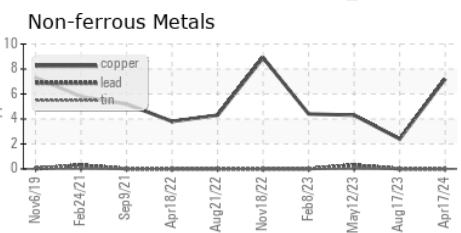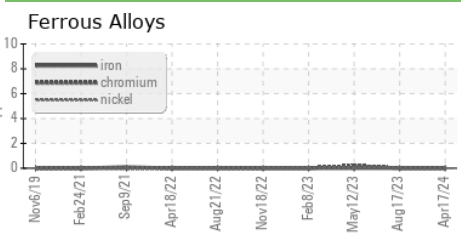

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KC128319  
**Lab Number** : 06160955  
**Unique Number** : 10996378  
**Test Package** : IND 2  
**Received** : 25 Apr 2024  
**Tested** : 26 Apr 2024  
**Diagnosed** : 29 Apr 2024 - Don Baldrige

**MEOPTA USA INC**  
 7826 PHOTONICS DR  
 TRINITY, FL  
 US 34655  
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)