


# **OIL ANALYSIS REPORT**

Sample Rating Trend

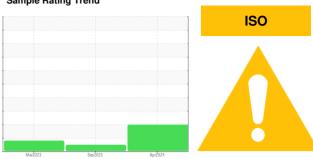

Machine Id

# **KAESER 8576276**

Component Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

### **DIAGNOSIS**

#### Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

### Contamination

There is a high amount of particulates present in the oil.


#### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Mar <sup>2</sup> 023 Sag <sup>2</sup> 023 Αφ <sup>2</sup> 024						
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC128429	KC106491	KC101078
Sample Date		Client Info		11 Apr 2024	01 Sep 2023	20 Mar 2023
Machine Age	hrs	Client Info		3930	2656	1710
Oil Age	hrs	Client Info		1320	946	1710
Oil Changed		Client Info		Not Changd	Changed	Changed
Sample Status				ABNORMAL	NORMAL	ATTENTION
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	0
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	<1
Aluminum	ppm	ASTM D5185m	>10	0	3	0
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	2	3	6
Tin	ppm	ASTM D5185m	>10	0	0	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m	90	5	0	9
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	0	<1
Magnesium	ppm	ASTM D5185m	90	49	53	38
Calcium	ppm	ASTM D5185m	2	1	<1	2
Phosphorus	ppm	ASTM D5185m		0	<1	3
Zinc	ppm	ASTM D5185m		6	3	7
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	<1	<1
Sodium	ppm	ASTM D5185m		15	13	11
Potassium	ppm	ASTM D5185m	>20	4	7	11
Water	%	ASTM D6304	>0.05	0.024	0.025	0.012
ppm Water	ppm	ASTM D6304	>500	240	255.9	120.5
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		5102	973	4288
Particles >6µm		ASTM D7647	>1300	<u> </u>	346	1431
Particles >14μm		ASTM D7647	>80	<u> </u>	35	64
Particles >21µm		ASTM D7647	>20	<b>△</b> 68	11	9
Particles >38μm		ASTM D7647	>4	<u>^</u> 7	1	1
Particles >71µm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u>^</u> 20/18/15	16/12	18/13
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.32	0.29	0.27



## **OIL ANALYSIS REPORT**

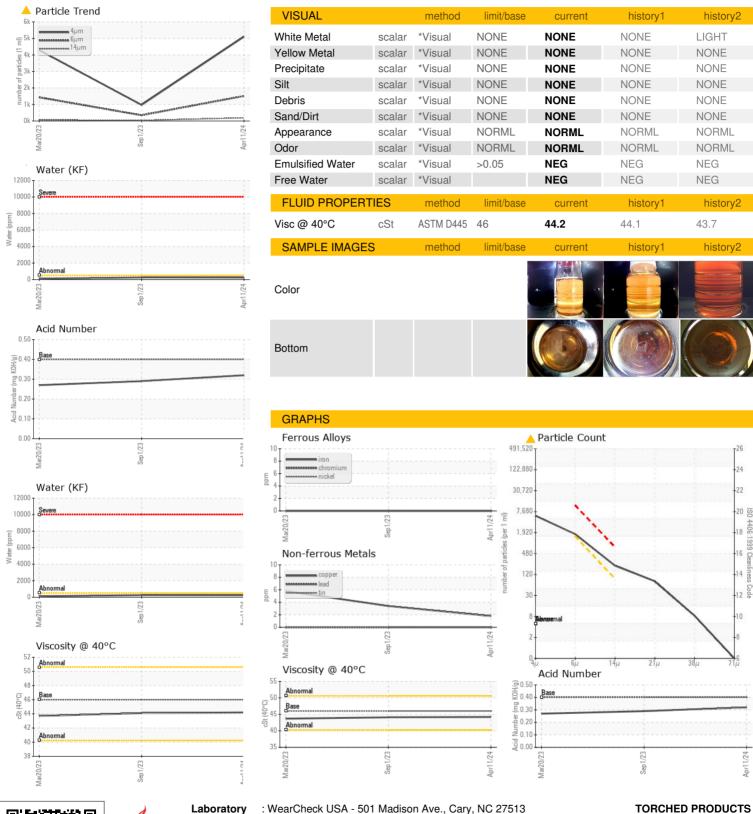





Certificate 12367

Laboratory

Sample No. Lab Number

: KC128429 : 06160958

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 25 Apr 2024 **Tested** : 26 Apr 2024

Diagnosed Unique Number : 10996381 : 29 Apr 2024 - Don Baldridge Test Package : IND 2

To discuss this sample report, contact Customer Service at 1-800-237-1369.

 $^st$  - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

217 HOBBS ST

Contact: Service Manager

TAMPA, FL

US 33619

T:

F: