




OIL ANALYSIS REPORT

Sample Rating Trend

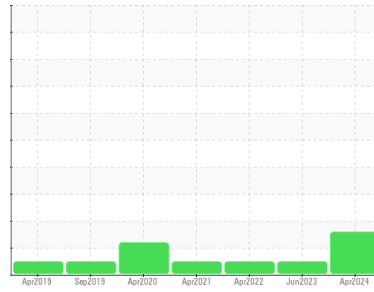

ISO



Machine Id
KAESER DSD 250 6343276 (S/N 1072)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	KCPA012711	KCPA005010	KCP45007
Sample Date	Client Info	18 Apr 2024	26 Jun 2023	22 Apr 2022
Machine Age	hrs	26043	21826	17039
Oil Age	hrs	4267	0	5633
Oil Changed	Client Info	Not Chngd	N/A	Not Chngd
Sample Status		ABNORMAL	NORMAL	NORMAL

WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >50	0	0	0
Chromium	ppm	ASTM D5185m >10	0	0	0
Nickel	ppm	ASTM D5185m >3	0	<1	0
Titanium	ppm	ASTM D5185m >3	0	0	0
Silver	ppm	ASTM D5185m >2	0	<1	<1
Aluminum	ppm	ASTM D5185m >10	<1	0	0
Lead	ppm	ASTM D5185m >10	0	0	0
Copper	ppm	ASTM D5185m >50	6	7	4
Tin	ppm	ASTM D5185m >10	0	0	0
Antimony	ppm	ASTM D5185m	---	---	---
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	0	0	<1
Barium	ppm	ASTM D5185m 90	3	0	0
Molybdenum	ppm	ASTM D5185m	0	0	0
Manganese	ppm	ASTM D5185m	0	0	0
Magnesium	ppm	ASTM D5185m 90	33	0	0
Calcium	ppm	ASTM D5185m 2	<1	0	2
Phosphorus	ppm	ASTM D5185m	<1	3	0
Zinc	ppm	ASTM D5185m	11	0	0
Sulfur	ppm	ASTM D5185m	22376	15191	14249

CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >25	2	0	<1
Sodium	ppm	ASTM D5185m	8	0	<1
Potassium	ppm	ASTM D5185m >20	10	2	0
Water	%	ASTM D6304 >0.05	0.013	0.006	0.006
ppm Water	ppm	ASTM D6304 >500	138	67.1	67.8

FLUID CLEANLINESS


method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	13502	1820	1451
Particles >6µm	ASTM D7647 >1300	▲ 3570	329	387
Particles >14µm	ASTM D7647 >80	▲ 179	4	29
Particles >21µm	ASTM D7647 >20	▲ 31	1	13
Particles >38µm	ASTM D7647 >4	1	0	3
Particles >71µm	ASTM D7647 >3	0	0	1
Oil Cleanliness	ISO 4406 (c) >--/17/13	▲ 21/19/15	18/16/9	18/16/12

FLUID DEGRADATION


method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	0.38	0.50	0.53

OIL ANALYSIS REPORT


▲ Particle Trend

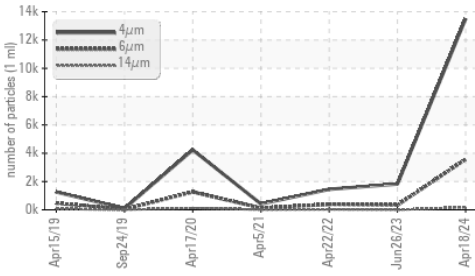


Water (KF)

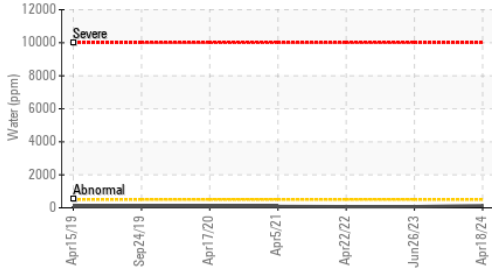


Acid Number

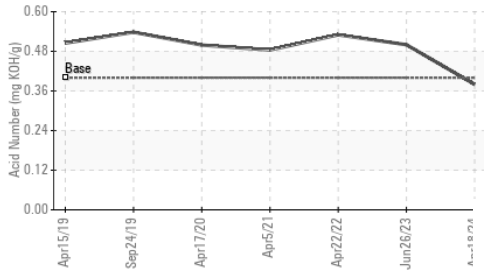

Water (KF)

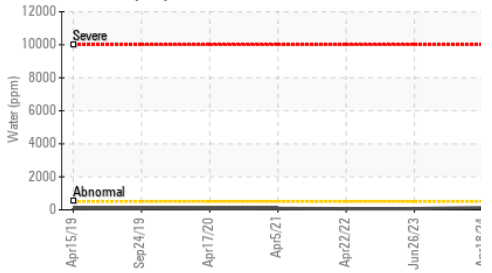

Viscosity @ 40°C

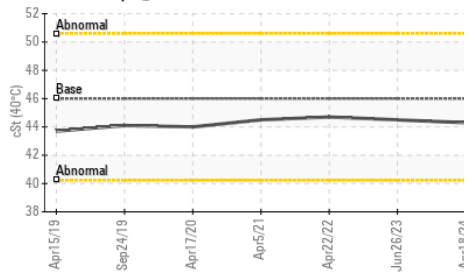


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	44.3	44.5	44.7

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color




Bottom




GRAPHS


Ferrous Alloys

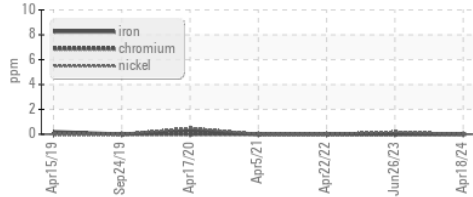


Non-ferrous Metals

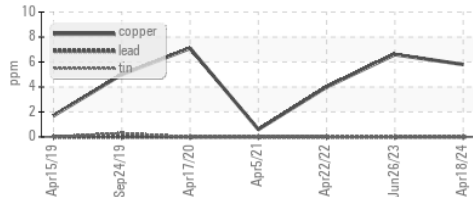


Viscosity @ 40°C

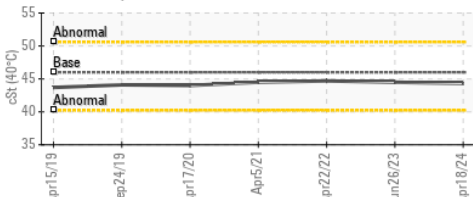

▲ Particle Count

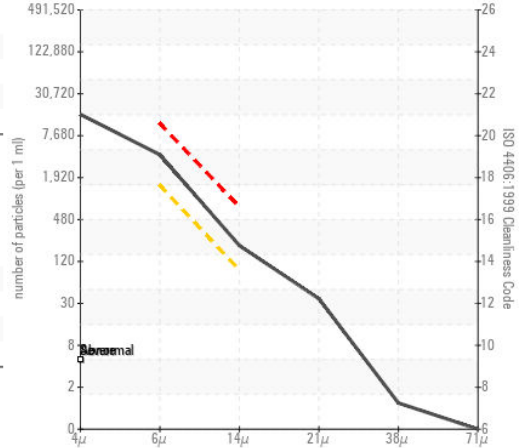

Acid Number

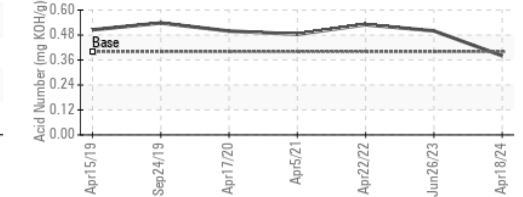

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513

Sample No. : KCPA012711

Lab Number : 06160959

Unique Number : 10996382

Test Package : IND 2 (Additional Tests: KF, PrtCount)

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Received : 25 Apr 2024

Tested : 26 Apr 2024

Diagnosed : 29 Apr 2024 - Don Baldrige

CROWN CORK & SEAL

5005 N SPRINGBORO PIKE

DAYTON, OH

US 45439

Contact: RENE SANTIAGO

RENE.SANTIAGO@CROWNCORK.COM

T:

F: