




# OIL ANALYSIS REPORT

## Sample Rating Trend

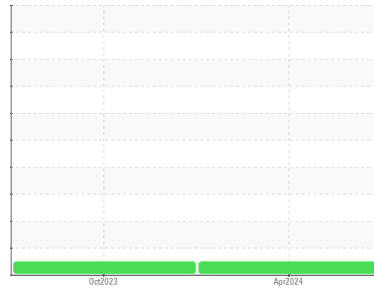

Machine Id  
**KAESER 8586098**  
 Component  
**Compressor**  
 Fluid  
**KAESER SIGMA (OEM) S-460 (--- GAL)**

### DIAGNOSIS

**Recommendation**  
 Resample at the next service interval to monitor.

**Wear**  
 All component wear rates are normal.

**Contamination**  
 The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

**Fluid Condition**  
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>KC06160969</b>	KC124482	---
Sample Date	Client Info			<b>17 Apr 2024</b>	16 Oct 2023	---
Machine Age	hrs	Client Info		<b>408</b>	46	---
Oil Age	hrs	Client Info		<b>0</b>	0	---
Oil Changed	Client Info			<b>N/A</b>	N/A	---
Sample Status				<b>NORMAL</b>	NORMAL	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>0</b>	0	---
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	---
Nickel	ppm	ASTM D5185m	>3	<b>0</b>	0	---
Titanium	ppm	ASTM D5185m	>3	<b>0</b>	0	---
Silver	ppm	ASTM D5185m	>2	<b>0</b>	0	---
Aluminum	ppm	ASTM D5185m	>10	<b>0</b>	0	---
Lead	ppm	ASTM D5185m	>10	<b>0</b>	0	---
Copper	ppm	ASTM D5185m	>50	<b>1</b>	<1	---
Tin	ppm	ASTM D5185m	>10	<b>0</b>	0	---
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	---
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	---





ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	0	---
Barium	ppm	ASTM D5185m	90	<b>5</b>	27	---
Molybdenum	ppm	ASTM D5185m		<b>0</b>	0	---
Manganese	ppm	ASTM D5185m		<b>0</b>	<1	---
Magnesium	ppm	ASTM D5185m	90	<b>54</b>	53	---
Calcium	ppm	ASTM D5185m	2	<b>3</b>	1	---
Phosphorus	ppm	ASTM D5185m		<b>2</b>	1	---
Zinc	ppm	ASTM D5185m		<b>11</b>	12	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>0</b>	<1	---
Sodium	ppm	ASTM D5185m		<b>17</b>	10	---
Potassium	ppm	ASTM D5185m	>20	<b>19</b>	16	---
Water	%	ASTM D6304	>0.05	<b>0.016</b>	0.018	---
ppm Water	ppm	ASTM D6304	>500	<b>165</b>	180.6	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		<b>2098</b>	2026	---
Particles >6µm		ASTM D7647	>1300	<b>810</b>	756	---
Particles >14µm		ASTM D7647	>80	<b>36</b>	22	---
Particles >21µm		ASTM D7647	>20	<b>7</b>	3	---
Particles >38µm		ASTM D7647	>4	<b>0</b>	0	---
Particles >71µm		ASTM D7647	>3	<b>0</b>	0	---
Oil Cleanliness		ISO 4406 (c)	>--/17/13	<b>18/17/12</b>	18/17/12	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	<b>0.26</b>	0.28	---


# OIL ANALYSIS REPORT

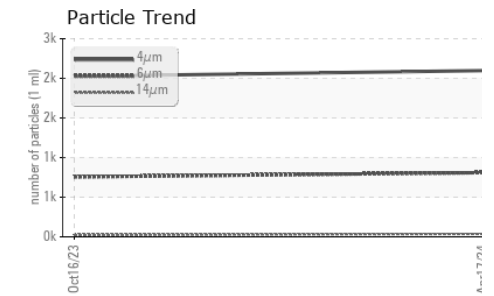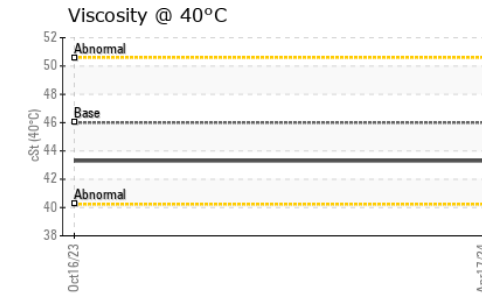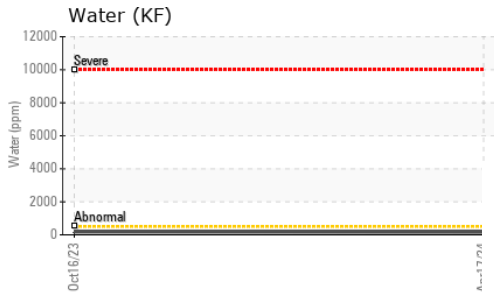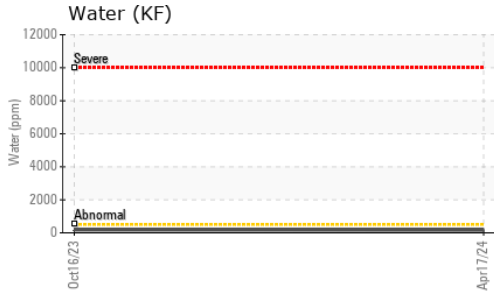






VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Debris	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	---
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	---
Emulsified Water	scalar	*Visual	>0.05	<b>NEG</b>	NEG	---
Free Water	scalar	*Visual		<b>NEG</b>	NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	46	<b>43.3</b>	43.3	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

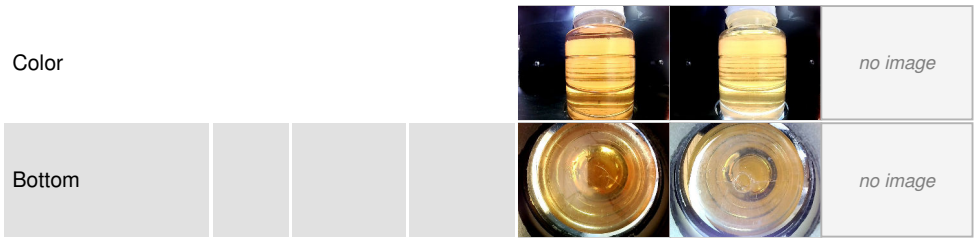

## GRAPHS

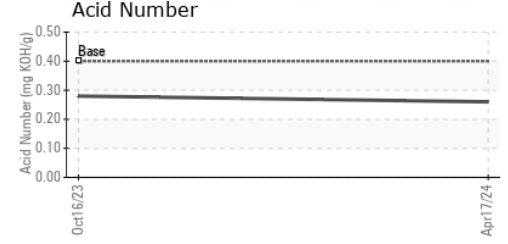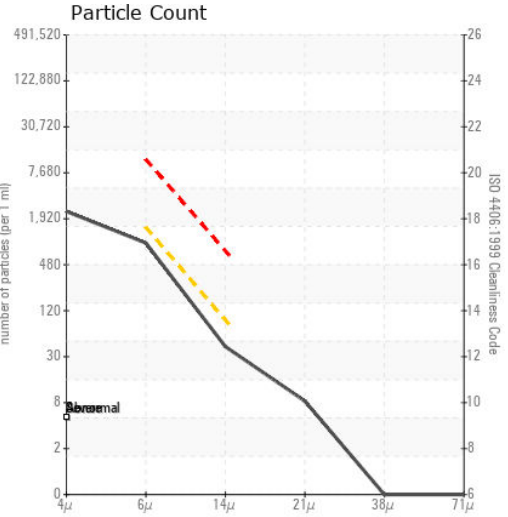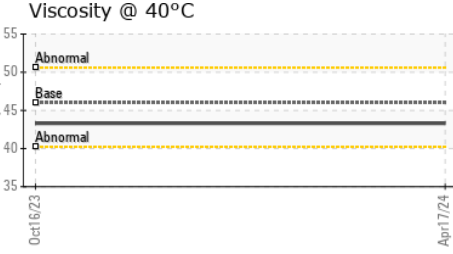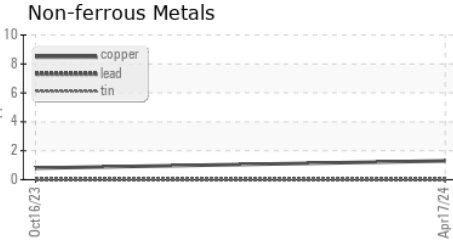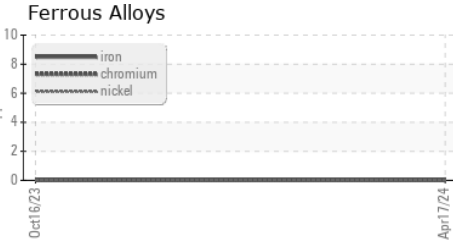

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KC06160969  
**Lab Number** : 06160969  
**Unique Number** : 10996392  
**Test Package** : IND 2  
**Received** : 25 Apr 2024  
**Tested** : 26 Apr 2024  
**Diagnosed** : 29 Apr 2024 - Don Baldrige

**MCKESSON**  
 3056 TRADEPORT DR  
 ORLANDO, FL  
 US 32824  
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)