




# OIL ANALYSIS REPORT

## Sample Rating Trend

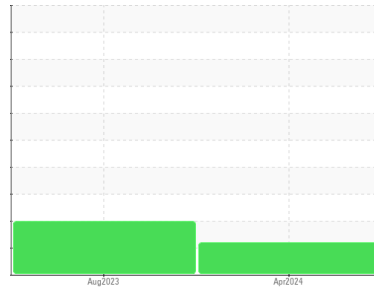

ISO



Machine Id

**KAESER BSD 60 8494296 (S/N 1239)**

Component

**Compressor**

Fluid

**KAESER SIGMA (OEM) M-460 (--- GAL)**

### DIAGNOSIS

#### Recommendation

Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is a moderate amount of particulates present in the oil.

#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>KC130478</b>	KC05944635	---
Sample Date	Client Info			<b>01 Apr 2024</b>	31 Aug 2023	---
Machine Age	hrs	Client Info		<b>7186</b>	4851	---
Oil Age	hrs	Client Info		<b>7186</b>	0	---
Oil Changed	Client Info			<b>Changed</b>	N/A	---
Sample Status				<b>ATTENTION</b>	ABNORMAL	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>0</b>	0	---
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	---
Nickel	ppm	ASTM D5185m	>3	<b>0</b>	0	---
Titanium	ppm	ASTM D5185m	>3	<b>0</b>	0	---
Silver	ppm	ASTM D5185m	>2	<b>0</b>	0	---
Aluminum	ppm	ASTM D5185m	>10	<b>0</b>	0	---
Lead	ppm	ASTM D5185m	>10	<b>0</b>	0	---
Copper	ppm	ASTM D5185m	>50	<b>14</b>	13	---
Tin	ppm	ASTM D5185m	>10	<b>0</b>	0	---
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	---
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	---

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	<b>0</b>	0	---
Barium	ppm	ASTM D5185m	90	<b>0</b>	7	---
Molybdenum	ppm	ASTM D5185m	0	<b>0</b>	0	---
Manganese	ppm	ASTM D5185m		<b>0</b>	0	---
Magnesium	ppm	ASTM D5185m	100	<b>0</b>	13	---
Calcium	ppm	ASTM D5185m	0	<b>0</b>	0	---
Phosphorus	ppm	ASTM D5185m	0	<b>0</b>	3	---
Zinc	ppm	ASTM D5185m	0	<b>13</b>	23	---


CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>&lt;1</b>	<1	---
Sodium	ppm	ASTM D5185m		<b>3</b>	6	---
Potassium	ppm	ASTM D5185m	>20	<b>&lt;1</b>	6	---
Water	%	ASTM D6304	>0.05	<b>0.006</b>	0.015	---
ppm Water	ppm	ASTM D6304	>500	<b>68</b>	150.2	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		<b>2764</b>	8379	---
Particles >6µm		ASTM D7647	>1300	<b>963</b>	▲ 4916	---
Particles >14µm		ASTM D7647	>80	● <b>125</b>	▲ 768	---
Particles >21µm		ASTM D7647	>20	● <b>38</b>	▲ 181	---
Particles >38µm		ASTM D7647	>4	<b>2</b>	▲ 5	---
Particles >71µm		ASTM D7647	>3	<b>0</b>	0	---
Oil Cleanliness		ISO 4406 (c)	>--/17/13	● <b>19/17/14</b>	▲ 20/19/17	---


FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	<b>0.43</b>	0.34	---

# OIL ANALYSIS REPORT


## Particle Trend

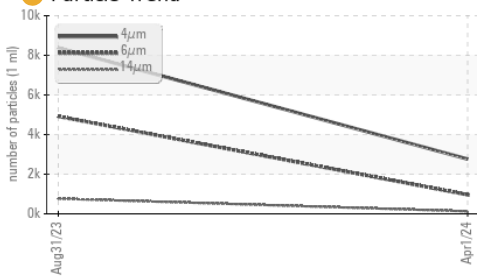

## Water (KF)

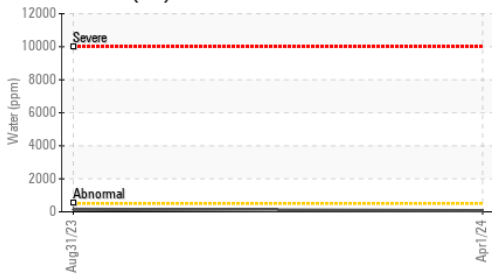


## Acid Number

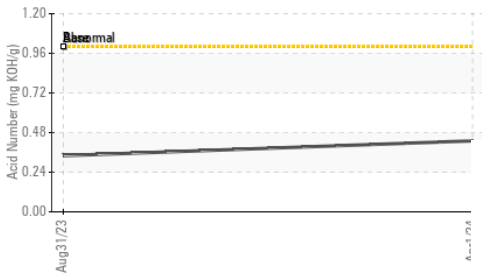

## Water (KF)



## Viscosity @ 40°C

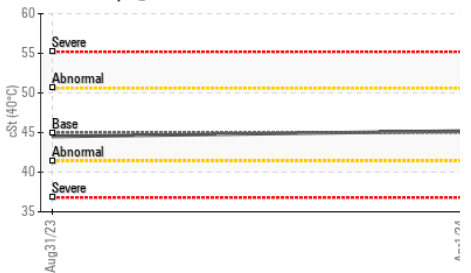

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	44.5	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color




Bottom




## GRAPHS


### Ferrous Alloys

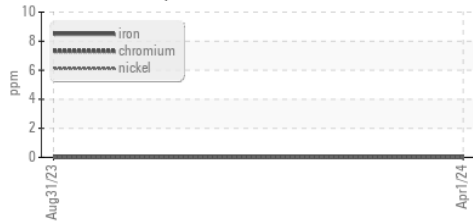


### Non-ferrous Metals

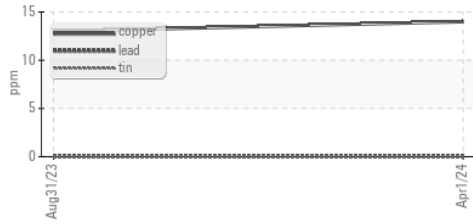


### Viscosity @ 40°C

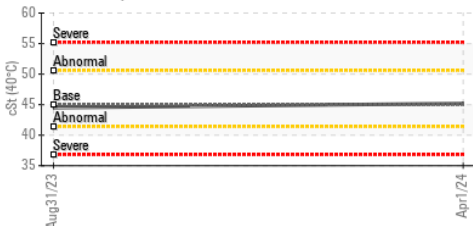

### Particle Count

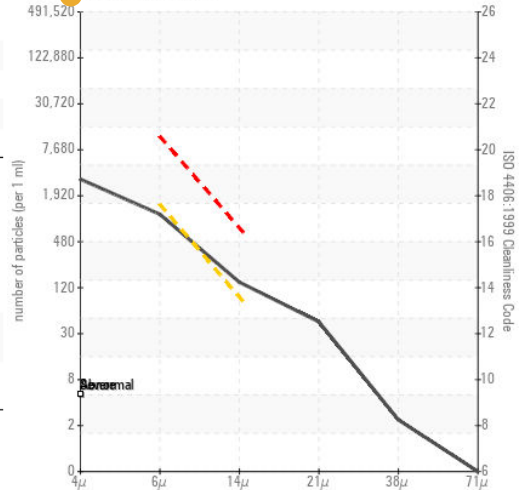

### Acid Number

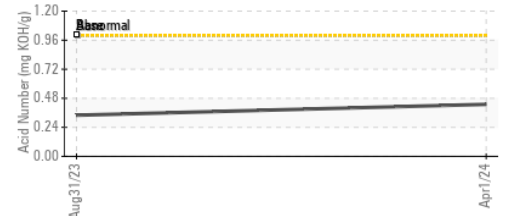

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513

Sample No. : KC130478

Lab Number : 06161436

Unique Number : 10996859

Test Package : IND 2

Received : 26 Apr 2024

Tested : 29 Apr 2024

Diagnosed : 30 Apr 2024 - Don Baldrige

FLOATS & FUEL CELLS

4010 PILOT DRIVE SUITE 103

MEMPHIS, TN

US 38118

Contact: SERVICE MANAGER

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:

F: