




OIL ANALYSIS REPORT

Sample Rating Trend

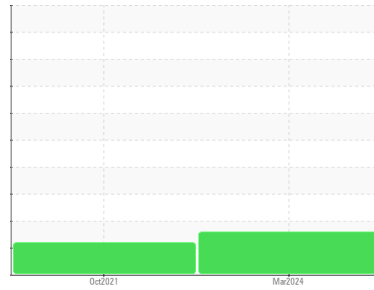

ISO



Machine Id

KAESER SK 20 7451256 (S/N 1282)

Component

Compressor

Fluid

KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			KCPA015075	KCP36414	---
Sample Date	Client Info			28 Mar 2024	05 Oct 2021	---
Machine Age	hrs	Client Info		10099	2491	---
Oil Age	hrs	Client Info		0	2491	---
Oil Changed	Client Info			Not Changed	Changed	---
Sample Status				ABNORMAL	ABNORMAL	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	<1	---
Chromium	ppm	ASTM D5185m	>10	0	0	---
Nickel	ppm	ASTM D5185m	>3	0	<1	---
Titanium	ppm	ASTM D5185m	>3	0	0	---
Silver	ppm	ASTM D5185m	>2	0	<1	---
Aluminum	ppm	ASTM D5185m	>10	0	0	---
Lead	ppm	ASTM D5185m	>10	0	<1	---
Copper	ppm	ASTM D5185m	>50	3	11	---
Tin	ppm	ASTM D5185m	>10	0	0	---
Antimony	ppm	ASTM D5185m		---	0	---
Vanadium	ppm	ASTM D5185m		0	0	---
Cadmium	ppm	ASTM D5185m		0	0	---

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	<1	---
Barium	ppm	ASTM D5185m	90	0	0	---
Molybdenum	ppm	ASTM D5185m		0	0	---
Manganese	ppm	ASTM D5185m		0	<1	---
Magnesium	ppm	ASTM D5185m	90	16	5	---
Calcium	ppm	ASTM D5185m	2	0	0	---
Phosphorus	ppm	ASTM D5185m		0	<1	---
Zinc	ppm	ASTM D5185m		0	0	---
Sulfur	ppm	ASTM D5185m		20814	15706	---


CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	1	---
Sodium	ppm	ASTM D5185m		6	0	---
Potassium	ppm	ASTM D5185m	>20	0	1	---
Water	%	ASTM D6304	>0.05	0.011	0.012	---
ppm Water	ppm	ASTM D6304	>500	111	120.0	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		7012	8022	---
Particles >6µm		ASTM D7647	>1300	▲ 2434	▲ 2220	---
Particles >14µm		ASTM D7647	>80	▲ 172	▲ 194	---
Particles >21µm		ASTM D7647	>20	▲ 36	▲ 47	---
Particles >38µm		ASTM D7647	>4	3	2	---
Particles >71µm		ASTM D7647	>3	0	0	---
Oil Cleanliness		ISO 4406 (c)	>--/17/13	▲ 20/18/15	▲ 18/15	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.40	0.305	---

OIL ANALYSIS REPORT


▲ Particle Trend

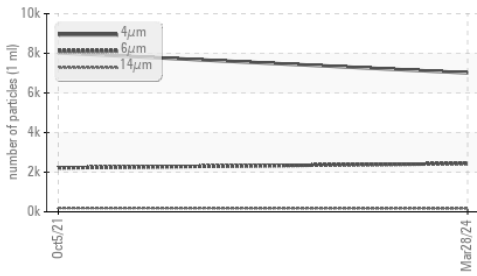

Water (KF)




Acid Number

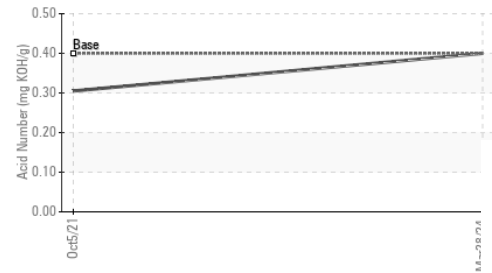

Water (KF)



Viscosity @ 40°C

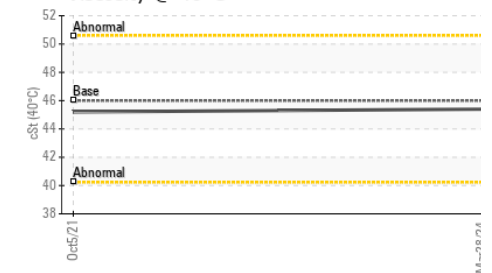


PARAMETER	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	LIGHT	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	45.4	45.2


SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color

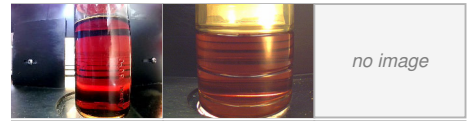

no image

Bottom




no image

GRAPHS


Ferrous Alloys




Non-ferrous Metals

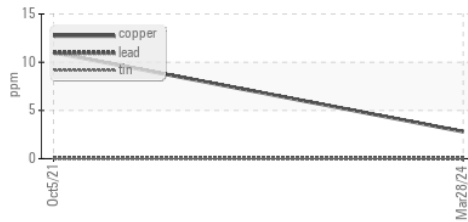


Viscosity @ 40°C

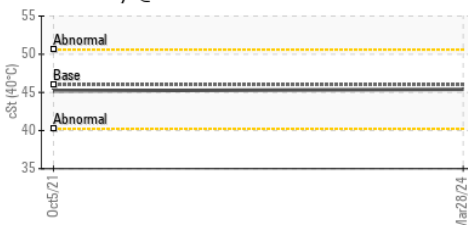

▲ Particle Count

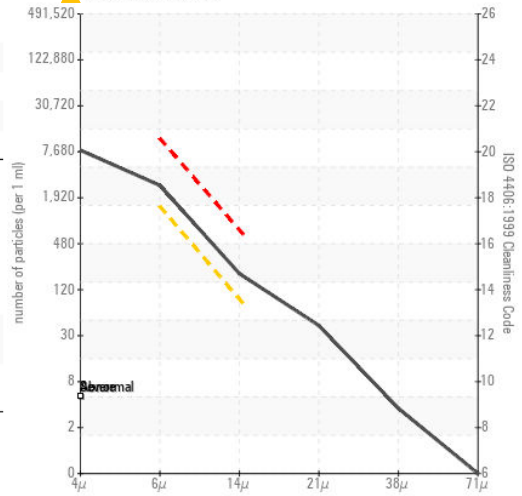

Acid Number

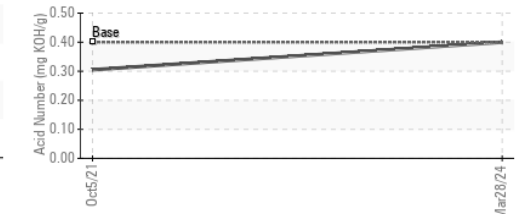

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513

Sample No. : KCPA015075

Lab Number : 06161438

Unique Number : 10996861

Test Package : IND 2 (Additional Tests: KF, PrtCount)

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

UNIFIRST MANUFACTURING

1 UNIFIRST DR

CAVE CITY, AR

US 72521

Contact: ADAM TOMEY

ATOMEY@TGHINDUSTRIAL.COM

T: (386)848-8786

F: