




OIL ANALYSIS REPORT

Sample Rating Trend

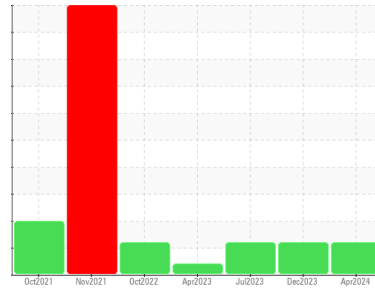

ISO



Area
BAGLINE
 Machine Id
KETTLE 3
 Component
Refrigeration Compressor
 Fluid
PETRO CANADA PURITY FG EP GEAR OIL 220 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

Insufficient sample was received to conduct all the routine laboratory tests. There is a high amount of silt (particulates < 14 microns in size) present in the oil.

Fluid Condition

The condition of the oil is acceptable for the time in service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		USP0006686	USP0004479	USP250215
Sample Date	Client Info		25 Apr 2024	17 Dec 2023	05 Jul 2023
Machine Age	hrs	Client Info	0	0	0
Oil Age	hrs	Client Info	0	0	0
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			ABNORMAL	ABNORMAL	ABNORMAL

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >8	0	1	2
Chromium	ppm	ASTM D5185m >2	0	0	0
Nickel	ppm	ASTM D5185m	0	0	0
Titanium	ppm	ASTM D5185m	0	0	0
Silver	ppm	ASTM D5185m >2	0	0	0
Aluminum	ppm	ASTM D5185m >3	0	<1	<1
Lead	ppm	ASTM D5185m >2	0	0	0
Copper	ppm	ASTM D5185m >8	14	22	30
Tin	ppm	ASTM D5185m >4	<1	<1	3
Vanadium	ppm	ASTM D5185m	0	0	<1
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	4	6	7
Barium	ppm	ASTM D5185m	0	0	<1
Molybdenum	ppm	ASTM D5185m	0	0	0
Manganese	ppm	ASTM D5185m	0	0	0
Magnesium	ppm	ASTM D5185m	0	0	3
Calcium	ppm	ASTM D5185m	0	0	10
Phosphorus	ppm	ASTM D5185m	570	572	586
Zinc	ppm	ASTM D5185m	0	0	5
Sulfur	ppm	ASTM D5185m	560	495	808

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	5	27	11
Sodium	ppm	ASTM D5185m	<1	<1	<1
Potassium	ppm	ASTM D5185m >20	0	0	1
Water	%	ASTM D6304 >0.01	0.003	0.011	0.006
ppm Water	ppm	ASTM D6304 >100	30	112	61.5

FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	▲ 55295	▲ 28899	▲ 43372
Particles >6µm	ASTM D7647	>2500	▲ 8902	● 3815	▲ 6040
Particles >14µm	ASTM D7647	>640	335	30	172
Particles >21µm	ASTM D7647	>160	86	2	54
Particles >38µm	ASTM D7647	>40	3	0	5
Particles >71µm	ASTM D7647	>10	0	0	1
Oil Cleanliness	ISO 4406 (c)	>20/18/16	▲ 23/20/16	▲ 22/19/12	▲ 23/20/15


FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974 0.51	---	0.67	0.72




OIL ANALYSIS REPORT


Particle Trend

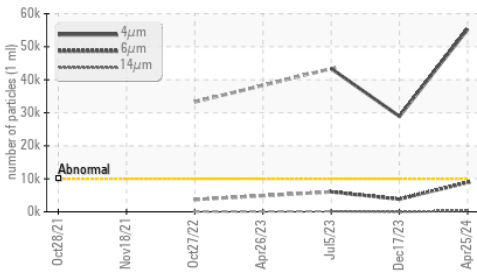


Water (KF)

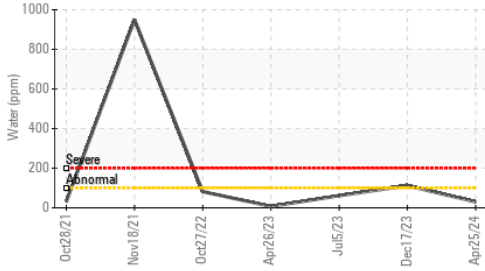


Water (KF)

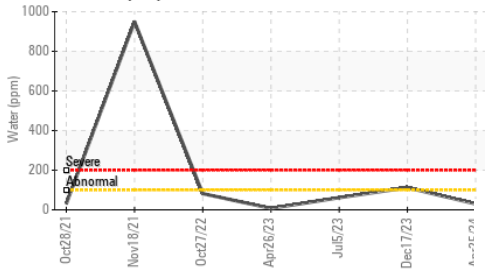

Viscosity @ 40°C

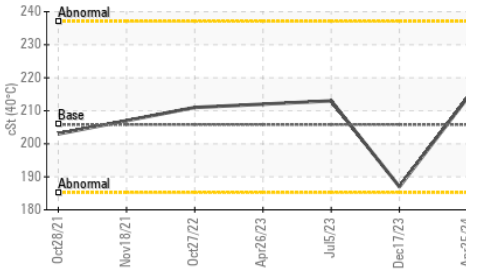


Acid Number

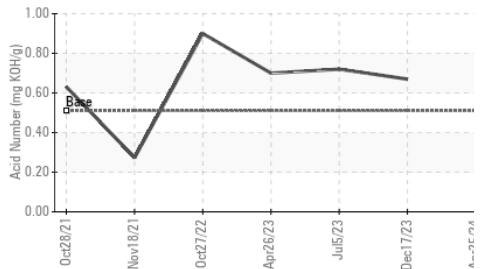

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.01	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	205.8	214	187	213

SAMPLE IMAGES

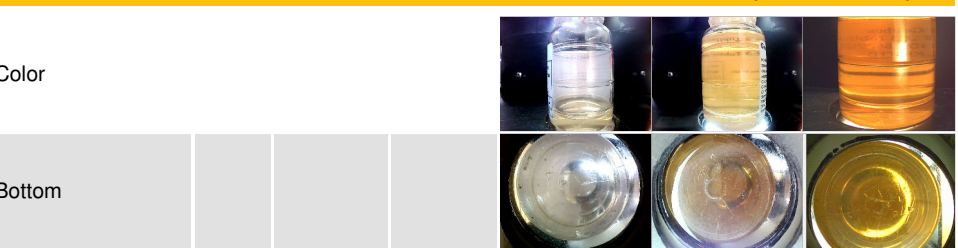


GRAPHS


Ferrous Alloys

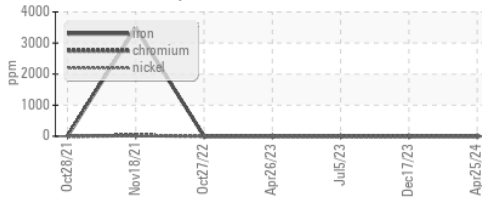


Non-ferrous Metals

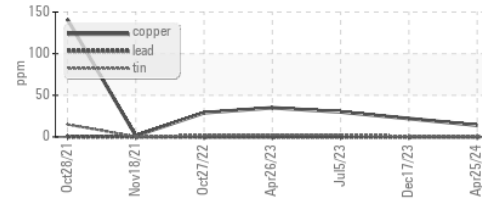


Viscosity @ 40°C

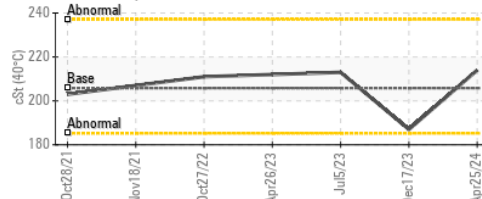

Particle Count

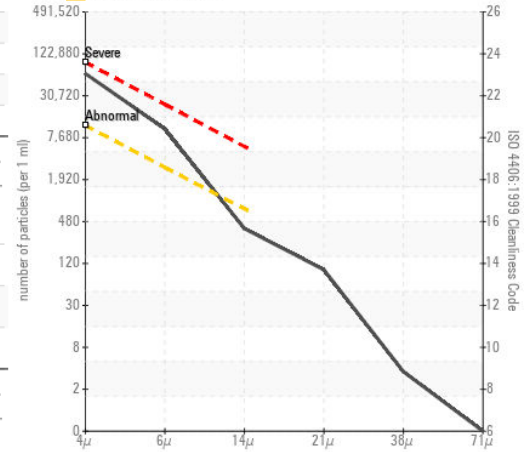

Acid Number

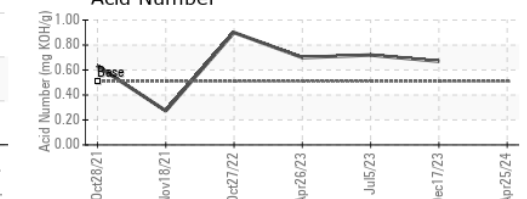

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
 Sample No. : USP0006686
 Lab Number : 06161484
 Unique Number : 10996907
 Test Package : IND 2

KraftHeinz - Cedar Rapids - Plant 8370
 4601 C ST SW
 CEDAR RAPIDS, IA
 US 52404
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: