

OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL



Machine Id

40-5 GEA ER1 (S/N 060539)

Refrigeration Compressor

USPI ALT-68 SC (150 GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the component. The amount and size of particulates present in the system is acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

złots Oczłots Oczłott Jun2019 Jun2020 Oczłożo Oczłoż Jul2022 Apyzłoż Apyzło						
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		USP0006671	USP0004804	USP0003200
Sample Date		Client Info		25 Apr 2024	04 Jan 2024	11 Oct 2023
Machine Age	hrs	Client Info		68438	68309	68260
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				NORMAL	NORMAL	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>8	0	<1	<1
Chromium	ppm	ASTM D5185m	>2	0	<1	0
Nickel	ppm	ASTM D5185m		0	0	0
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>3	0	0	0
Lead	ppm	ASTM D5185m	>2	0	0	0
Copper	ppm	ASTM D5185m	>8	0	0	0
Tin	ppm	ASTM D5185m	>4	0	0	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	0	0
Magnesium	ppm	ASTM D5185m		0	0	0
Calcium	ppm	ASTM D5185m		0	<1	0
Phosphorus	ppm	ASTM D5185m		0	0	0
Zinc	ppm	ASTM D5185m		0	0	0
Sulfur	ppm	ASTM D5185m	50	0	0	4
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	<1	<1	1
Sodium	ppm	ASTM D5185m		<1	0	0
Potassium	ppm	ASTM D5185m	>20	0	<1	0
Water	%	ASTM D6304	>0.01	0.008	0.004	0.005
ppm Water	ppm	ASTM D6304	>100	90	42	55.2
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	5166	9314	4434
Particles >6µm		ASTM D7647	>2500	1071	2216	1095
Particles >14μm		ASTM D7647	>640	43	44	36
Particles >21µm		ASTM D7647	>160	8	5	6
Particles >38μm		ASTM D7647	>40	1	0	0
Particles >71μm		ASTM D7647	>10	0	0	0
Oil Cleanliness		ISO 4406 (c)	>20/18/16	20/17/13	20/18/13	19/17/12
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
A alial Niversia au (ANI)	I/OII/-	ACTM DOZA	0.005	0.015	0.014	0.015

Acid Number (AN)

0.014


0.015

mg KOH/g ASTM D974 0.005

0.015



OIL ANALYSIS REPORT

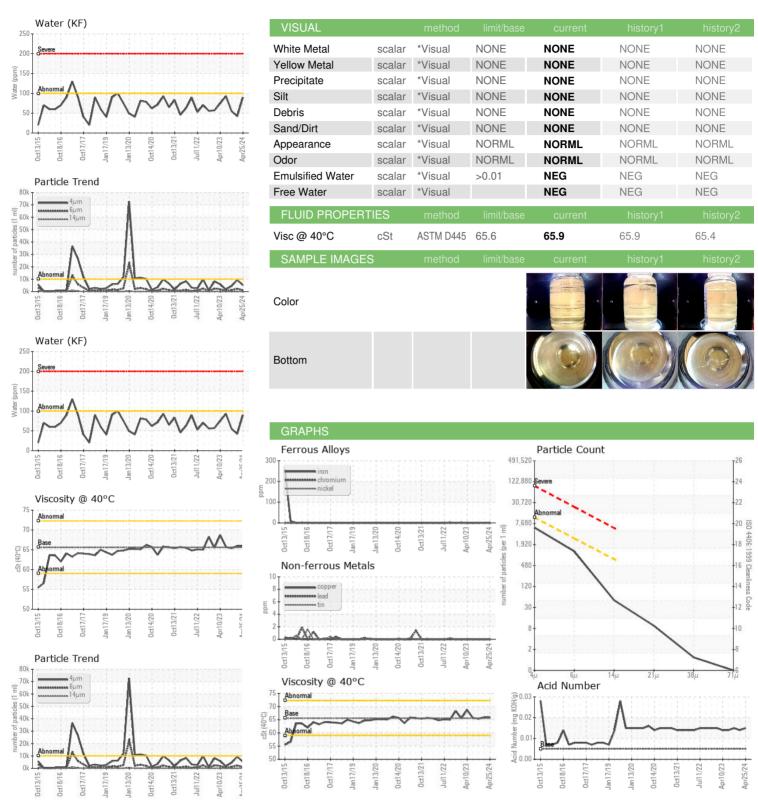





Laboratory Sample No. Lab Number

: USP0006671 : 06161514 Unique Number : 10996937 Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 26 Apr 2024 **Tested** : 30 Apr 2024

Diagnosed : 30 Apr 2024 - Jonathan Hester

Certificate 12367 To discuss this sample report, contact Customer Service at 1-800-237-1369.

 st - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Contact/Location: ? ? - KRANEWUSP

KraftHeinz - Newberry - Plant 8335

3704 LOUIS RICH DR

NEWBERRY, SC

US 29108

Contact:

T:

F: