

## **OIL ANALYSIS REPORT**

#### Sample Rating Trend



NORMAL



Machine Id

# FRICK TYSPBFP 6HS (S/N TDSH193L1532D)

Refrigeration Compressor

USPI ALT-68 SC (65 GAL)

#### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the component. The amount and size of particulates present in the system is acceptable.


#### **Fluid Condition**


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


2012 May2014 Jul2015 Dec2016 Jun2019 Sep2019 Jun2021 Feb2023						
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		USP0006648	USP0005628	USP0001188
Sample Date		Client Info		27 Apr 2024	23 Jan 2024	15 Oct 2023
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				NORMAL	NORMAL	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>8	0	0	0
Chromium	ppm	ASTM D5185m	>2	0	0	0
Nickel	ppm	ASTM D5185m		0	0	<1
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>3	0	0	0
Lead	ppm	ASTM D5185m	>2	0	0	<1
Copper	ppm	ASTM D5185m	>8	0	<1	0
Tin	ppm	ASTM D5185m	>4	0	0	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	<1	0
Magnesium	ppm	ASTM D5185m		0	<1	<1
Calcium	ppm	ASTM D5185m		0	1	0
Phosphorus	ppm	ASTM D5185m		0	0	0
Zinc	ppm	ASTM D5185m		0	0	1
Sulfur	ppm	ASTM D5185m	50	0	3	0
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	<1	2	<1
Sodium	ppm	ASTM D5185m		0	<1	0
Potassium	ppm	ASTM D5185m	>20	0	0	<1
Water	%	ASTM D6304	>0.01	0.001	0.006	0.003
ppm Water	ppm	ASTM D6304	>100	8	61	37.2
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		1227	4166	4100
Particles >6µm		ASTM D7647	>2500	213	672	910
Particles >14µm		ASTM D7647	>320	8	27	29
Particles >21µm		ASTM D7647	>80	3	5	5
Particles >38µm		ASTM D7647	>20	0	0	1
Particles >71µm		ASTM D7647	>4	0	0	0
Oil Cleanliness		ISO 4406 (c)	>/18/15	17/15/10	19/17/12	19/17/12
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974	0.005	0.015	0.014	0.014





### **OIL ANALYSIS REPORT**












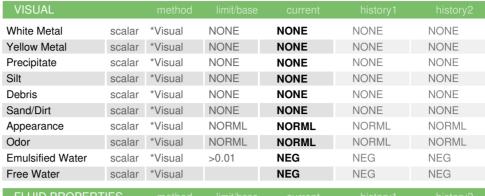


FLUID PROPER	HES	method	ilmit/base		nistory i	nistoryz
Visc @ 40°C	cSt	ASTM D445	65.6	64.5	64.5	65.2

SAMPLE	IMAGES	

Color

**Bottom** 



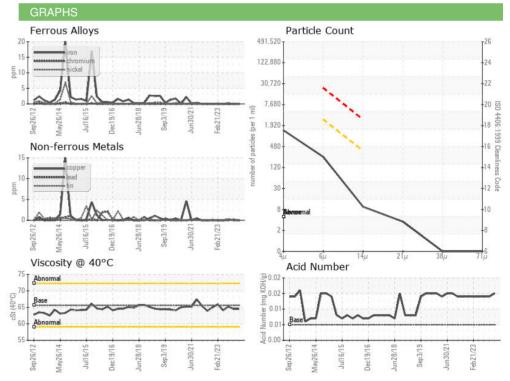





Certificate 12367

Laboratory Sample No. Lab Number

: USP0006648 : 06161527

: WearCheck USA - 501 Madison Ave., Cary, NC 27513

Unique Number : 10996950 Test Package : IND 2

Received : 26 Apr 2024

**Tested** : 30 Apr 2024 Diagnosed : 30 Apr 2024 - Jonathan Hester

**TYSON FP-PINE BLUFF-USP** 

PINE BLUFF, AR US 71602

Contact: RICHARD RICKELS

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Report Id: TYSPBFP [WUSCAR] 06161527 (Generated: 05/04/2024 05:34:23) Rev: 1

Contact/Location: RICHARD RICKELS - TYSPBFP

T:

F: