


# **OIL ANALYSIS REPORT**

Sample Rating Trend



NORMAL



Machine Id

# FRICK TYSPBFP 2B (S/N TDSL283XL0038JJ)

Refrigeration Compressor

**USPI ALT-68 SC (165 GAL)** 

## DIAGNOSIS

## Recommendation

Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

## Contamination

There is no indication of any contamination in the component. The amount and size of particulates present in the system is acceptable.


# **Fluid Condition**


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


		52012 May20	14 Jul2015 Dec2016	Jun2018 Jan2020 Jun2021 F	eb 2023	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		USP0006646	USP0005590	USP0001200
Sample Date		Client Info		27 Apr 2024	23 Jan 2024	15 Oct 2023
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				NORMAL	NORMAL	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>8	0	0	0
Chromium	ppm	ASTM D5185m	>2	0	0	0
Nickel	ppm	ASTM D5185m		0	0	<1
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>3	0	0	0
Lead	ppm	ASTM D5185m	>2	0	0	<1
Copper	ppm	ASTM D5185m	>8	0	0	0
Tin	ppm	ASTM D5185m	>4	0	<1	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	<1	0
Magnesium	ppm	ASTM D5185m		0	0	0
Calcium	ppm	ASTM D5185m		0	0	0
Phosphorus	ppm	ASTM D5185m		0	0	0
Zinc	ppm	ASTM D5185m		0	0	<1
Sulfur	ppm	ASTM D5185m	50	0	2	0
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	2	2	2
Sodium	ppm	ASTM D5185m		0	<1	0
Potassium	ppm	ASTM D5185m	>20	0	0	<1
Water	%	ASTM D6304	>0.01	0.002	0.004	0.003
ppm Water	ppm	ASTM D6304	>100	17	46	37.6
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	535	5499	8972
Particles >6µm		ASTM D7647	>2500	101	1633	1666
Particles >14µm		ASTM D7647	>320	8	68	46
Particles >21µm		ASTM D7647	>80	3	8	7
Particles >38µm		ASTM D7647	>20	0	0	0
Particles >71μm		ASTM D7647	>4	0	0	0
Oil Cleanliness		ISO 4406 (c)	>20/18/15	16/14/10	20/18/13	20/18/13
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974	0.005	0.014	0.014	0.011





# **OIL ANALYSIS REPORT**












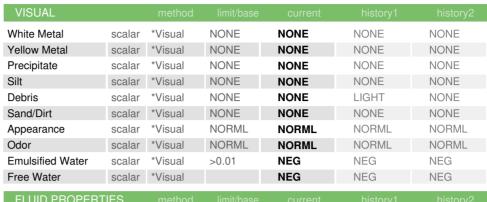

T LOID I HOI LITT	ILO					
Visc @ 40°C	cSt	ASTM D445	65.6	68.0	67.1	67.6


SAMPLE IMAGES	

Color

**Bottom** 





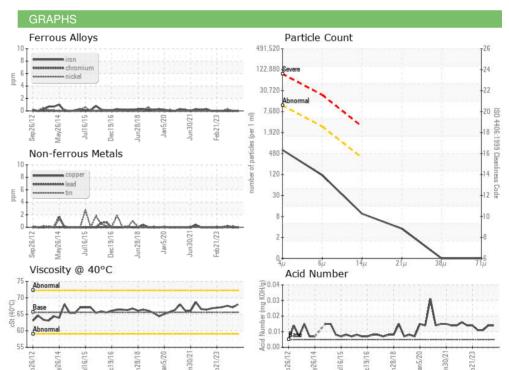





Certificate 12367

Laboratory Sample No. Lab Number

Test Package : IND 2

: USP0006646 : 06161529

Unique Number : 10996952

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 26 Apr 2024 **Tested** 

: 30 Apr 2024

Diagnosed : 30 Apr 2024 - Jonathan Hester **TYSON FP-PINE BLUFF-USP** 

PINE BLUFF, AR US 71602

Contact: RICHARD RICKELS

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:

F: