

# **OIL ANALYSIS REPORT**

## Sample Rating Trend



Machine Id

# FRICK TYSPBFP 7HS (S/N TDSH193L1546D)

Refrigeration Compressor

USPI ALT-68 SC (65 GAL)

#### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the component. The amount and size of particulates present in the system is acceptable.


### **Fluid Condition**


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


w/d011 Feb/2013 Nov/d014 Mey/d016 Nov/d017 Mey/d019 Des/d020 Des/d020 Des/d020										
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2				
Sample Number		Client Info		USP0006644	USP0005604	USP243901				
Sample Date		Client Info		27 Apr 2024	23 Jan 2024	18 Jun 2023				
Machine Age	hrs	Client Info		0	0	0				
Oil Age	hrs	Client Info		0	0	0				
Oil Changed		Client Info		N/A	N/A	N/A				
Sample Status				NORMAL	ABNORMAL	ABNORMAL				
WEAR METALS		method	limit/base	current	history1	history2				
Iron	ppm	ASTM D5185m	>8	0	0	0				
Chromium	ppm	ASTM D5185m	>2	0	0	0				
Nickel	ppm	ASTM D5185m		0	0	<1				
Titanium	ppm	ASTM D5185m		0	0	0				
Silver	ppm	ASTM D5185m	>2	0	0	0				
Aluminum	ppm	ASTM D5185m	>3	0	0	0				
Lead	ppm	ASTM D5185m	>2	0	0	0				
Copper	ppm	ASTM D5185m	>8	0	0	0				
Tin	ppm	ASTM D5185m	>4	0	<1	0				
Vanadium	ppm	ASTM D5185m		0	0	0				
Cadmium	ppm	ASTM D5185m		0	0	0				
ADDITIVES		method	limit/base	current	history1	history2				
Boron	ppm	ASTM D5185m		0	0	0				
Barium	ppm	ASTM D5185m		0	0	0				
Molybdenum	ppm	ASTM D5185m		0	0	0				
Manganese	ppm	ASTM D5185m		0	<1	0				
Magnesium	ppm	ASTM D5185m		0	<1	0				
Calcium	ppm	ASTM D5185m		0	1	0				
Phosphorus	ppm	ASTM D5185m		0	0	1				
Zinc	ppm	ASTM D5185m		0	0	<1				
Sulfur	ppm	ASTM D5185m	50	0	7	0				
CONTAMINANTS		method	limit/base	current	history1	history2				
Silicon	ppm	ASTM D5185m	>15	1	3	2				
Sodium	ppm	ASTM D5185m		0	1	0				
Potassium	ppm	ASTM D5185m	>20	0	0	<1				
Water	%	ASTM D6304	>0.01	0.002	0.004	0.003				
ppm Water	ppm	ASTM D6304	>100	22	49	37.3				
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2				
Particles >4µm		ASTM D7647	>10000	2722	<u> </u>	<u>^</u> 20339				
Particles >6µm		ASTM D7647	>2500	570	△ 5557	4491				
Particles >14µm		ASTM D7647	>320	22	76	111				
Particles >21µm		ASTM D7647	>80	5	7	19				
Particles >38µm		ASTM D7647	>20	0	1	0				
Particles >71µm		ASTM D7647	>4	0	0	0				
Oil Cleanliness		ISO 4406 (c)	>20/18/15	19/16/12	<u>22/20/13</u>	<u>22/19/14</u>				
FLUID DEGRADA	TION	method	limit/base	current	history1	history2				
Acid Number (AN)	mg KOH/g	ASTM D974	0.005	0.014	0.014	0.013				





## **OIL ANALYSIS REPORT**












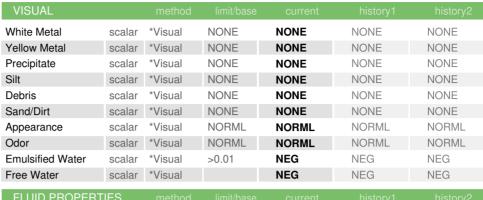

I LOID I HOI LITTILO							
Visc @ 40°C	cSt	ASTM D445	65.6	65.1	65.3	65.1	

SAMPLE IMAGES









Color







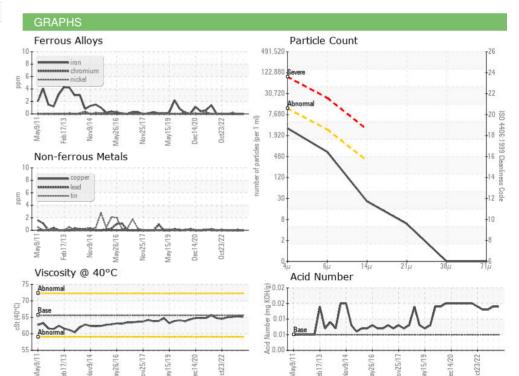





Certificate 12367

Laboratory Sample No. Lab Number

: USP0006644 : 06161532 Unique Number : 10996955 Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 26 Apr 2024

**Tested** : 30 Apr 2024 Diagnosed

: 30 Apr 2024 - Jonathan Hester

PINE BLUFF, AR US 71602

Contact: RICHARD RICKELS

**TYSON FP-PINE BLUFF-USP** 

To discuss this sample report, contact Customer Service at 1-800-237-1369.

 $^st$  - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:

F: